EPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

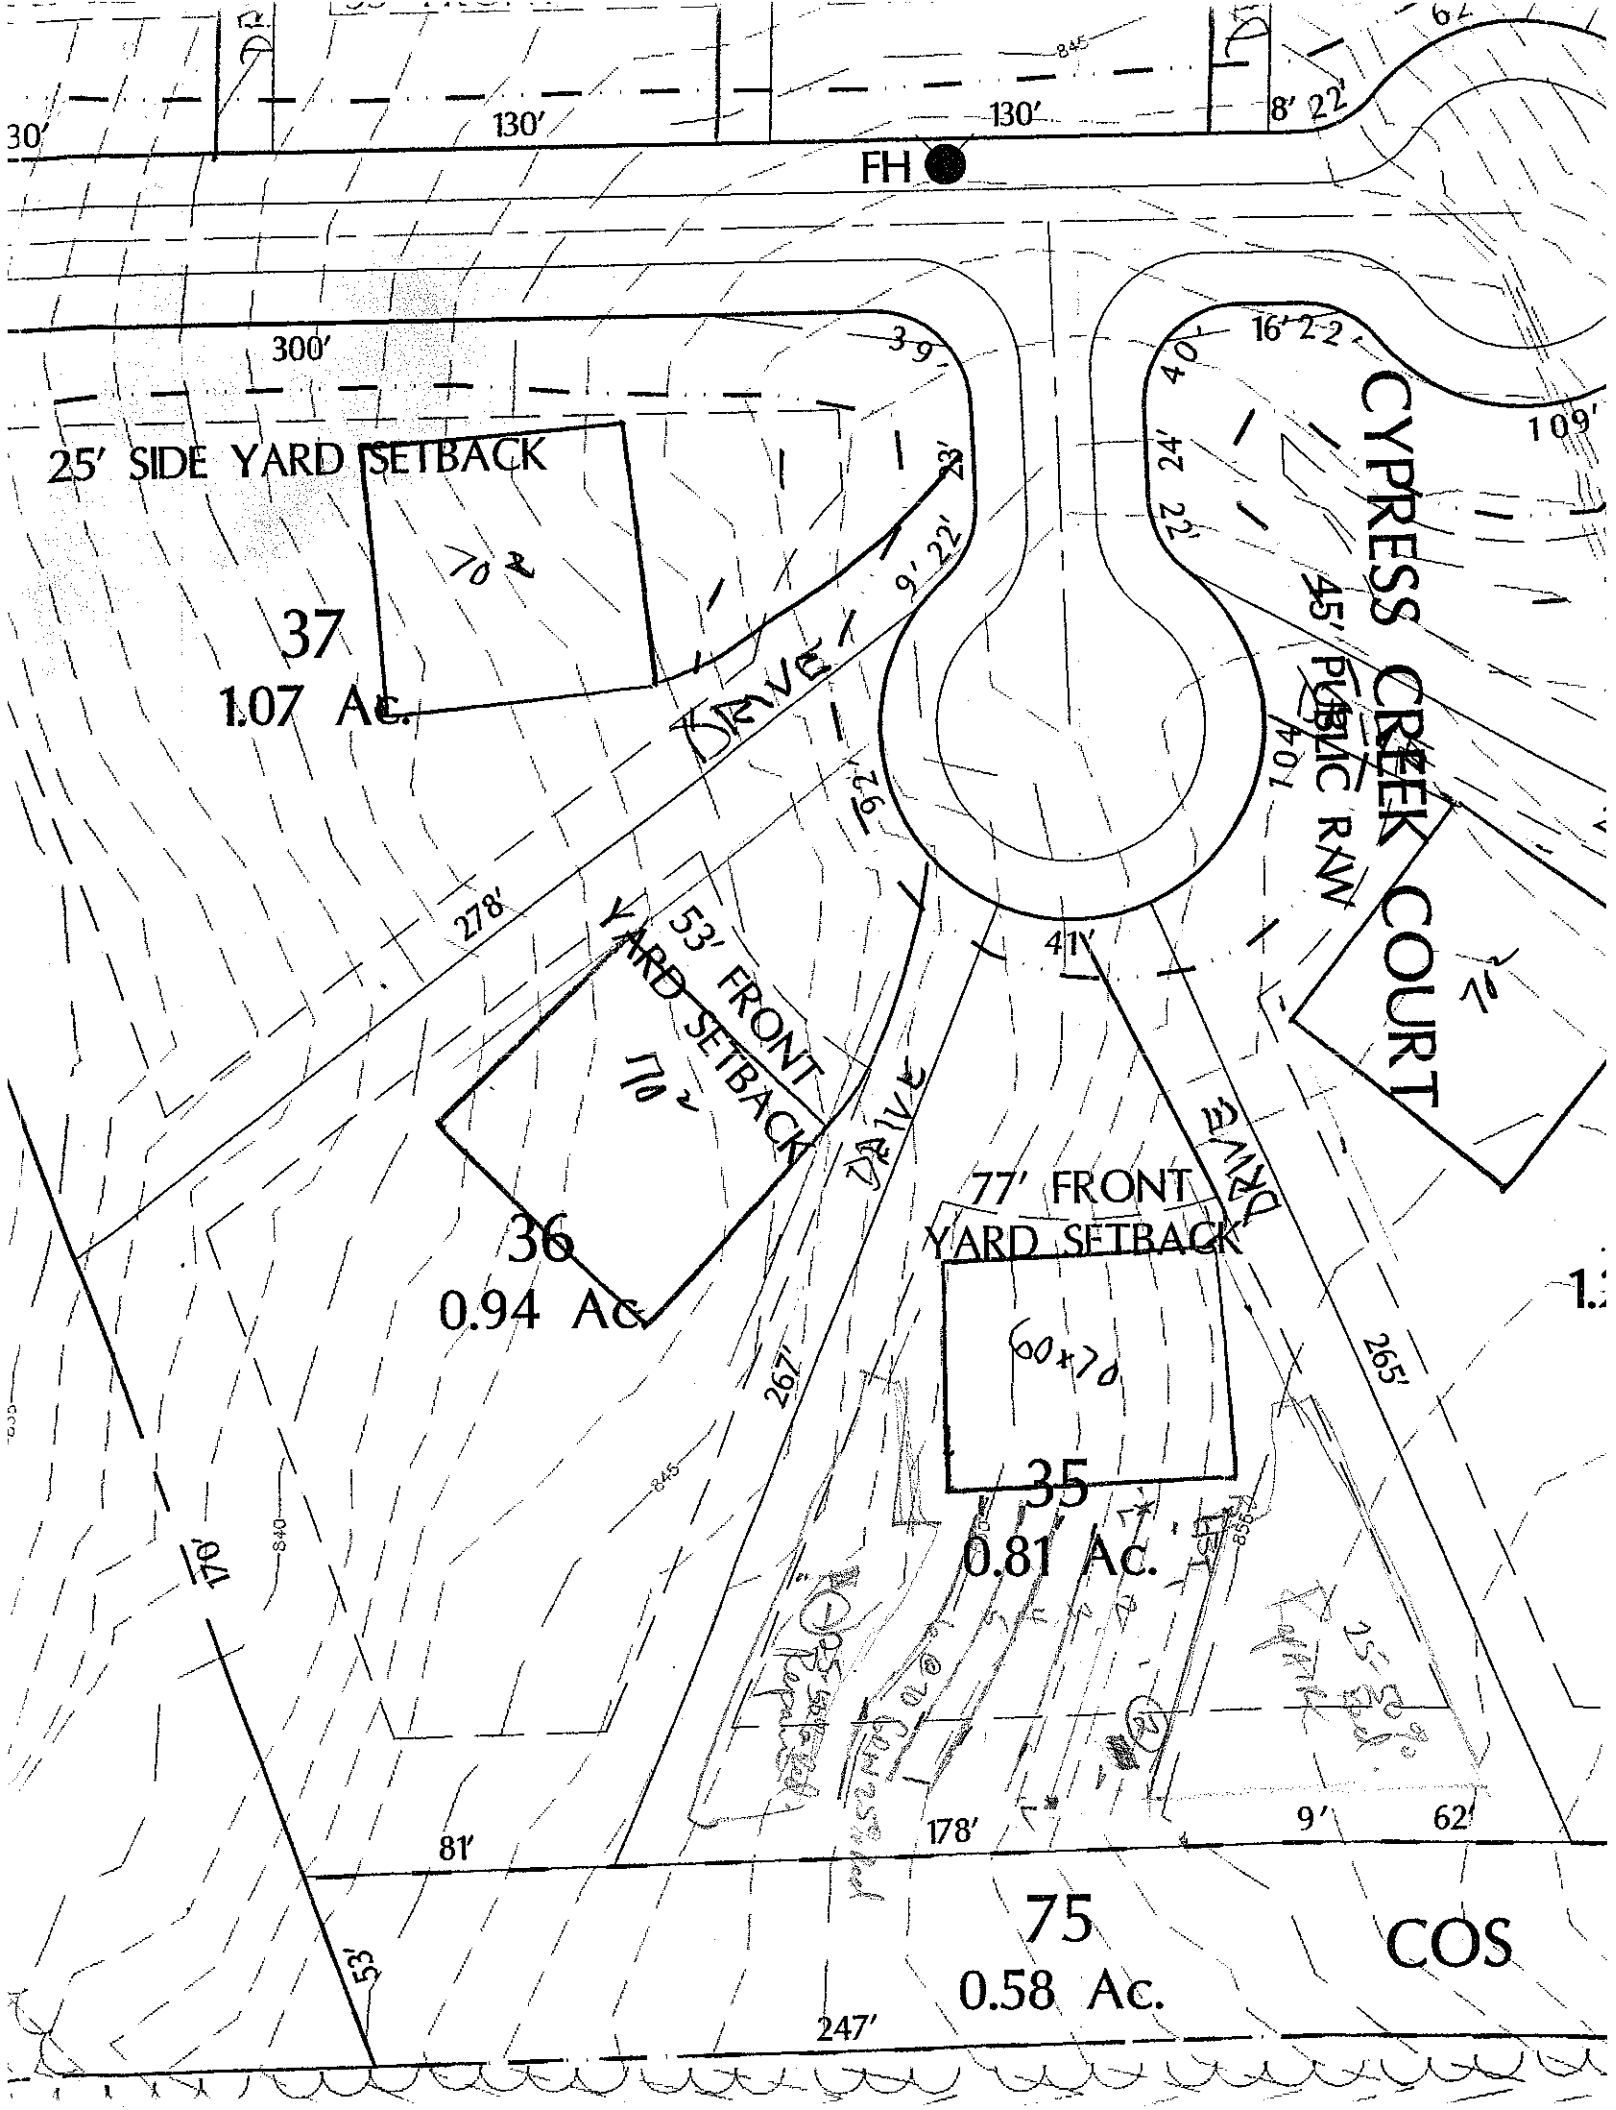
OWNER: CPL APPLICATION DATE _____
ADDRESS: _____ DATE EVALUATED: 3-27-24
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: lot 35 Lakeforest PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-6	wk fsbk sl sl fr ss sp						.3
		6-36	m fsbk sc fr ss sp						
		36-53	m fsbk sc fr ss sp						
2	6-8%	0-28 (AA)	wk fsbk sl/sdy l fr ss sp		few lite yellow mottles				.3
		28-52	m fsbk sc fr ss sp						
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	Gravel 25% Red	LPP bars
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: _____
OTHER(S) PRESENT: _____

COMMENTS: _____


130'
130'
8' 22'
FH
300'
25' SIDE YARD SETBACK
37
1.07 Ac.
DRIVE
9' 22'
CYPRESS CREEK COURT
45' PUBLIC R/W
16' 22'
109'
278'
53' FRONT YARD SETBACK
170'
36
0.94 Ac.
DRIVE
411'
77' FRONT YARD SETBACK
60x70
35
0.81 Ac.
267'
265'
845
840
81'
178'
9'
62'
75
0.58 Ac.
COS
247'