DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

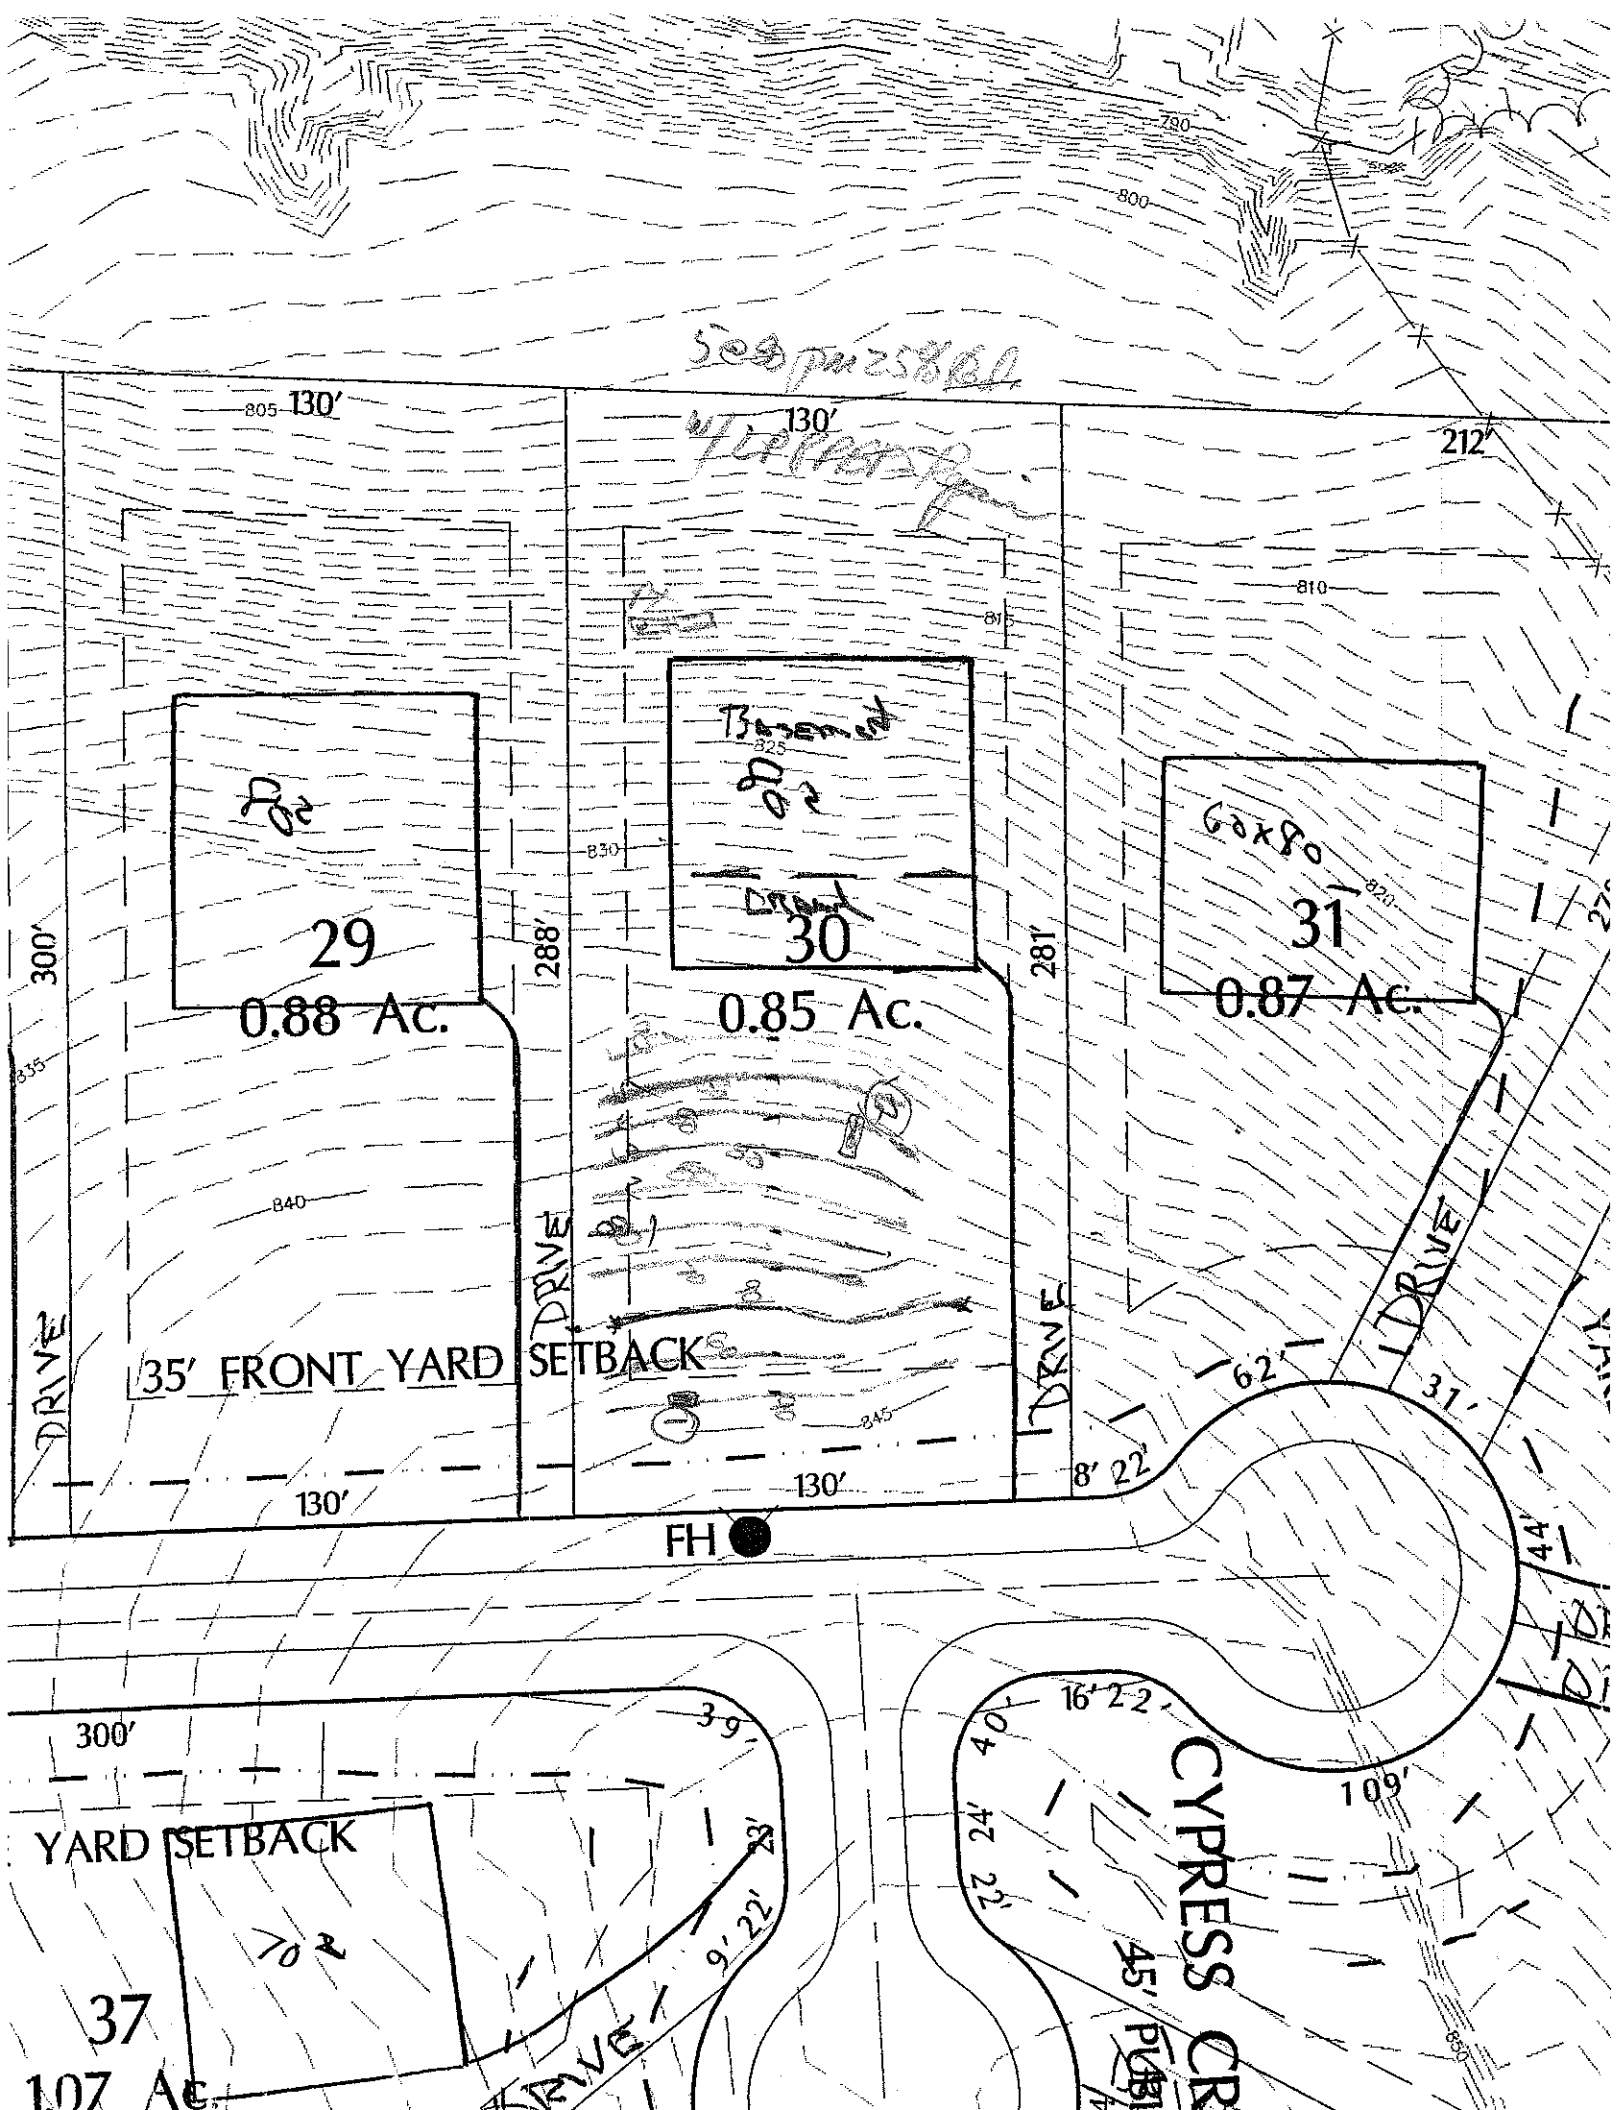
OWNER: CRT APPLICATION DATE _____
ADDRESS: _____ DATE EVALUATED: 3-28-03
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 480 gpd PROPERTY SIZE: _____
LOCATION OF SITE: Lot 30 Lakefront PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☒ Public ☐ Well ☒ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	8%	0-23	mfsbk Ra	frssp					
		23-51	wkfsbk-Rcl	frssp	brownish sap				.3
2		0-15	wksbk brnsl	frssp					
		15-30	mfsbk Rc	frssp	sap				.3
		30-48	(B-C) wkfsbk yrch	frssp	few mottling sap				
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	15	15 proposed
System Type(s)	PM 25% Red.	LPPBPS
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): B
EVALUATED BY: DLH
OTHER(S) PRESENT: Paul Pennington

COMMENTS: _____


130'
130'
212'
29
0.88 Ac.
30
0.85 Ac.
31
0.87 Ac.
300'
288'
281'
DRIVE
DRIVE
DRIVE
DRIVE
35' FRONT YARD SETBACK
130'
130'
62'
31'
8' 22'
FH
44'
300'
39'
YARD SETBACK
37
1.07 Ac.
9' 22'
16' 22'
40'
24'
22'
109'
CYPRESS CR
45'
PUBL