EPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: CRT APPLICATION DATE _____
ADDRESS: _____ DATE EVALUATED: 4-17-03
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 4Bdrm PROPERTY SIZE: _____
LOCATION OF SITE: 58 & SFE Lakefront PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☒ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

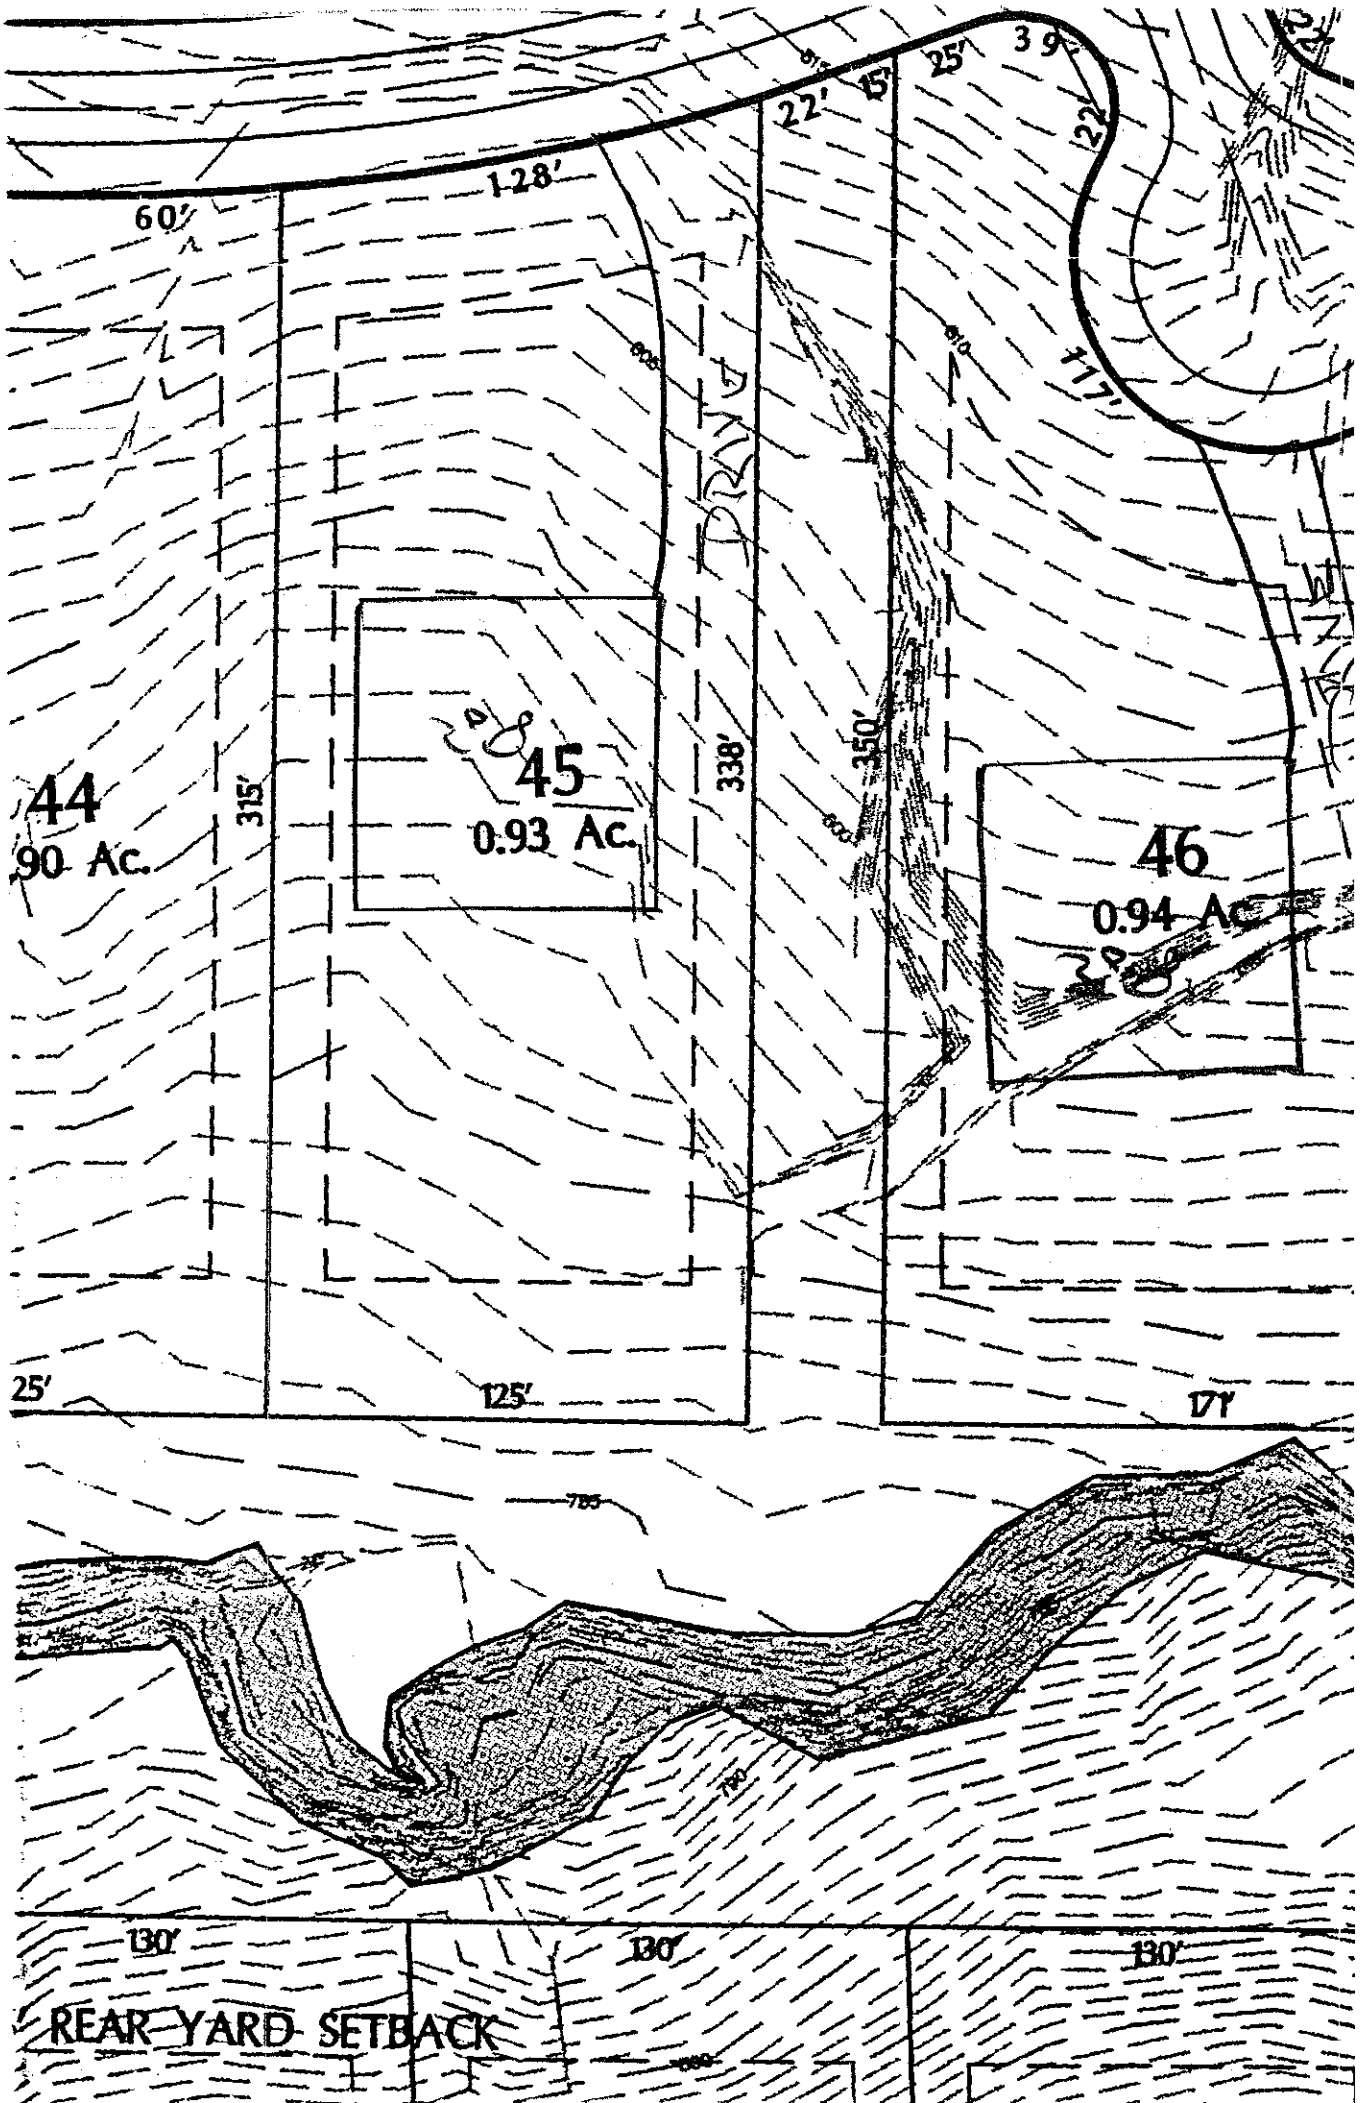
Now SFE 45A

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-6	gr brn sl	frssso					
		6-34	MPABK RC	frSO SOPO	few-common yl brn mottles				.25-.3
		34-52	wk fsbk RCL	frssso	few fine mnl SWP				
2	N3%	0-9	gr brn sl	frssso					
		9-26	MPsbk RC	fr SO SOPO					.3
		26-54	wk fsbk yl cl	fr SSSO	few mnl SWP				
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS .1956	PS per .1958
System Type(s)	LPPBPS	LPPBPS
Site LTAR	.3	.25-.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): BS
EVALUATED BY: DCH
OTHER(S) PRESENT: Paul Henninger

COMMENTS: _____


128'
60'
22'
25'
117'
44
90 Ac.
315'
45
0.93 Ac.
338'
350'
46
0.94 Ac.
25'
125'
171'
130'
130'
130'
REAR YARD SETBACK