PARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
SION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

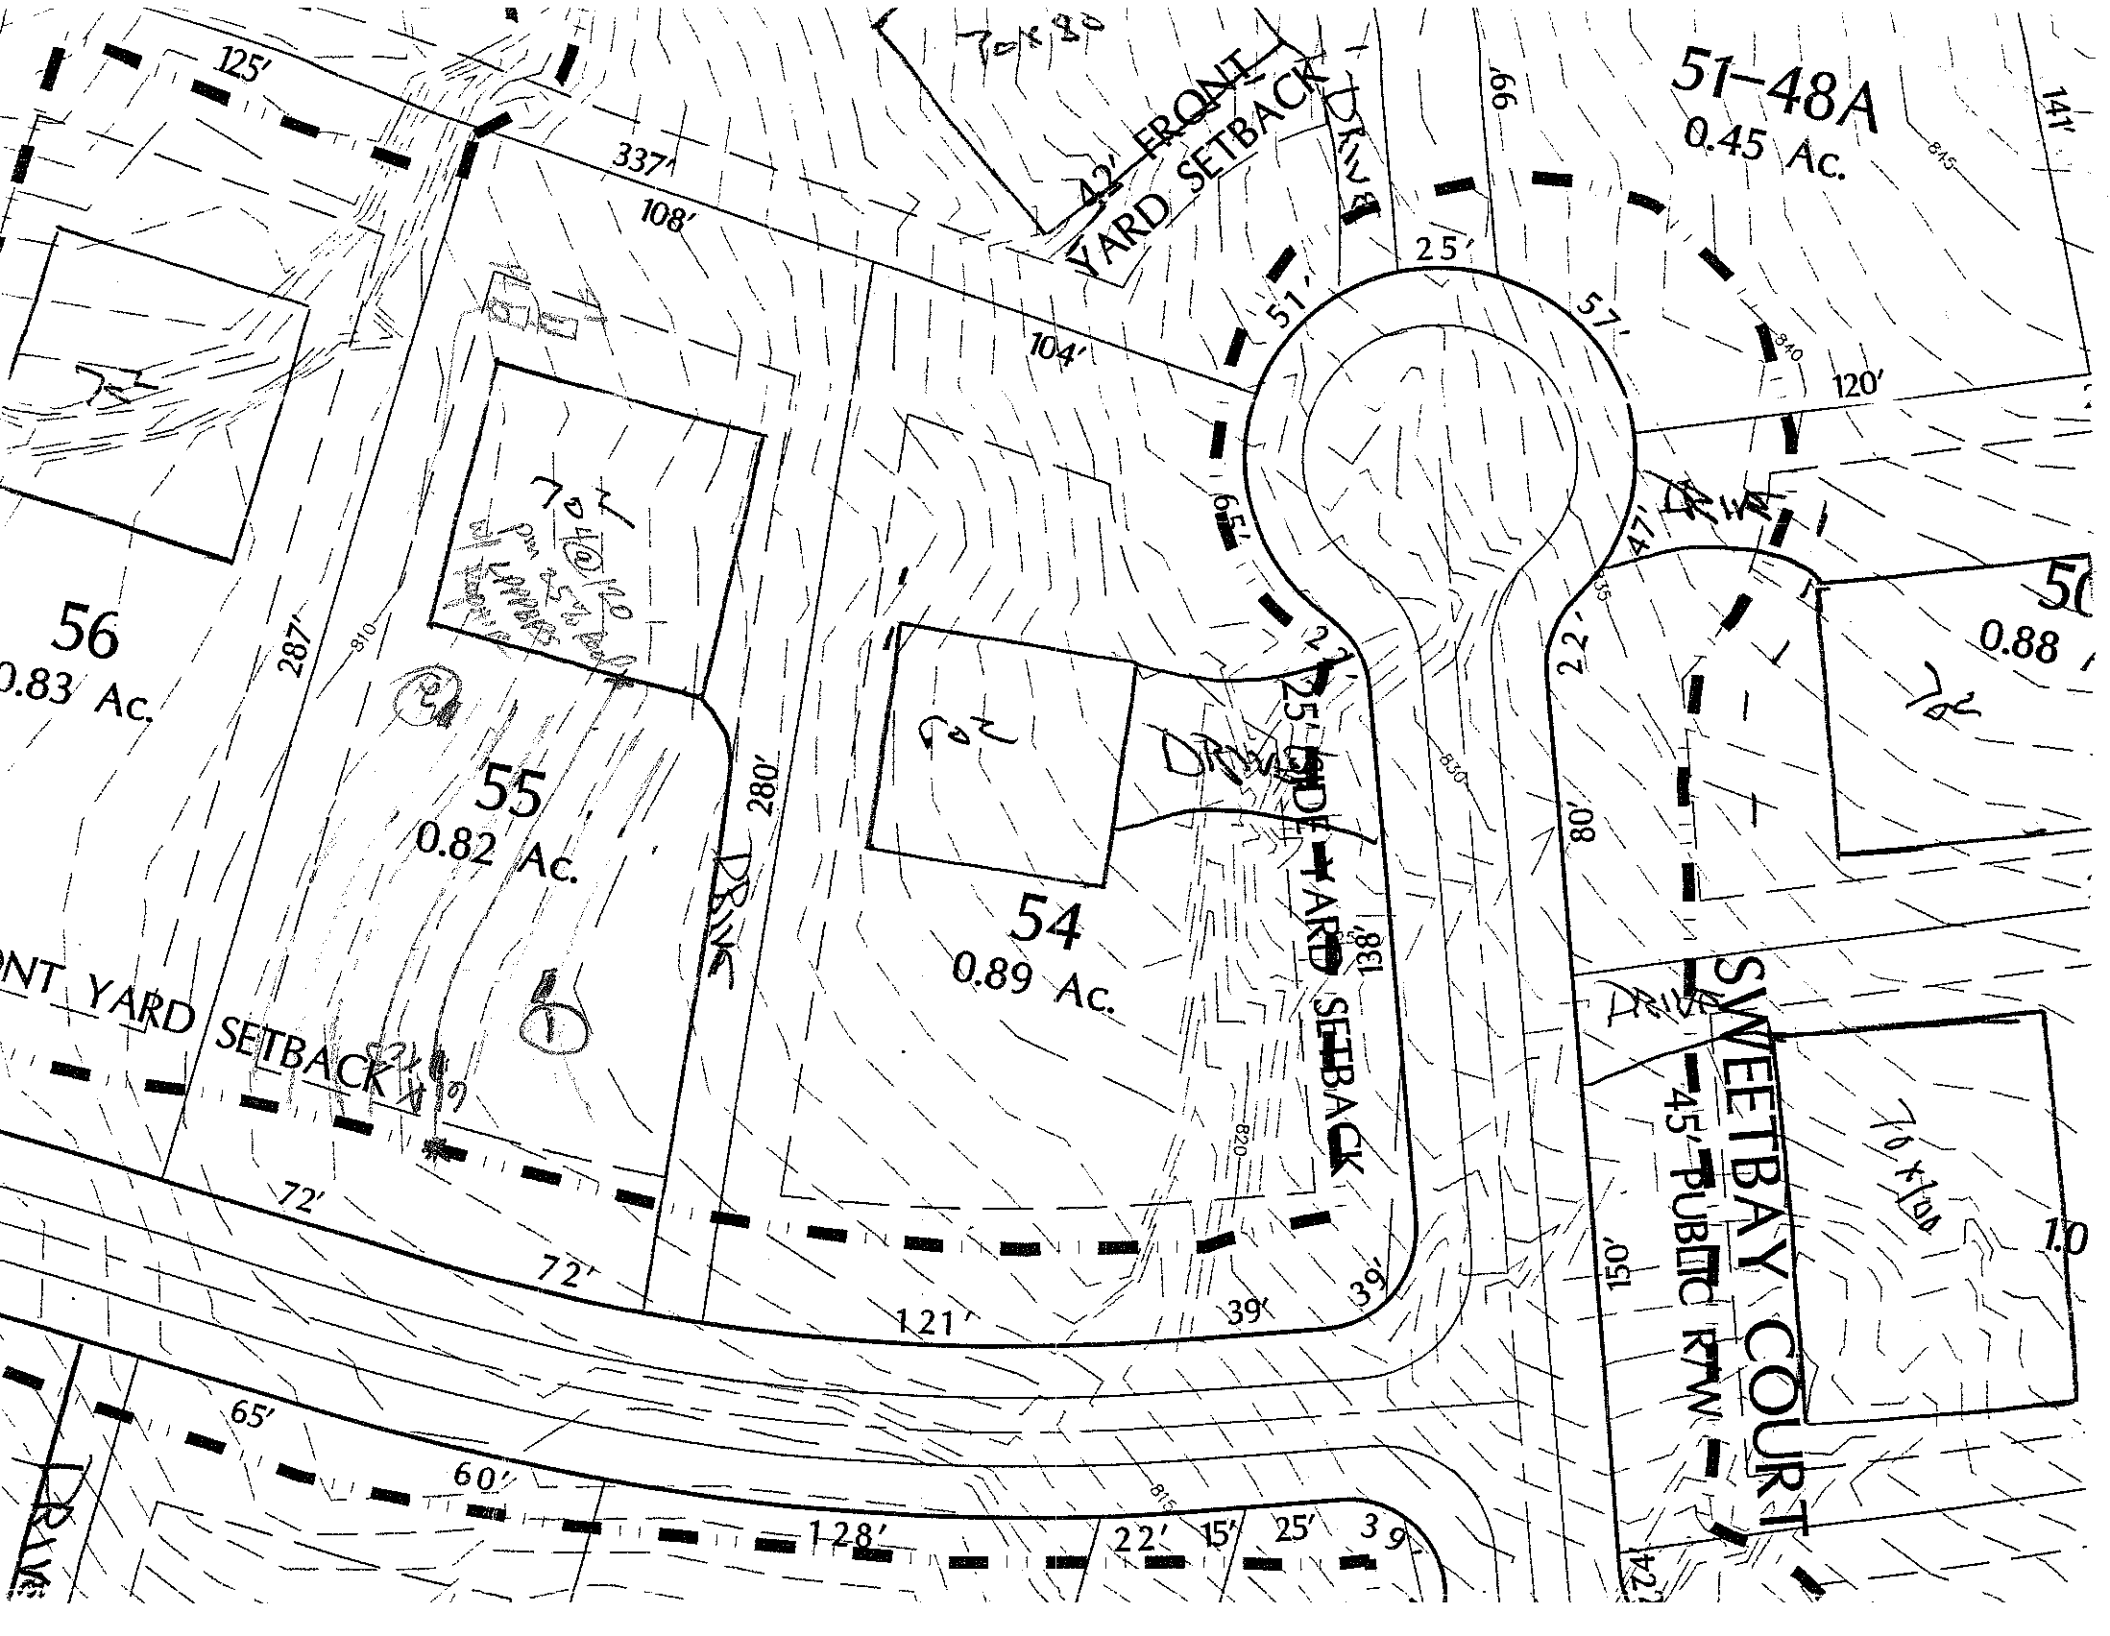
OWNER: CRI APPLICATION DATE: _____
ADDRESS: _____ DATE EVALUATED: 4-17-23
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 480gpd PROPERTY SIZE: _____
LOCATION OF SITE: Lot 55 LAKEFOREST PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☒ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	5-6%	0-7	wk sbk						.25-.3
		7-27	m-f sbk RC	fi-fr ss sp so					
		27-52 (B-C)	m-wk-f sbk-sg	hzy cl fi-fr ss ps sp	few common	m-f sbp			
2		0-30	sbk c/cl	fr ss-ss sp so					.25+
		30-55 (B-C)	sg cl/l	fr ss sp	many	m-f sbp			
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	gravity/Pump	LPP/ERS
Site LTAR	.25	.25

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: DPH
OTHER(S) PRESENT: Paul Pennington

COMMENTS: _____


51-48A
0.45 Ac.
56
0.83 Ac.
55
0.82 Ac.
54
0.89 Ac.
SWEETBAY COURT
45' PUBLIC R/W
42' FRONT YARD SETBACK
FRONT YARD SETBACK
SIDE YARD SETBACK
DRIVE
70 x 120
125'
337'
108'
104'
287'
280'
72'
121'
39'
65'
60'
128'
22'
15'
25'
120'
150'