DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

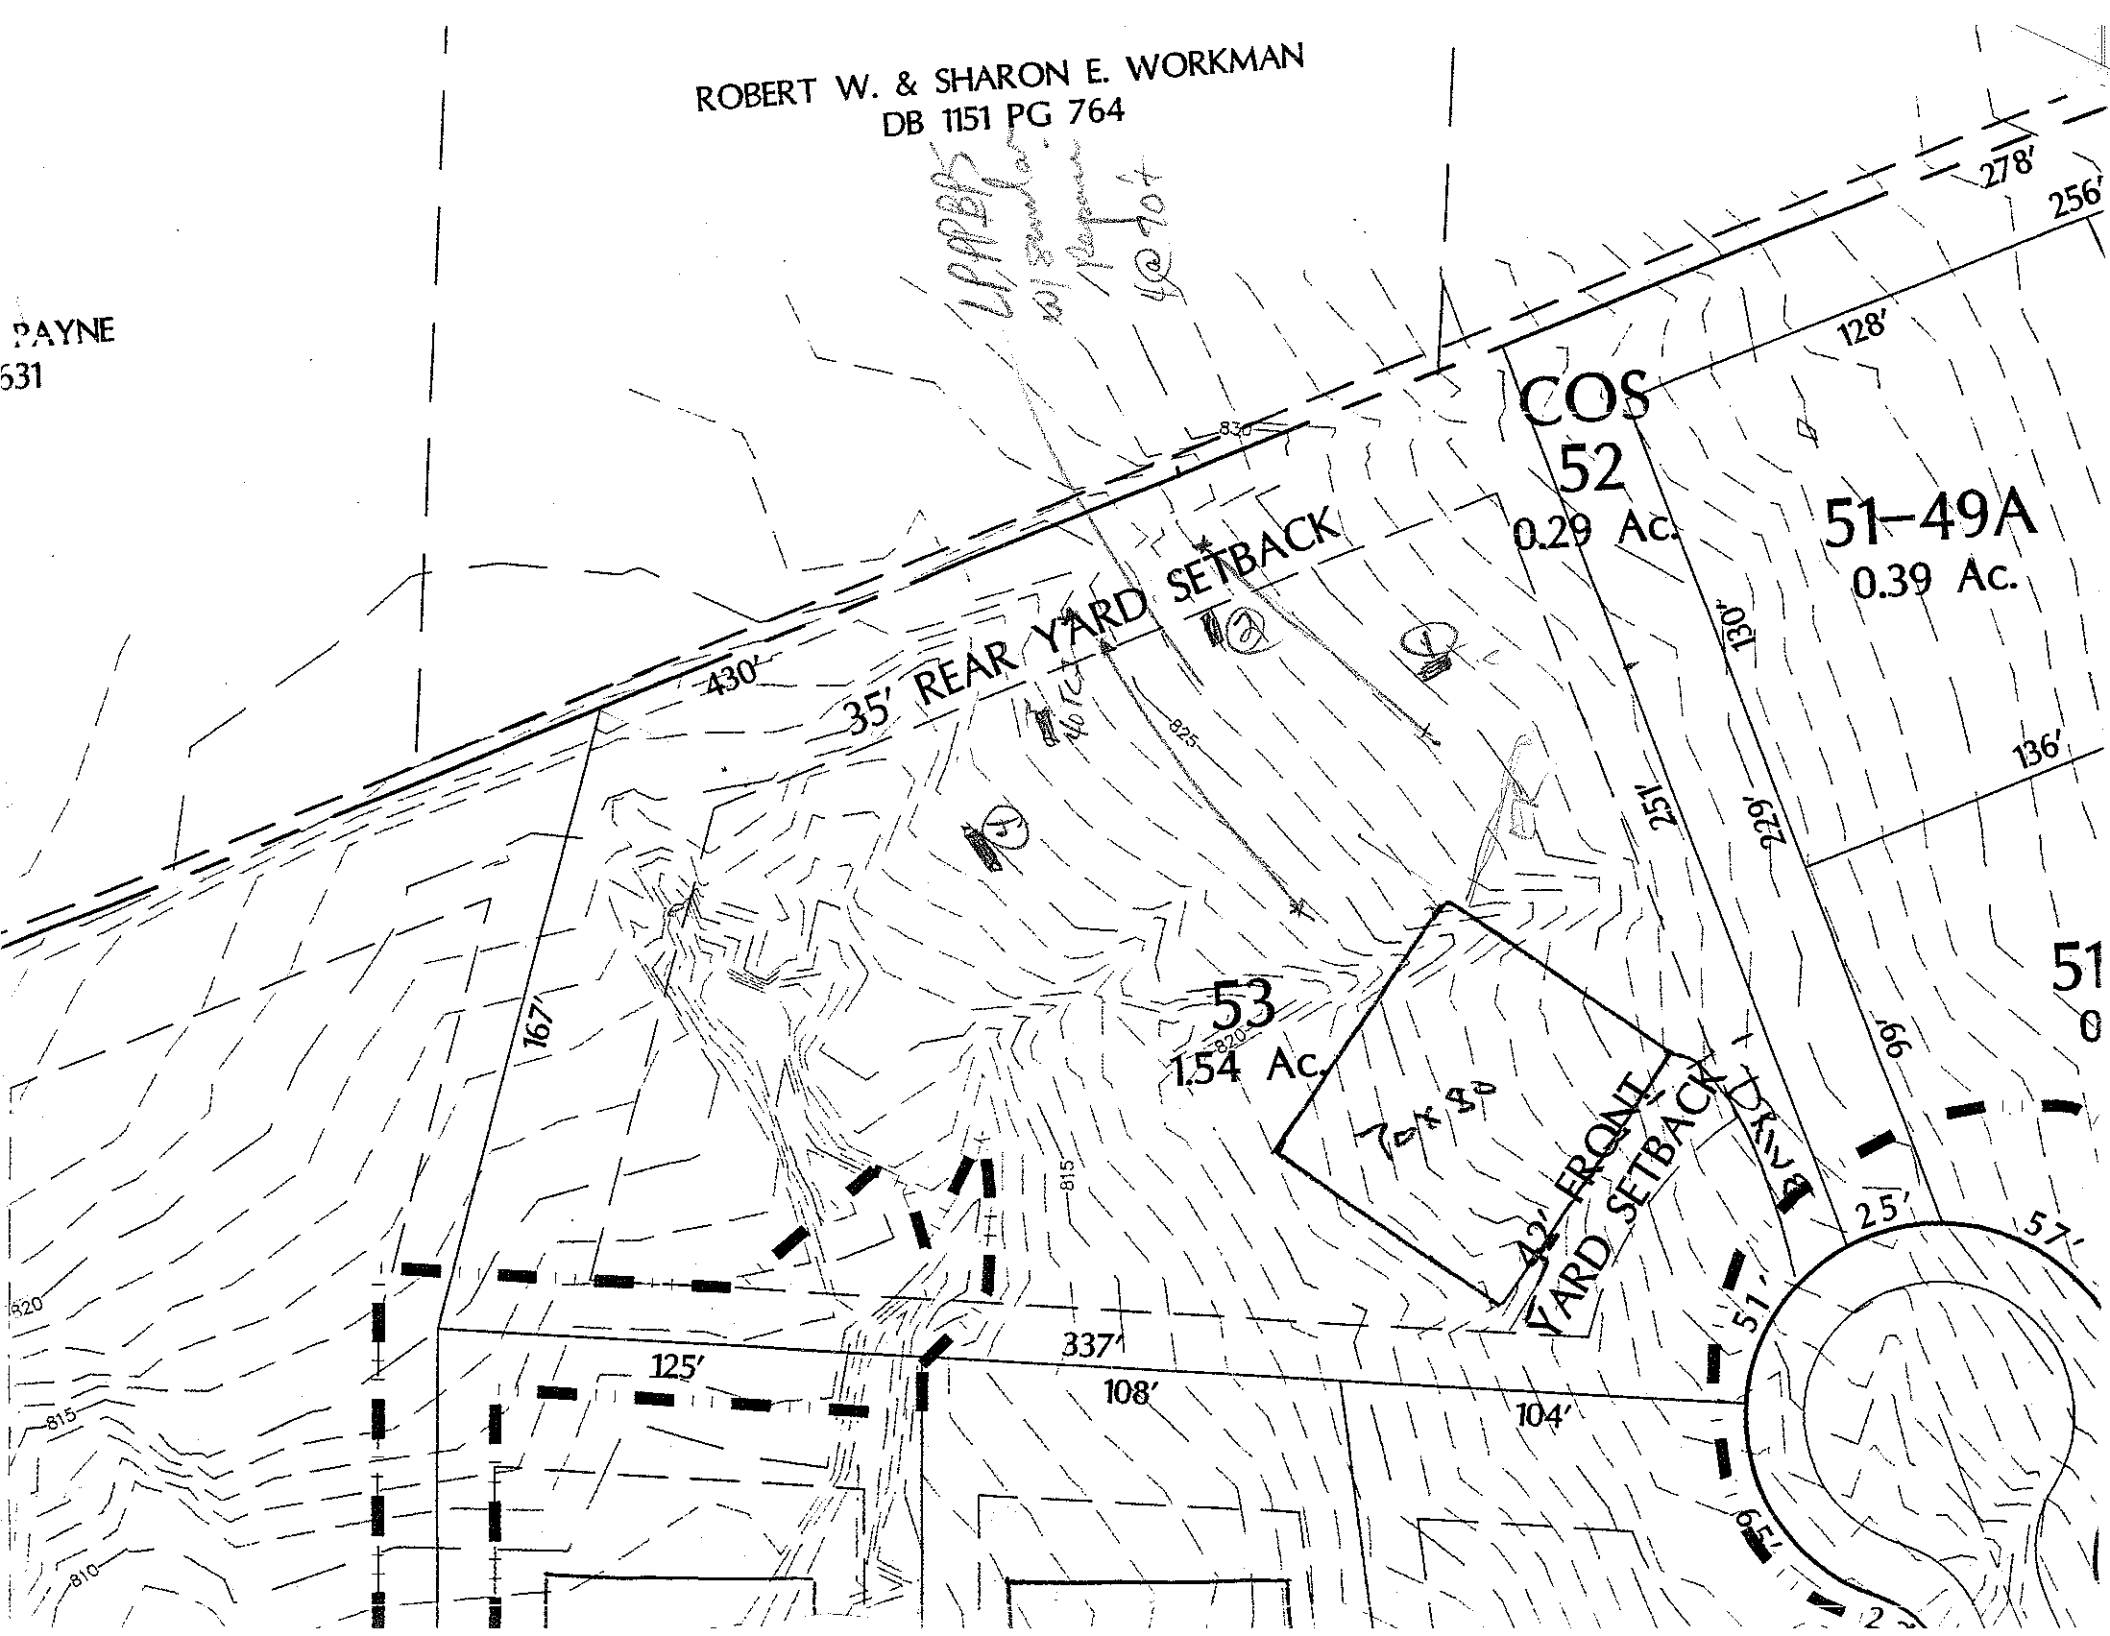
OWNER: CKST APPLICATION DATE _____
ADDRESS: _____ DATE EVALUATED: 4-17-83
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: lot 53 Lake Forest PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-21	mfsbk RC	fr sss sp sap					.3
		21-37	mfsbk yscl	fr sss sp	few common ind sap				
		37-48	mane rg sl/l sap	fr sss sp	few ind sap				
2		0-6	gr-wk sbk/wk sbk	fr sss sp					.3
		6-21	mfsbk RC	fr sss sp sap					
		21-34	wk fsbk yscl	fr sss sp	few ind sap				
		34-60+	wk fsbk mabr ycl	fr sss sp					
3	40 TCJ	0-4	gr pbrk sl fr						.3
		4-44	wk sbk rc/l	fr ss sp	few ind sap				
4		0-24	gr wk sbk/wk sbk scl	fr sss sp					.25
		24-48	mfsbk RC	fr fr sp sap	few gravel mottles				

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____

COMMENTS: _____


ROBERT W. & SHARON E. WORKMAN
DB 1151 PG 764
PAYNE
631
COS
52
0.29 Ac.
51–49A
0.39 Ac.
35' REAR YARD SETBACK
53
1.54 Ac.
70' x 80'
42' FRONT YARD SETBACK
DRIVE
278'
256'
128'
430'
167'
130'
136'
229'
251'
66'
337'
125'
108'
104'
51'
25'
830
825
820
815
810