DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

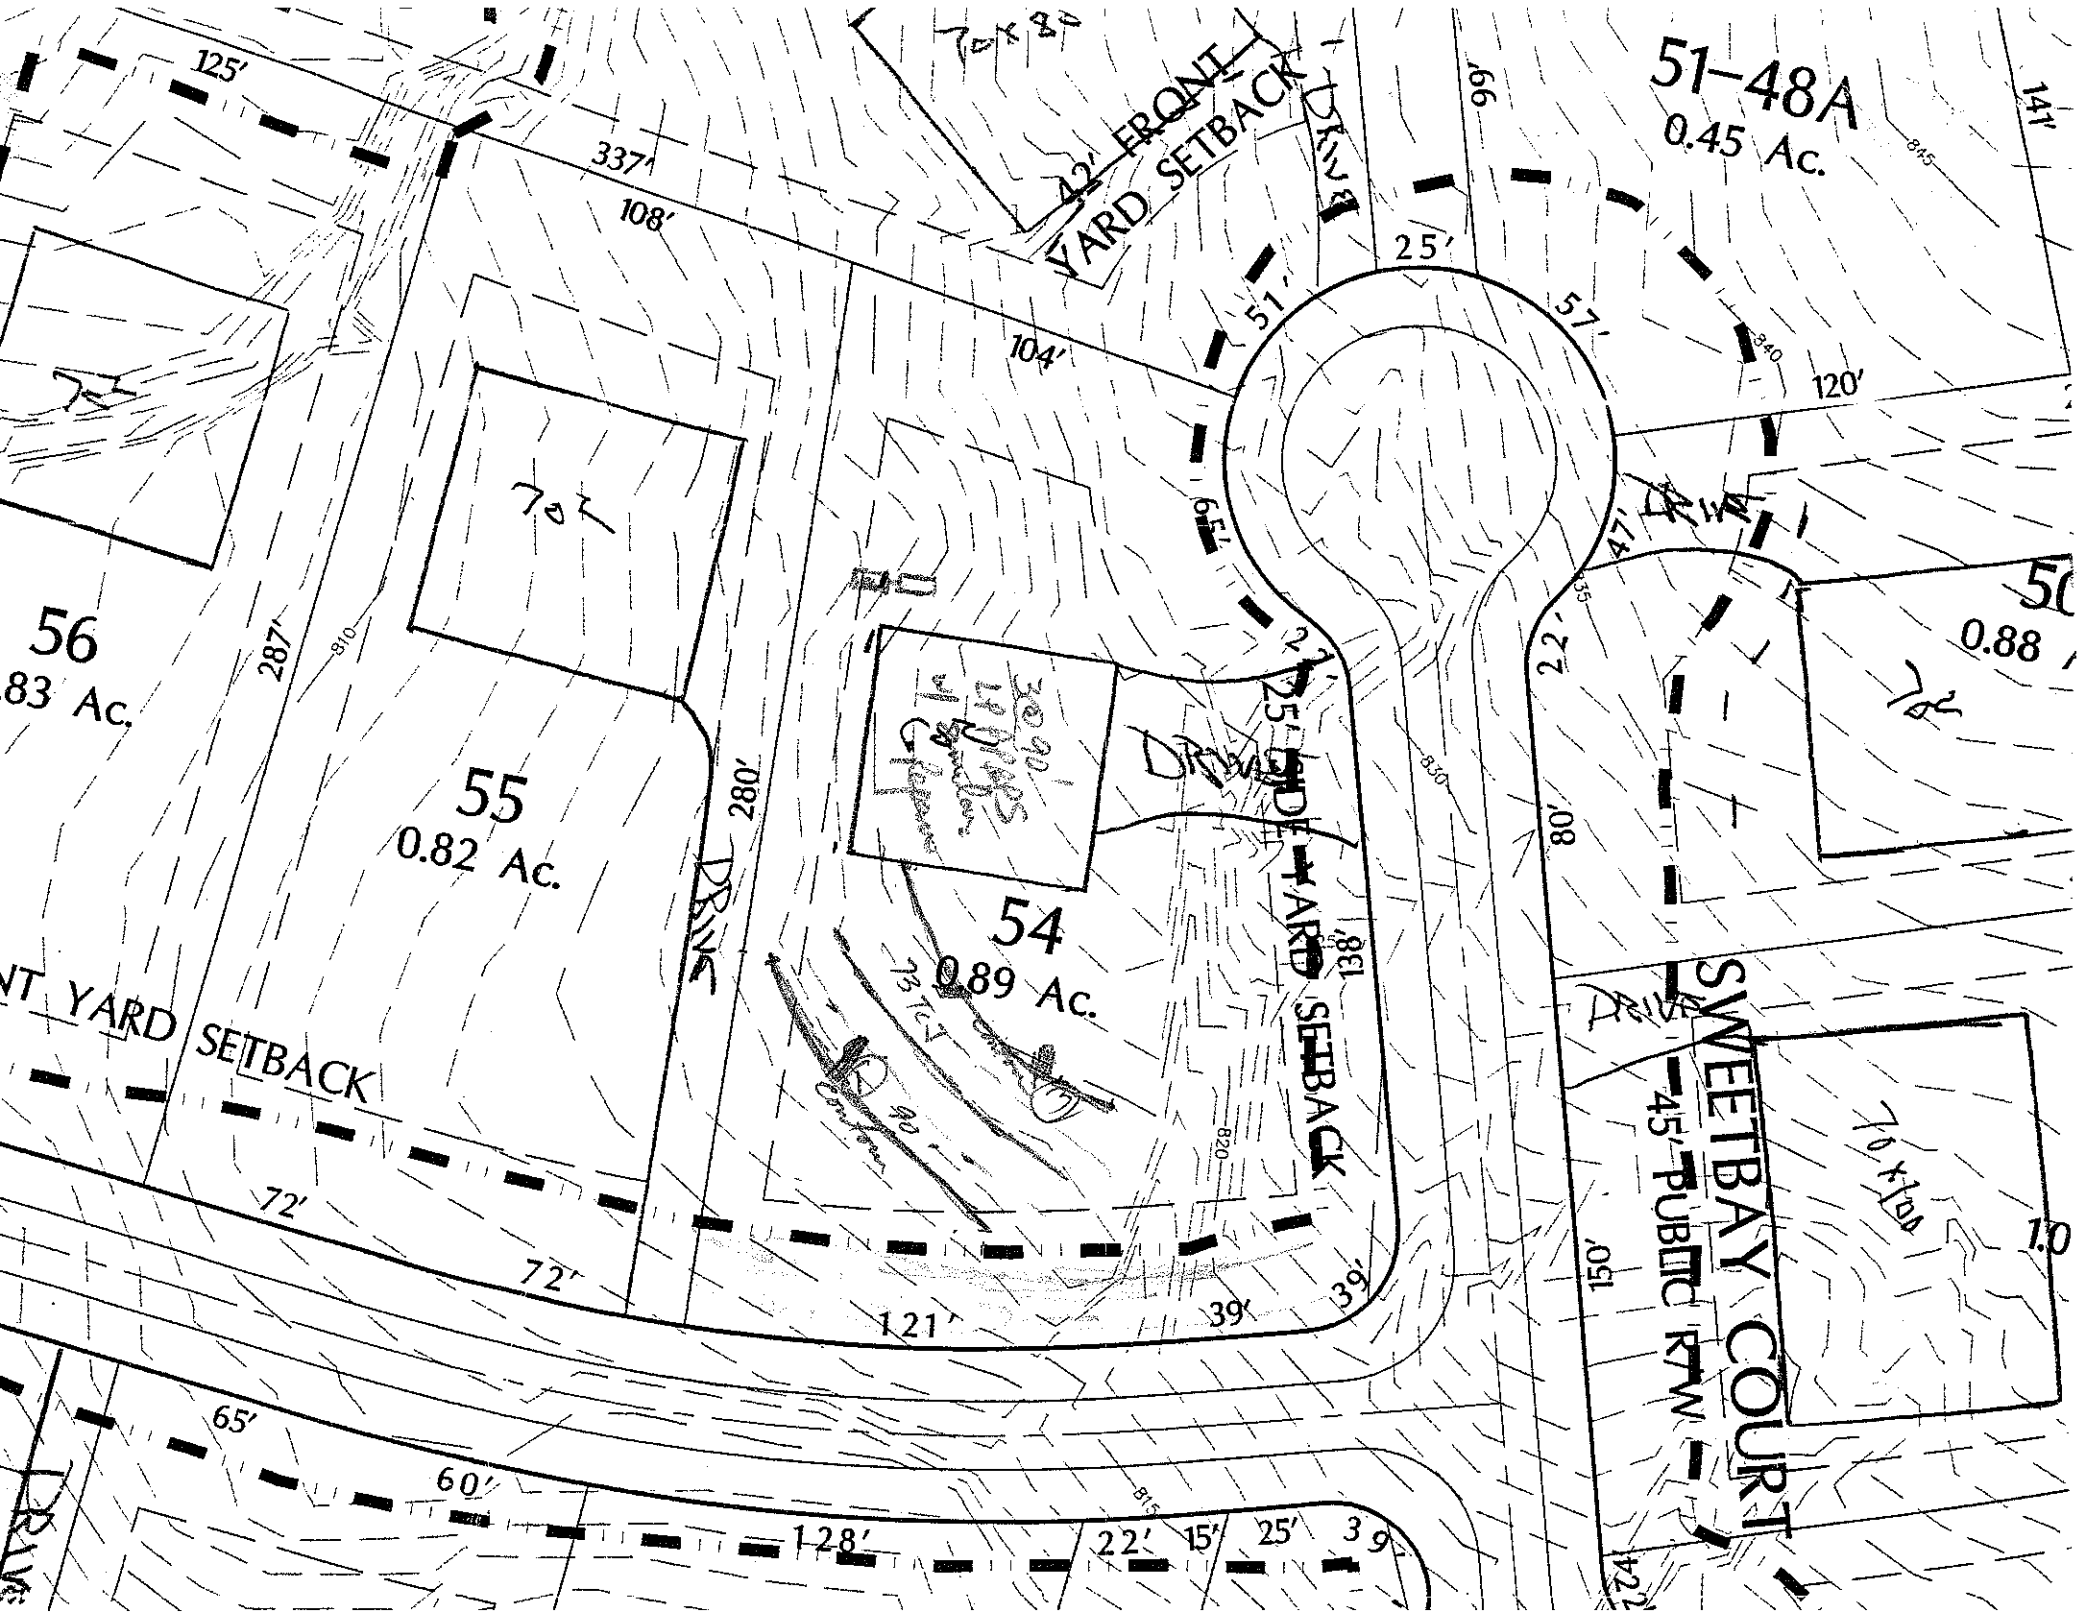
OWNER: Lot 54 APPLICATION DATE ___
ADDRESS: ___ DATE EVALUATED: 4-17-03
PROPOSED FACILITY: Lot 54 PROPOSED DESIGN FLOW (.1949): 480 gpd PROPERTY SIZE: .89 ac
LOCATION OF SITE: Lake Forest PROPERTY RECORDED: ___
WATER SUPPLY: ☐ Private ☒ Public ☒ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	~6%	0-8	gr.wk sbk sl/scl	fr ss sp					.3
		8-26	mt sbk rc	fr ss sp sPO					
		26-58	wk-mt sbk ypcl	fr ss sp fw-mpl sPp					
2	TS TCS	0-13	wk sbk ypcl	fr ss sp SPp					.3
3		0-9	wk f sbk rbr sclr	fr ss sp					.3
		9-49	m f sbk/gran Rc/cl	fr sp-ss sp					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS per 1956	PS per 1956
System Type(s)	LPP BPS	LPP BPS
Site LTAR	.3	.3

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: DH
OTHER(S) PRESENT: Paul Lannigan

COMMENTS: ___


51-48A
0.45 Ac.
56
.83 Ac.
55
0.82 Ac.
54
0.89 Ac.
50
0.88
42' FRONT YARD SETBACK
25' SIDE YARD SETBACK
NT YARD SETBACK
SWEETBAY COURT
45' PUBLIC R/W
DRIVE
125'
337'
108'
104'
287'
280'
72'
121'
65'
60'
128'
120'
80'
150'
70x80
70x100