1.15

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR John CASANOVA DATE 4-12-85 PERMIT NO. 114

PHONE: Business ________ Home ________

LOCATION 1100 TR 1178 / TL 1234 TR 1235 (Kings X Road) TR 1st drive on left S. R. No. ____

SUBDIVISION NAME LAKE NORMAN LOT NO. 1568 SECTION OR BLOCK NO. ____

House (X) Mobile Home ( ) Business ( ) Other ________

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (X)

Auto. Dishwasher Yes (X) No ( )

Auto. Wash. Machine Yes (X) No ( )

Site Suitable Yes (X) No ( )

Lot Area 1.47 ACRES

Character & Porosity of Soil Clay loam


Percolation Rate 0.5 gal/ft²/day

Topography 2-10%

Depth to Water Table 4'

Rock or other impervious formations NONE obs.

X Basement with Plumbing ____ Basement without Plumbing ____ No Basement

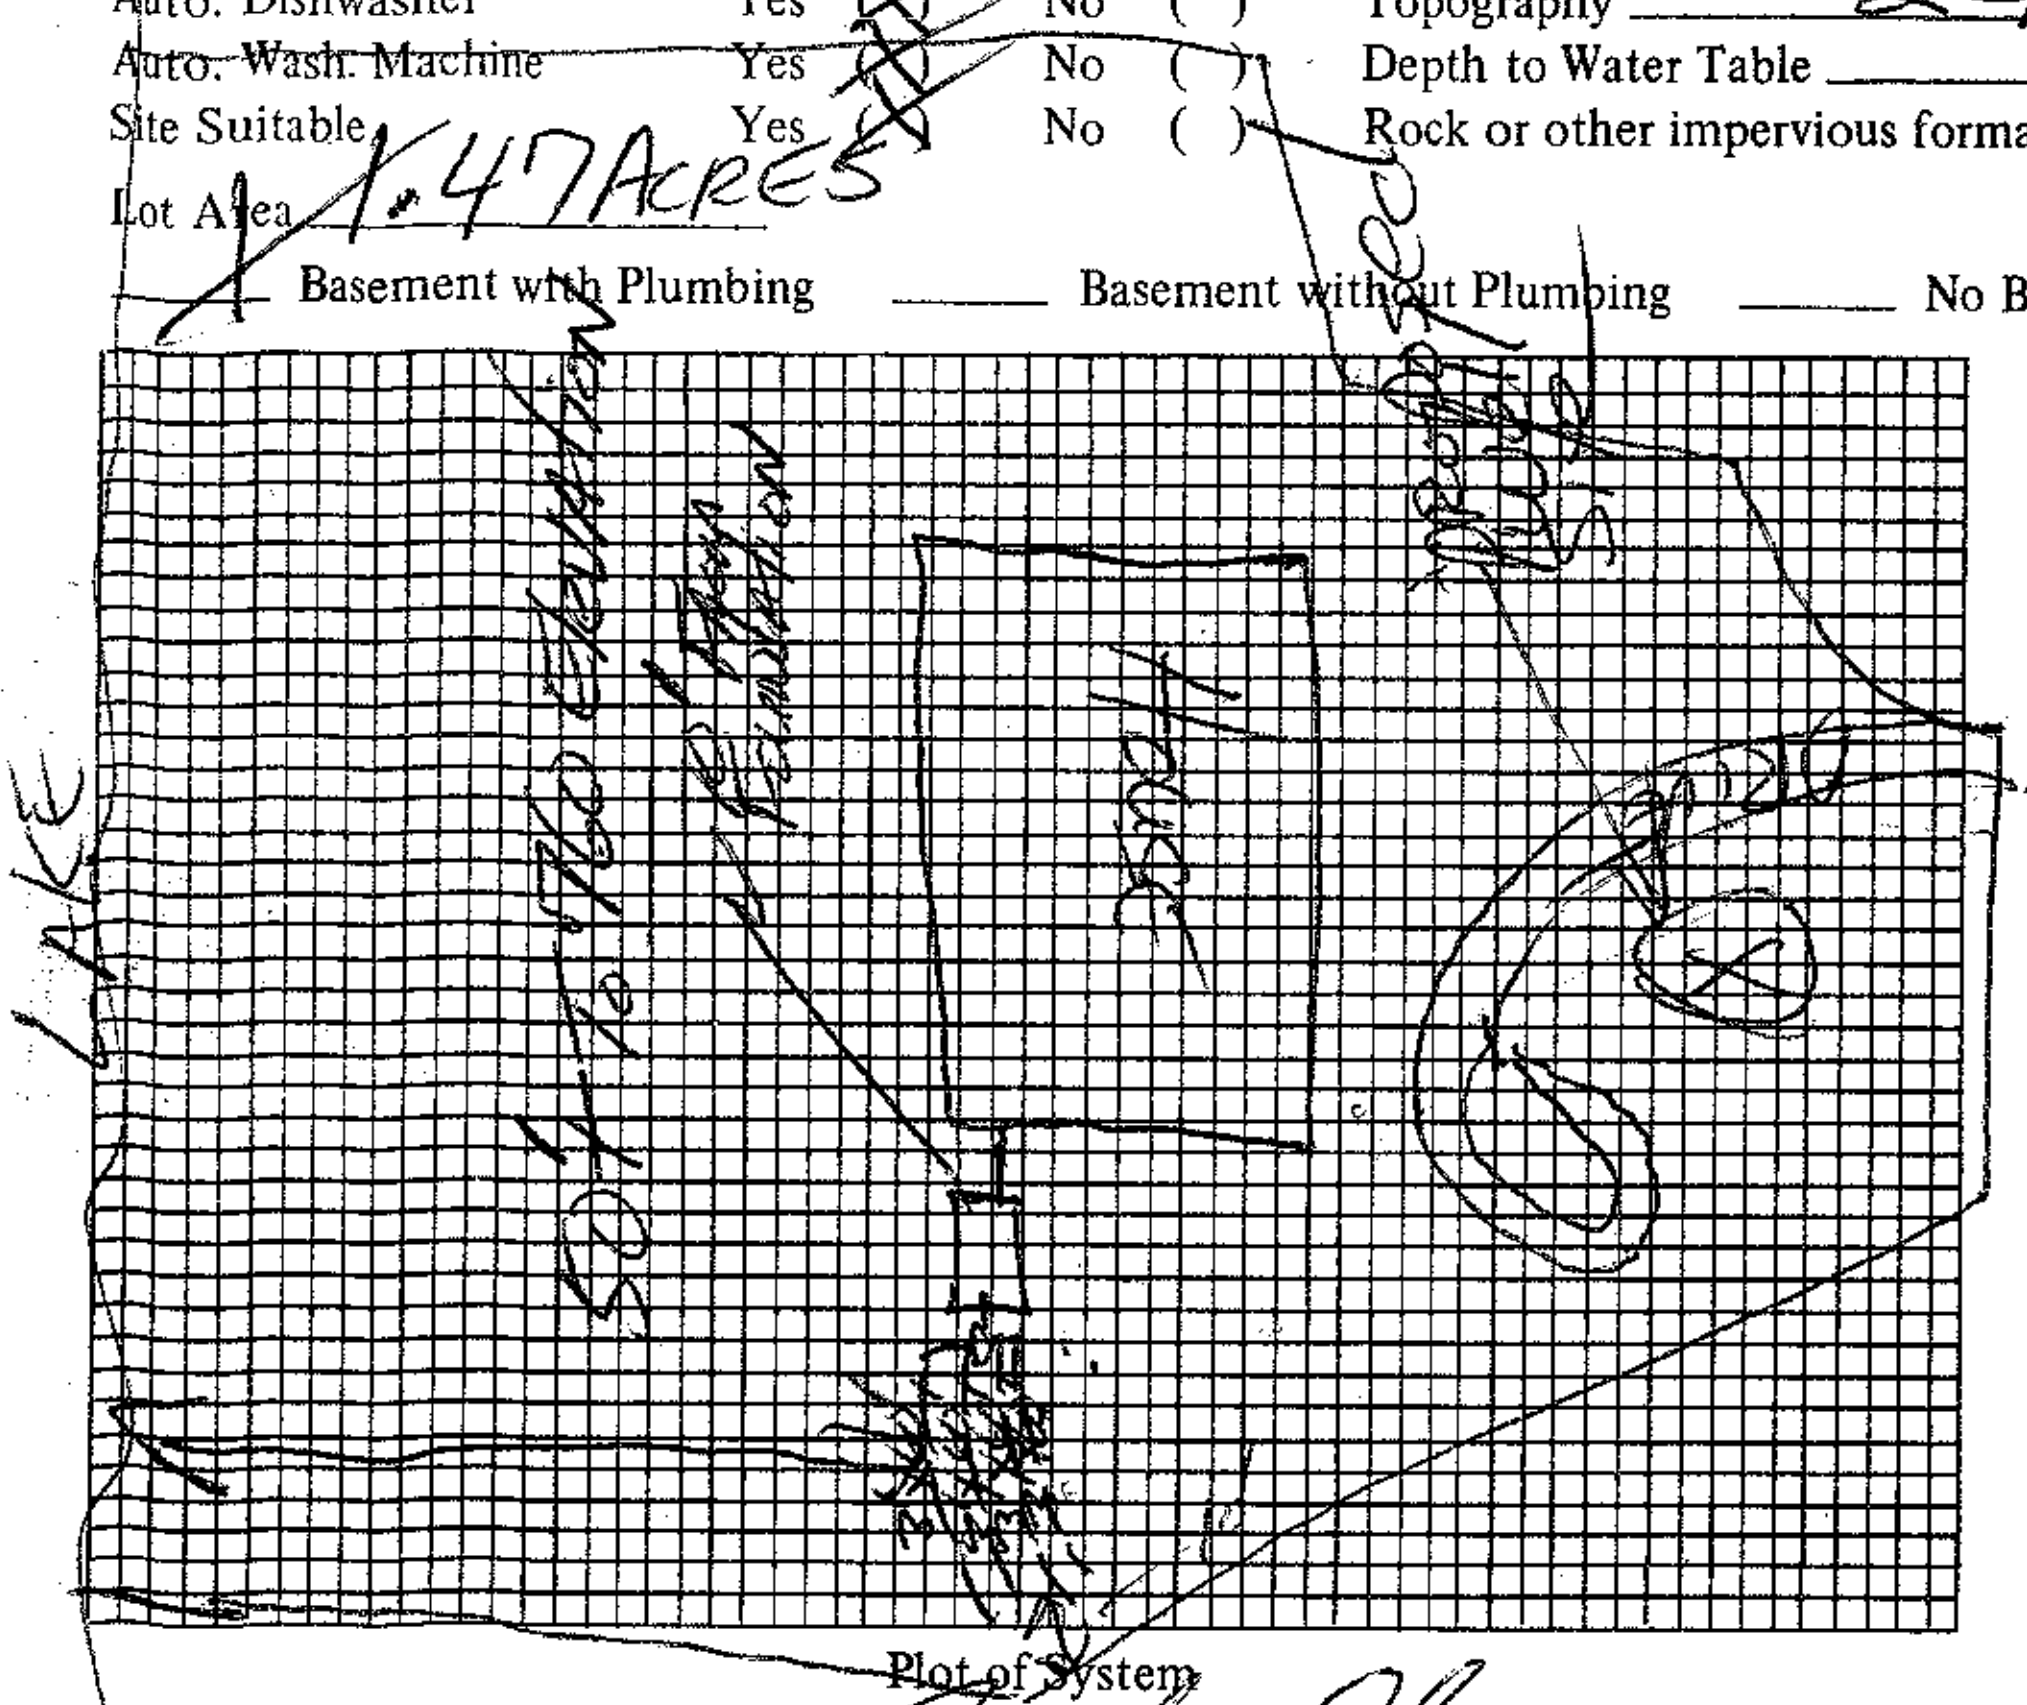

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 4
Sq. Ft. 720 Linear Ft. 240
Depth of Stone in Lines 12"

Water Supply: Individual (X)
Public ( )

Installed by ________

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: X Charles Casanova

IMPROVEMENTS PERMIT BY Fred Clemmer

COMMENTS: Keep system shallow — must stub plumbing out shallow — system to be no deeper than 2.5' cover MAXIMUM

CERTIFICATE OF COMPLETION BY ________ DATE ________

EXISTING SYSTEM CHECKED BY: ________ DATE ________

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold