DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

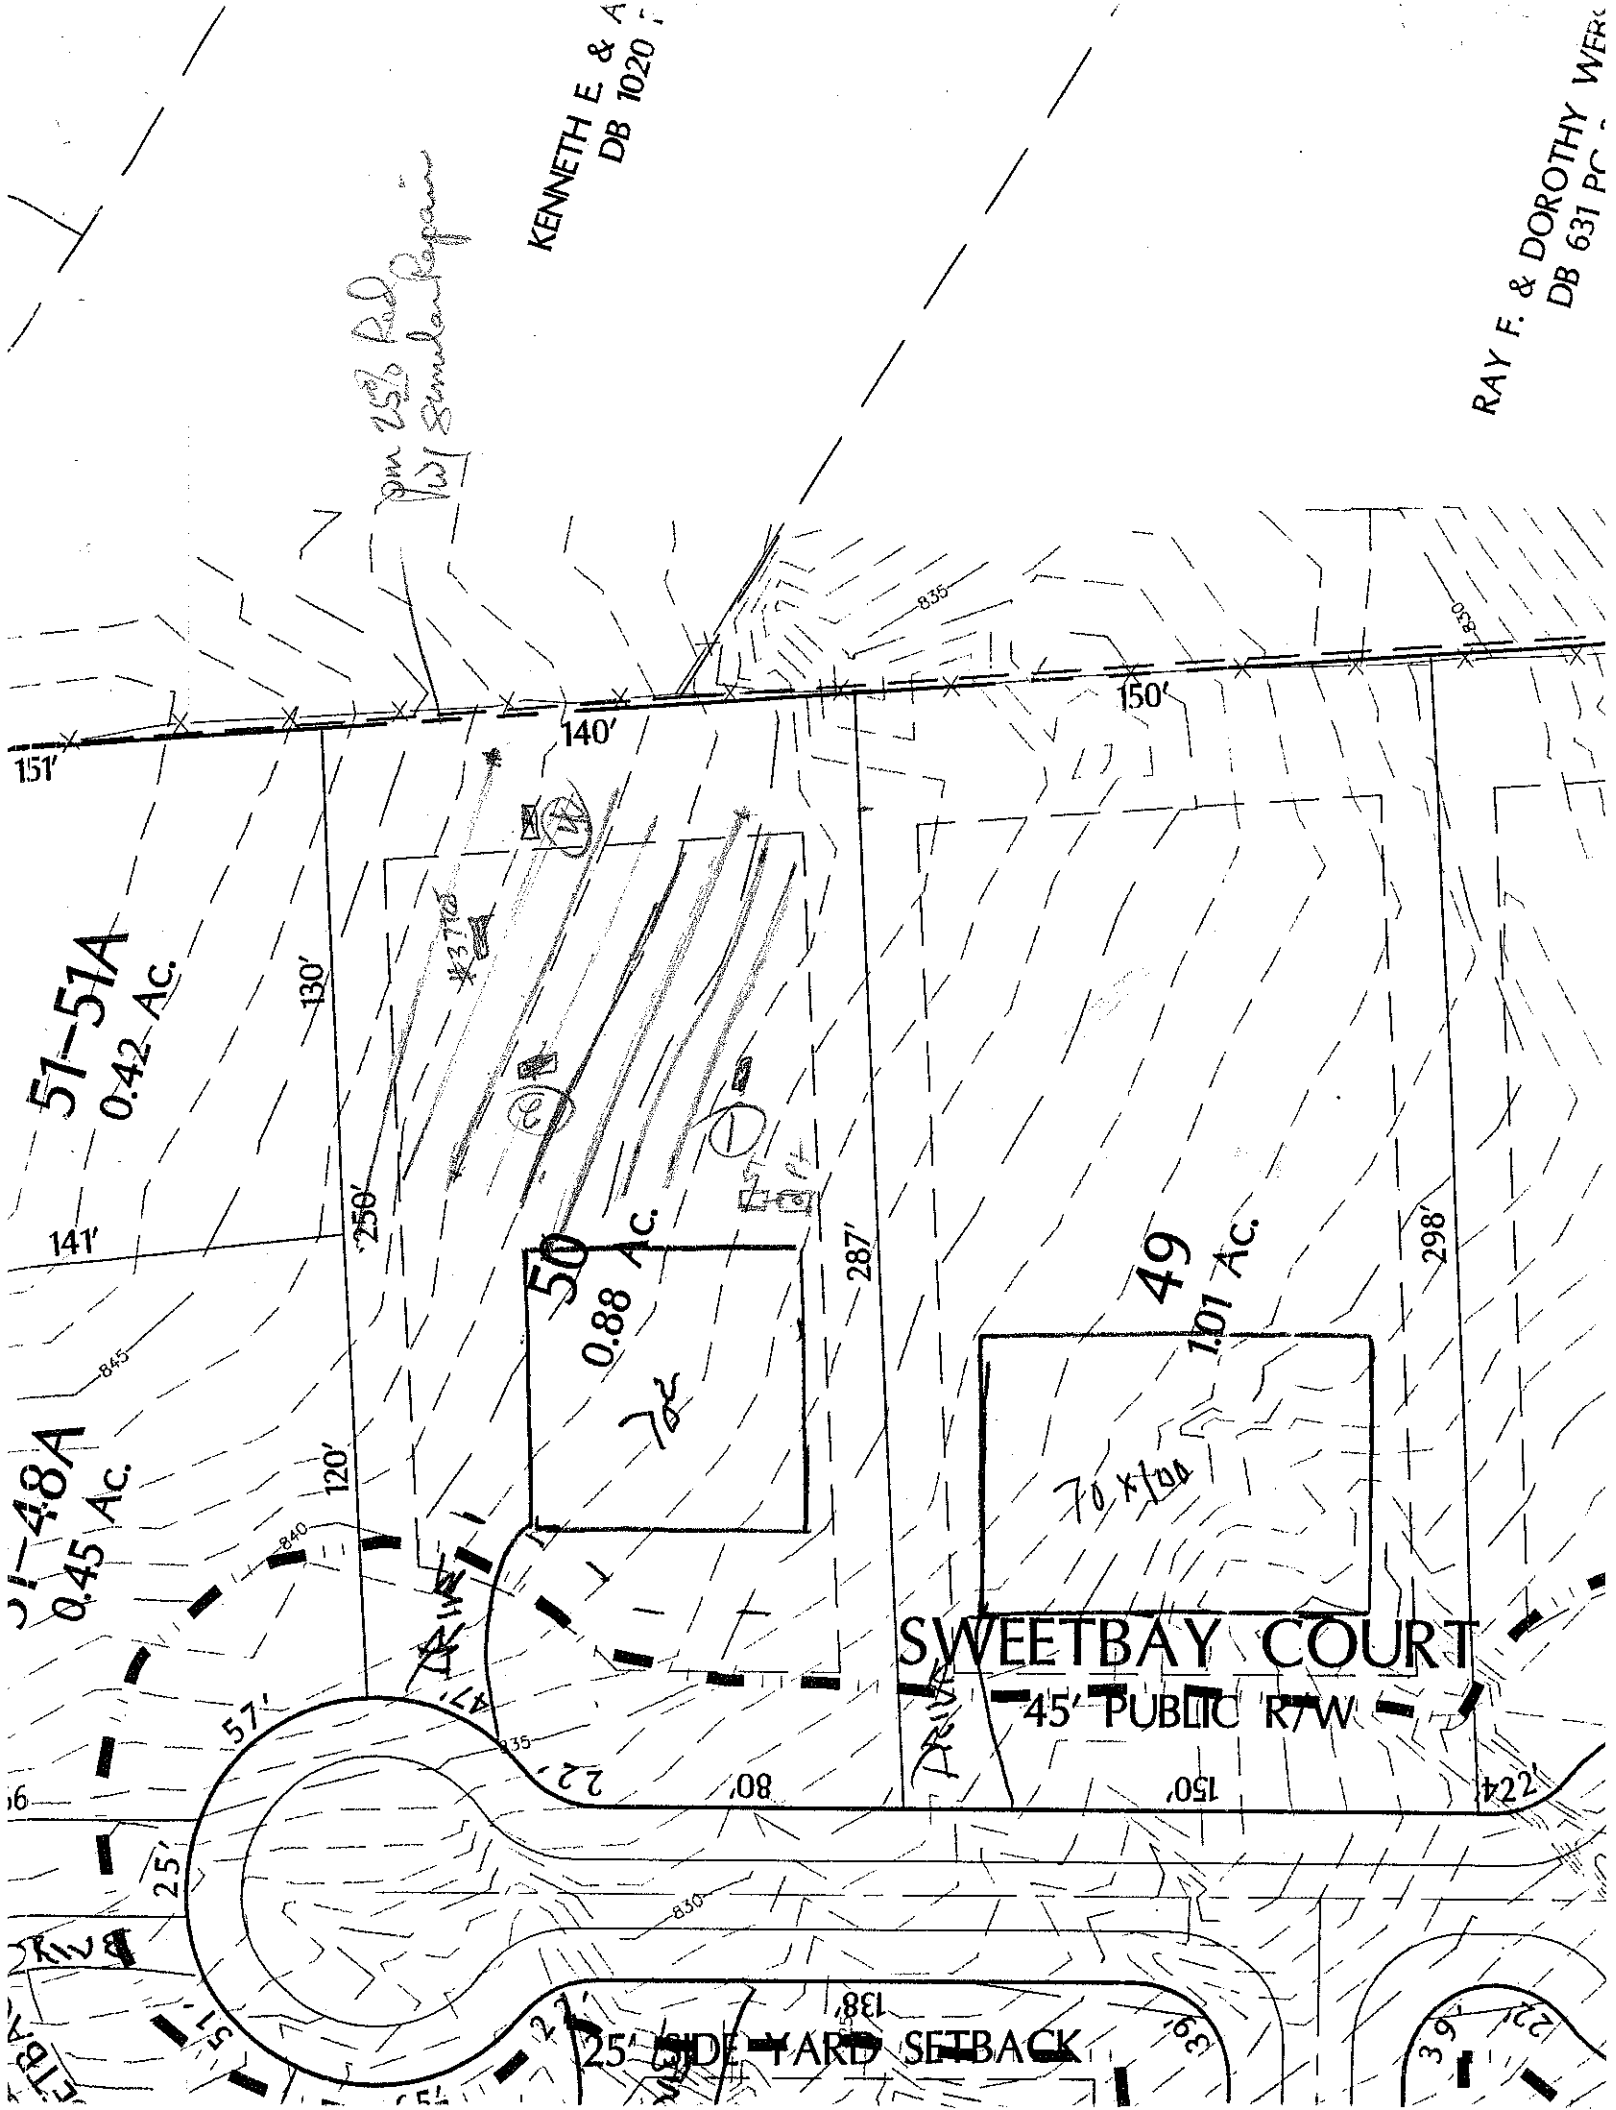
OWNER: CRI APPLICATION DATE ___
ADDRESS: ___ DATE EVALUATED: 4-17-03
PROPOSED FACILITY: ___ PROPOSED DESIGN FLOW (.1949): 4Bdrm PROPERTY SIZE: ___
LOCATION OF SITE: lot 50 Lake Forest PROPERTY RECORDED: ___
WATER SUPPLY: ☐ Private ☒ Public ☒ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-23	mfsbk RC	fr sssp					.3
		23-50	wk fsbk yr cl	fr sssp					
2	5-6%	0-10	gr brn sl	fr sssp					.3
		10-44	mfsbk RC	fr sp sspo					
		44-53	(BC) wk sbk yr cl	fr sssp					
3	#37 RCS	0-5	gr brn sl	fr sssp					.3
		5-27	sbk/msbk RC	fr sp sspo	Common mottling				
		27-44	(B-C) wk sbk yr cl	fr sssp					
4		0-30	m fsbk RC	fr sp sspo					.3
		30-47	m fsbk R w/ C/ yr cl	fr sssp	Seas mod sspo Few gravelly rocks				

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	pm 25% Red	pm 25% Red
Site LTAR	.3	.3

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: MH
OTHER(S) PRESENT: Paul Pennington

COMMENTS: ___


KENNETH E & A
DB 1020
RAY F. & DOROTHY WER
DB 631 PG
Pin 25% Rd
Wtl Simulation
835
838
150'
140'
151'
51-51A
0.42 Ac.
130'
#3 Tile
141'
250'
50
0.88 Ac.
287'
49
1.01 Ac.
298'
845
120'
840
0.45 Ac.
SWEETBAY COURT
45' PUBLIC R/W
57'
47'
835
22'
80'
150'
22'
25'
850
138'
25' SIDE YARD SETBACK