IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Dr. Bailey DATE 3-11-74 PERMIT NO. 38

PHONE: Business ______ Home ______

LOCATION 1100 TR on 1115 5th Rd to right 1455 Follow to 2nd spur Rd to right House on S. R. No. 1115

SUBDIVISION NAME Lake Norman LOT NO. 308 SECTION OR BLOCK NO. 2

House (✓) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 2 No. Bathrooms 1

	Yes	No
Garbage Disposal Unit	( )	(✓)
Auto. Dishwasher	( )	(✓)
Auto. Wash. Machine	(✓)	( )
Site Suitable	(✓)	( )

Lot Area 1/2 acre


Character & Porosity of Soil Clay loam Porosity Fair to good

Percolation Rate Not taken

Topography 2% Slope

Depth to Water Table 10'+

Rock or other impervious formations 5 to 15' to bedrock

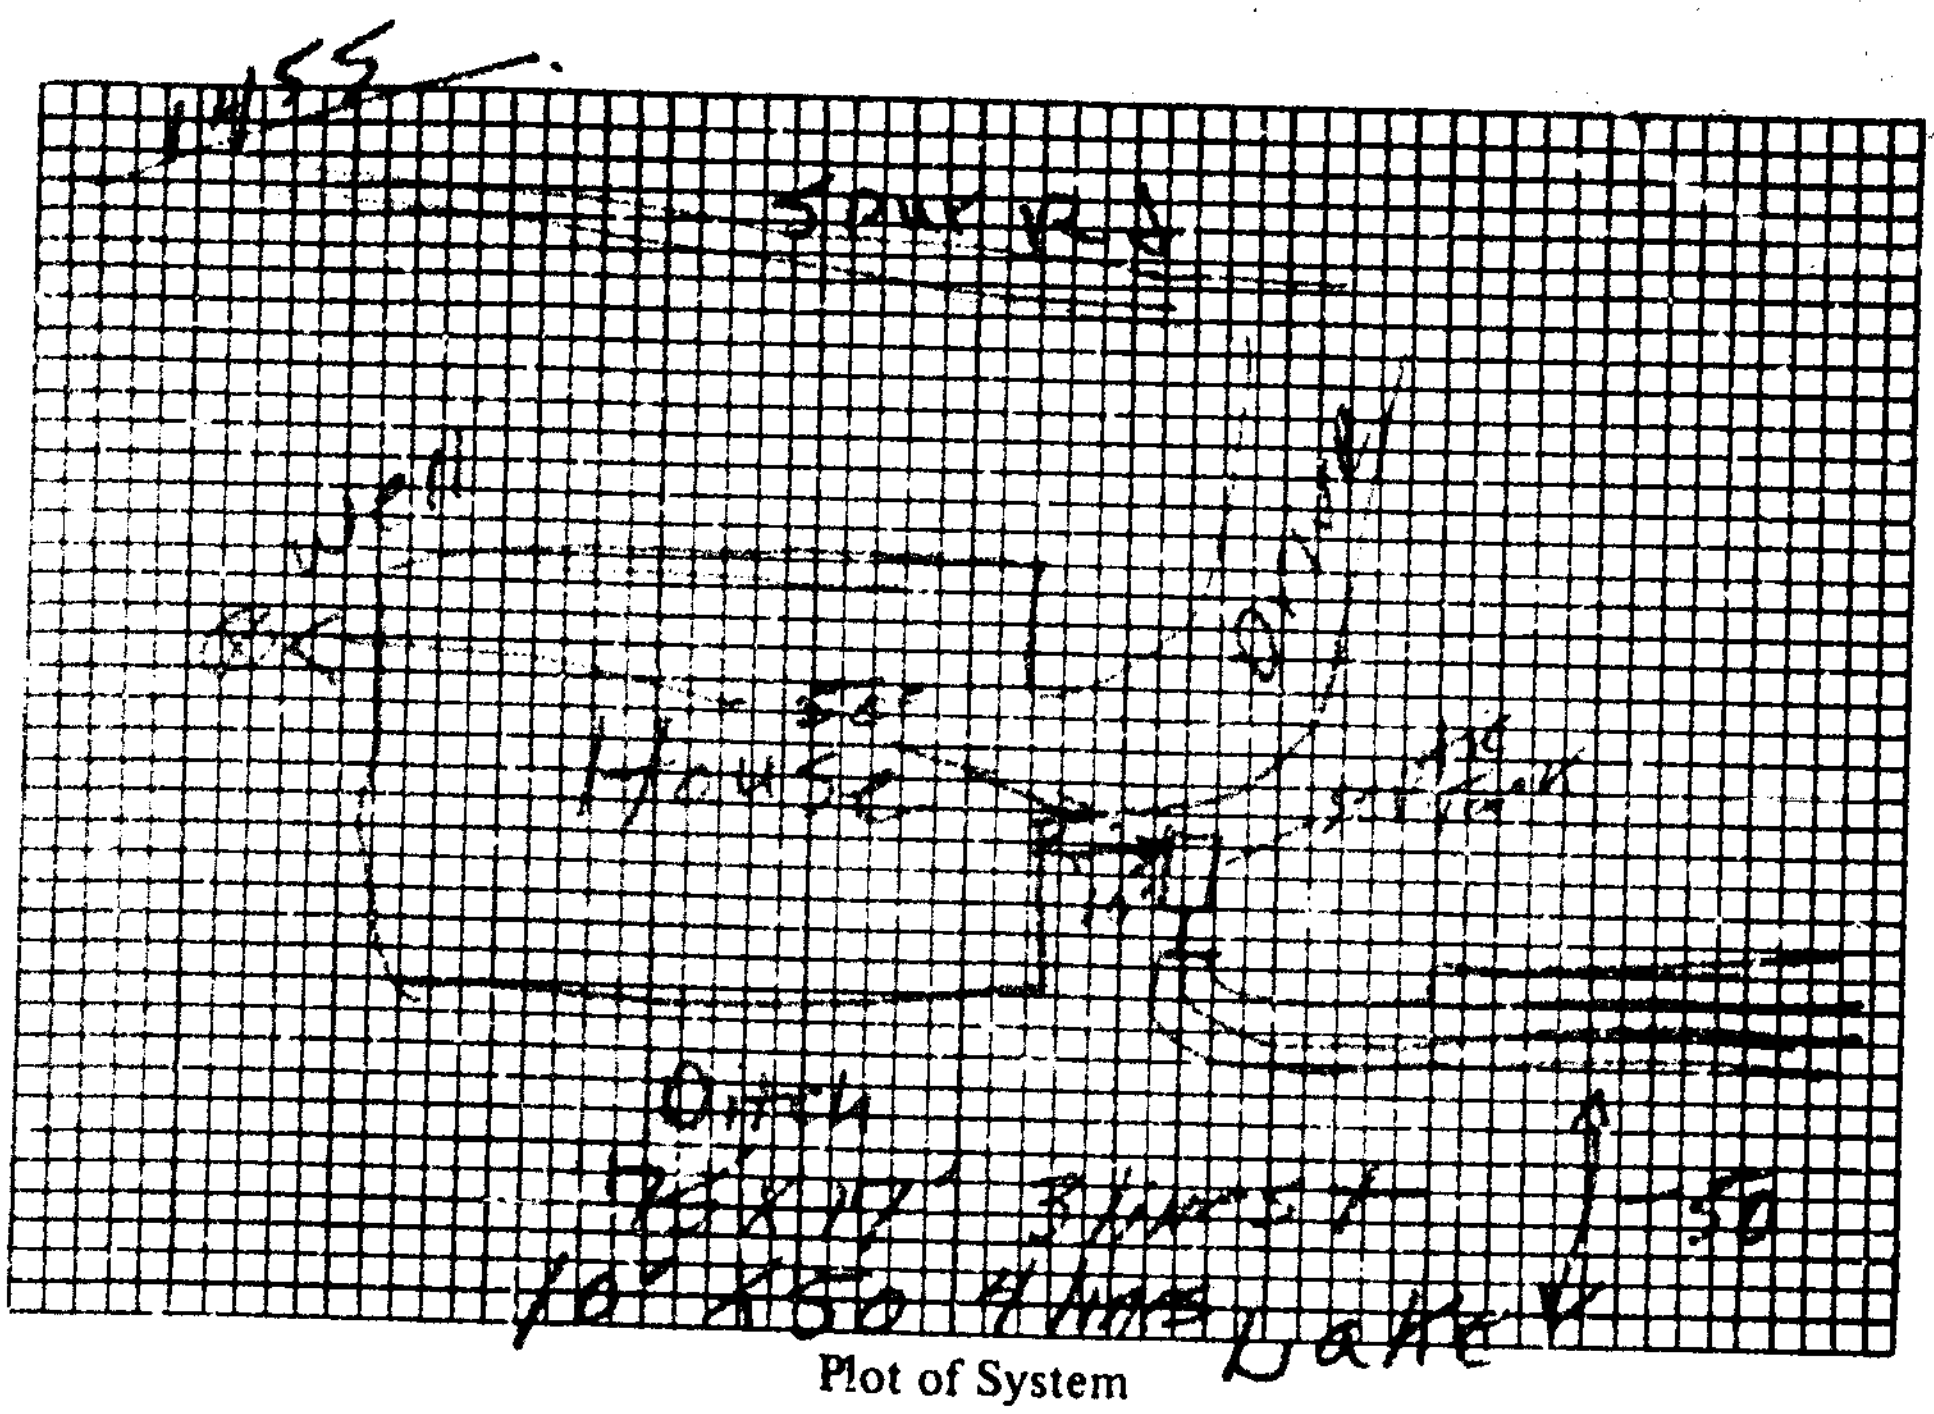

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 3+4 lines

Sq. Ft. 625 Linear Ft. 250

Depth of Stone in Lines 10"

Water Supply: Individual (✓)

Public ( )

Installed by F. J. Erwin

IMPROVEMENTS PERMIT BY ______

COMMENTS: ______

CERTIFICATE OF COMPLETION BY J. C. Moore DATE 3-11-74

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold