IREDELL COUNTY HEALTH DEPARTMENT

12476

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

*OWNER OR CONTRACTOR *Susan Hoenman / Hoffman-Harrington DATE March 20, '91 PERMIT NO. 22 2A 442

PHONE: Business _____ Home _____

LOCATION 1100 TR 1115 (McKendree) TR 1215 (Grasshopper) Bear left at forks ~3/4 mile on left S. R. No. _____

SUBDIVISION NAME CL&T Lake Norman LOT NO. 442 SECTION OR BLOCK NO. 8

House (✓) Mobile Home ( ) Business ( ) Other Addition w/ Addn.


No. Bedrooms 3 No. Bathrooms 2½

Garbage Disposal Unit	Yes ( )	No (✓)	
Auto. Dishwasher	Yes (✓)	No ( )	
Auto. Wash. Machine	Yes (✓)	No ( )	
Site Suitable PS	Yes ( )	No ( )	

Character & Porosity of Soil sandy clay
Percolation Rate 4
Topography ~15%
Depth to Water Table 4'+
Rock or other impervious formations numerous rock evaluated by backhoe pits should only be scatbed in drainfield area

Lot Area EXISTING 1000

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

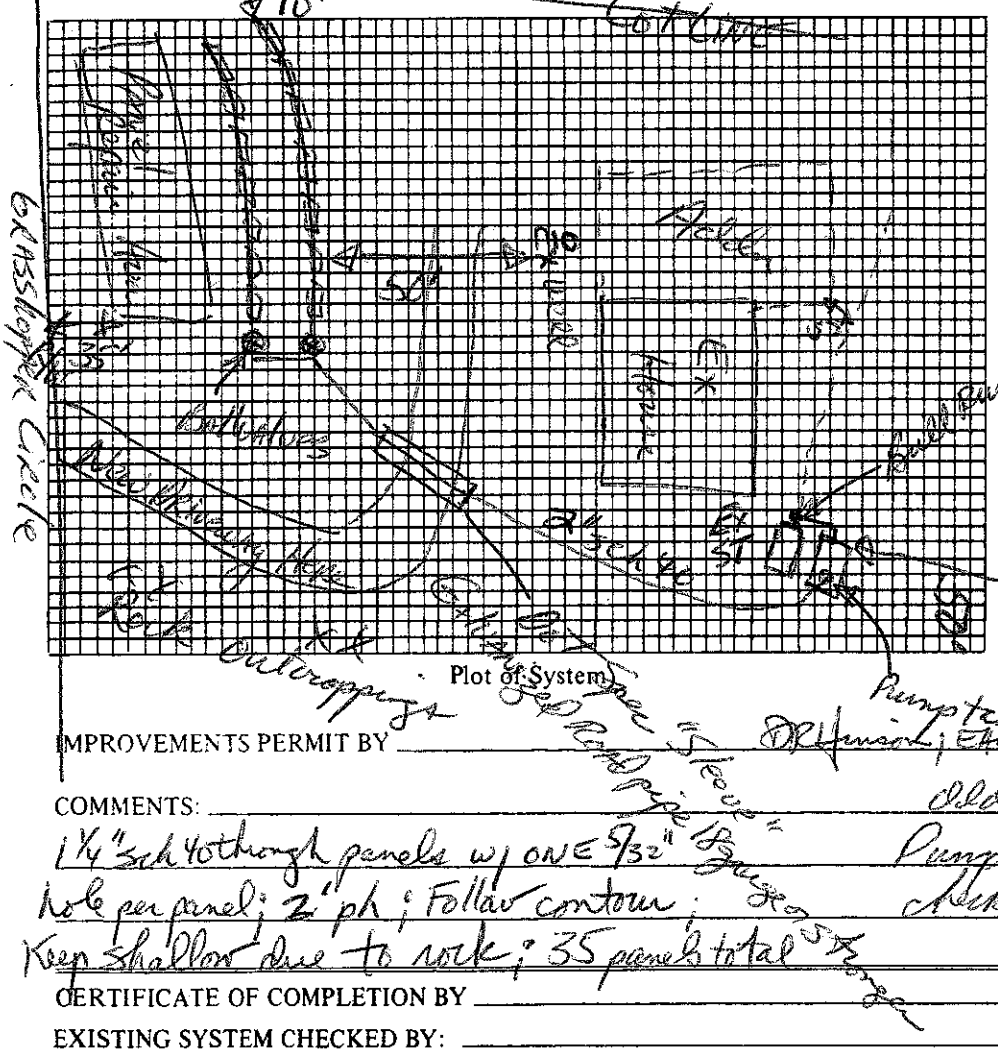

Plot of System

Size of Tank EXISTING Gals.
Nitrification Field:
No. of Lines 2-3
Sq. Ft. _____ Linear Ft. 150' ea
Depth of Stone in Lines 16" to T
Water Supply: Individual (✓) Existing Public ( ) panels pressure dosed

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: *Harold Harrington

IMPROVEMENTS PERMIT BY DR Hunsucker, EHS

COMMENTS: old driveway to be abandoned. Pump w. Septic tank and lids condition (replace if needed) 1¼" Sch 40 through panels w/ ONE 5/32" hole per panel; 2" ph; Follow contour; Keep shallow due to rock; 35 panels total

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit. Pump specs & 15 gal/min at Approx 32' total head

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold