IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Craig A. Shore DATE July 26, 88 PERMIT NO.

PHONE: Business Home

LOCATION 150 W. T.L. PARADISE PENINSULA. BEAR R. at Fork. ~1/4 mile on R. S. R. No.

SUBDIVISION NAME LOT NO. 1135 SECTION OR BLOCK NO.

21-6-A-206C

House ( ) Mobile Home (✓) Business ( ) Other


No. Bedrooms 3 No. Bathrooms 2
Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )

Character & Porosity of Soil clayey
Percolation Rate ~.4 gpd/ft²
Topography 10-12%
Depth to Water Table 4'+
Rock or other impervious formations none obsered

Lot Area

Basement with Plumbing ___ Basement without Plumbing ✓ No Basement

1000 gal - P.T.

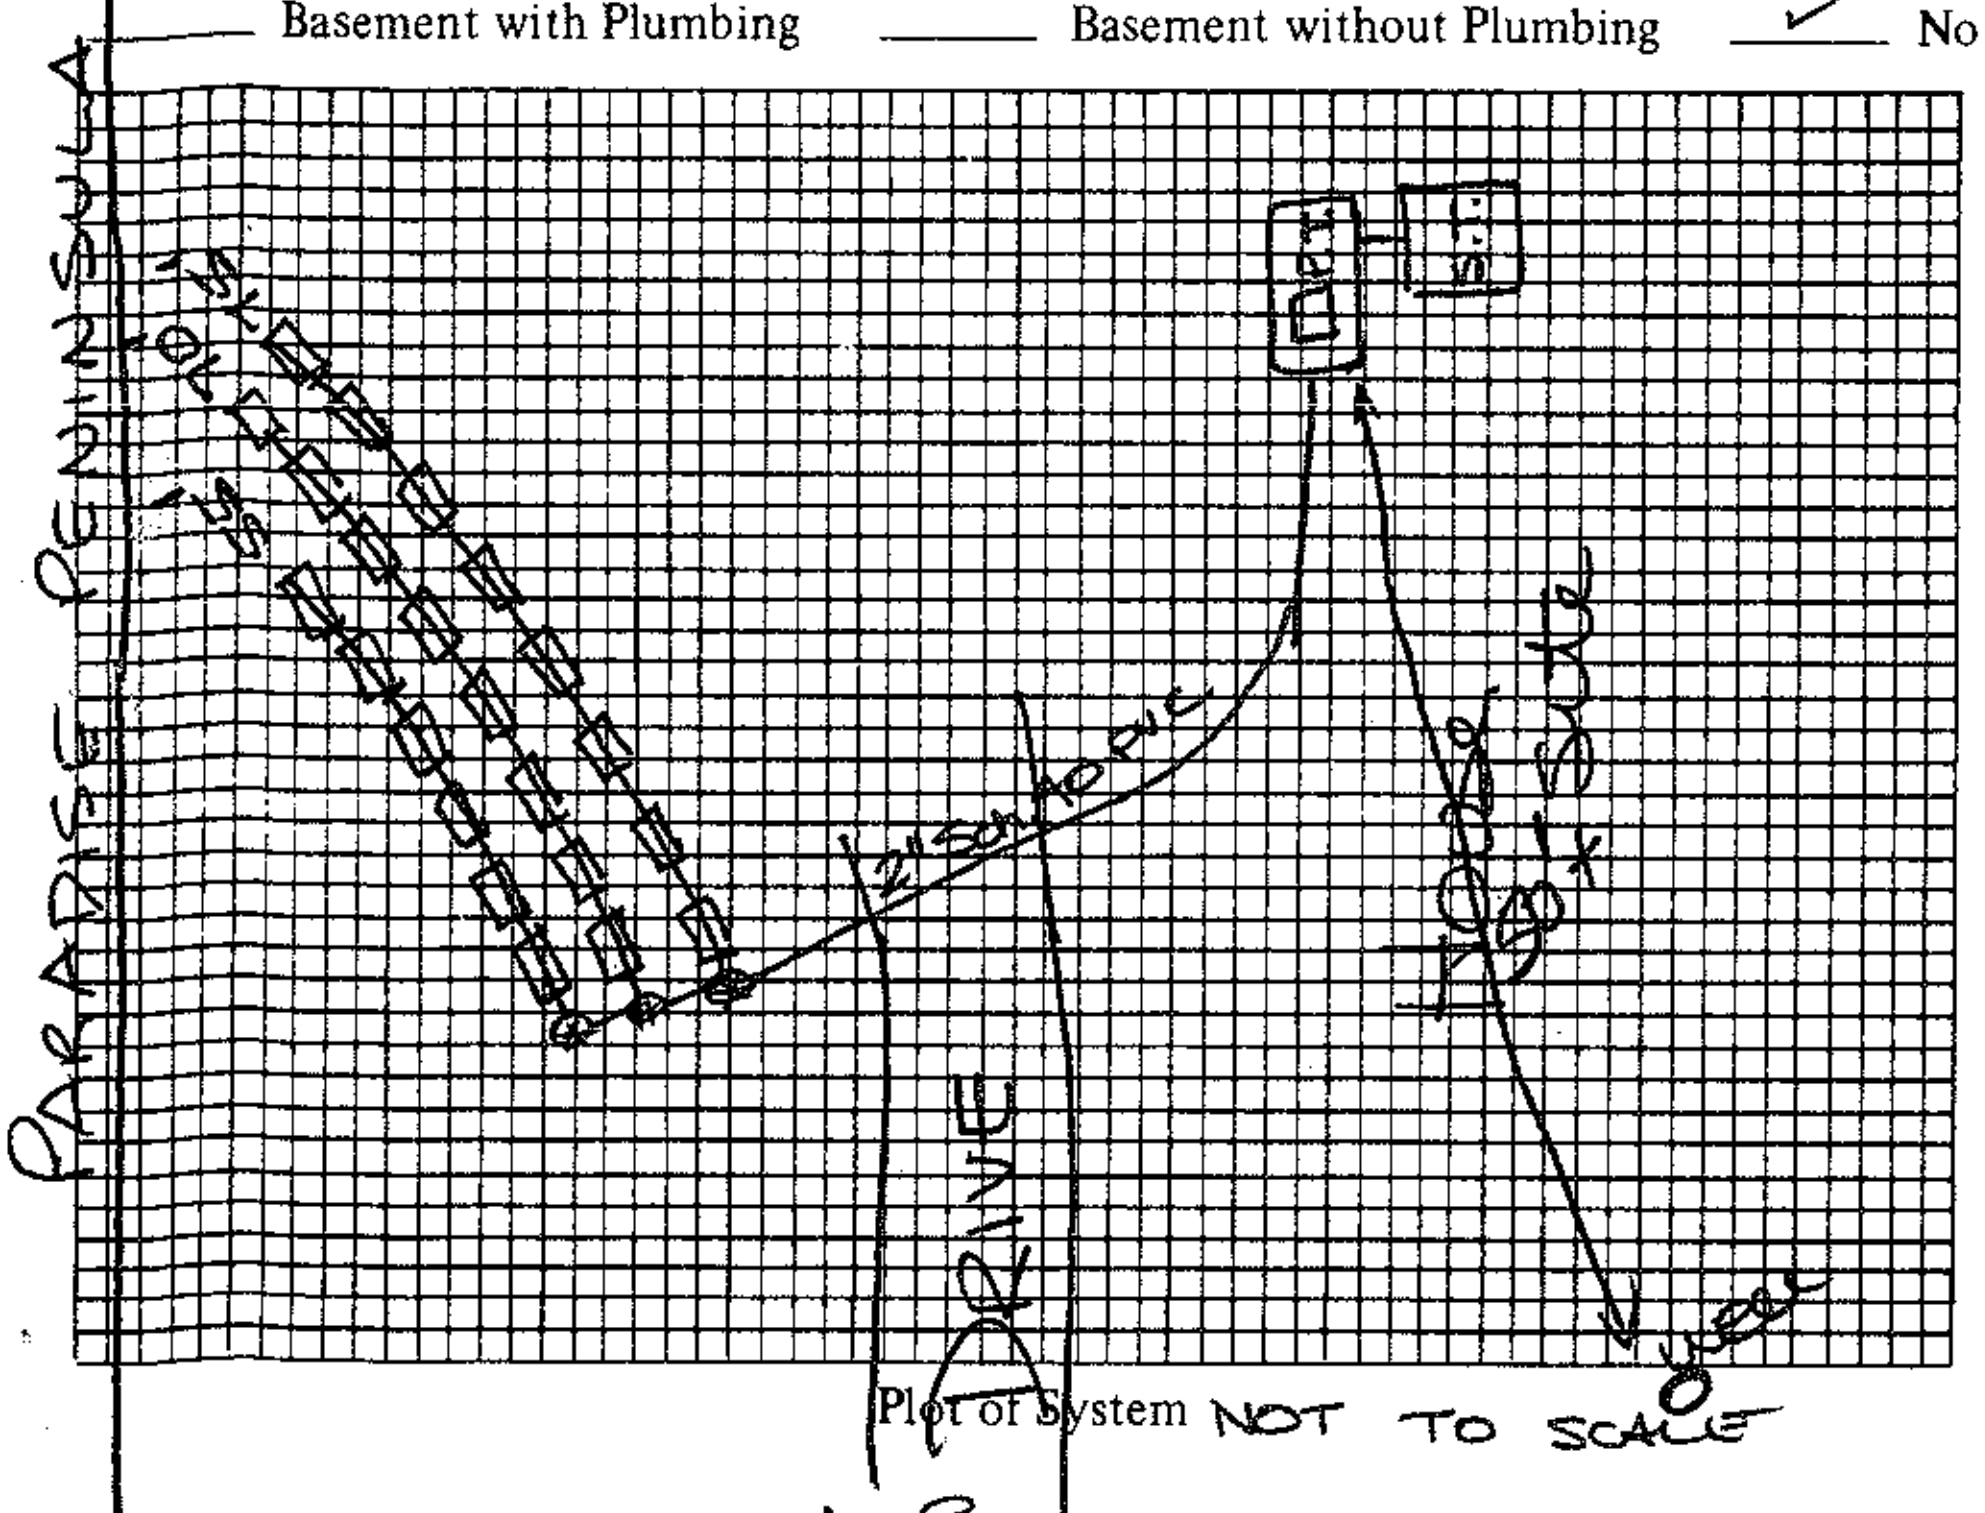

Plot of System

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 3
Sq. Ft. Linear Ft. 200'
Depth of Stone in Lines of 16" T&J
Water Supply: Individual (x) panels.
Public ( )

Installed by Dennis Galliher

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed:

IMPROVEMENTS PERMIT BY AP

COMMENTS: 7/19/88 - cked system
7/20/88 - didnt get pump regulated
7/26/88 - regulated pump to 2' on each ditch.

CERTIFICATE OF COMPLETION BY Andre C. Price DATE 7/26/88

EXISTING SYSTEM CHECKED BY: DATE

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold