DENR/DEH

ON-SITE WASTEWATER SECTION

Sheet 1 of 4
PROPERTY ID #:
COUNTY:

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Tommy Sawyer — APPLICATION DATE 8/10/15
ADDRESS: Same — DATE EVALUATED: 2/10/15
PROPOSED FACILITY: SFR — PROPOSED DESIGN FLOW (.1949): 360 GPD. — PROPERTY SIZE: 3/4 Acre
LOCATION OF SITE: 149 Hogan Ln. Mocksville NC — PROPERTY RECORDED: 60's
WATER SUPPLY: ☒ Private ☐ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☒ Auger Boring ☐ Pit ☐ Cut — TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
A 1	LS 12%	0-4	BCL, SBK	FR, SS, SP	/	48"	F-C SAP INCL 15"-48"	/	.275
		4-15	RC, SBK	" " "					
		15-36	RC/CL, SBK/MSBK	" " "					
		36-48	RCL, WSBK	" " "					
A 2	LS 12%	0-4	BSL, SBK	FR, SS, SP	/	48"	C-M SAP INCL 15"-48"	/	.275
		4-15	RC, ASBK	FI, S, P					
		15-38	RC, SBK	FR, SS, SP					
		38-48	RCL, WSBK	" " "					
A 3	LS 12%	0-36	FILL		/	36"-39"	M SAP INCL 36"-39"	40"	US
		36-39	CL, WSBK	FR, SS, SP					
		40	AR						
A 4	LS 12%	0-10	FILL		/	10"-48"	C-M SAP INCL 31"-48"	/	.3 10"-48"
		10-29	RC, SBK	FR, SS, SP					
		29-48	RCL, SBK/MSBK	" " "					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	Approved	Approved
Site LTAR	.275	.275

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948): PS
EVALUATED BY:
OTHER(S) PRESENT: Tommy Sawyer

COMMENTS: A3 Had Burnt Pieces of wood In Auger Indicating Burn Pit

SOIL/SITE EVALUATION

(Continuation Sheet)

DEPARTMENT OF ENVIRONMENT
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH

PROPERTY ID #: 2960
DATE OF EVALUATION:
COUNTY: Iredell

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
A 5	LS 12%	0-11	FILL		/	11-48"	C-M SAP INCL 27-48"	/	.3 11-48"
		11-29	RCL, SBK	FR, SS, SP					
		29-48	RCL, SBK/MSBK	" " "					
A 6	LS 12%	0-4	BCL, SBK	FR, SS, SP	/	35"	C-M SAP INCL 14-35"	/	.3
		4-16	RCL, SBK	" " "					
		16-35	RCL, SBK/MSBK	" " "					
		35-48	MASS SAP	VFR, SS, SP					
A 7	LS 12%	0-3	BCL, SBK	FR, SS, SP	/	48"	C-M SAP INCL 24-48"	/	.3
		3-37	RCL, SBK	" " "					
		37-48	RCL, SBK/MSBK	" " "					

COMMENTS:

LEGEND

use the following standard abbreviations

LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL .1955 LTAR*	LPP .1957 LTAR*	MINERALOGY/ CONSISTENCE	STRUCTURE
CC (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
CV (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
D (Drainage Way)					EXP (Expansive)	CR (Crumb)
DS (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
FP (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
FS (Foot Slope)						ABK (Angular Blocky)
H (Head Slope)	III	Si (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
L (Linear Slope)		SiCL (Silty Clay Loam)				PR (Prismatic)
N (Nose Slope)		CL (Clay Loam)				
R (Ridge)		SCL (Sandy Clay Loam)			**MOIST**	**WET**
S (Shoulder Slope)		SiL (Silt Loam)				
T (Terrace)					VFR (Very Friable)	NS (Non-sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FR (Friable)	SS (Slightly Sticky)
		SiC (Silty Clay)			FI (Firm)	S (Sticky)
		C (Clay)			VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
		O (Organic)	None	None	EFI (Extremely Firm)	NP (Non-plastic)
						SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)

*Adjust LTAR due to depth, consistence, structure, soil wetness, landscape, position, wastewater flow and quality.


NOTES

HORIZON DEPTH	In inches below natural soil surface
DEPTH OF FILL	In inches from land surface
RESTRICTIVE HORIZON	Thickness and depth from land surface
SAPROLITE	S(suitable) or U(unsuitable)
SOIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
CLASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

Evaluation of saprolite shall be by pits.

Long-term Acceptance Rate (LTAR): gal/day/ft^2


Show profile locations and other site features (dimensions, reference or benchmark, and North).

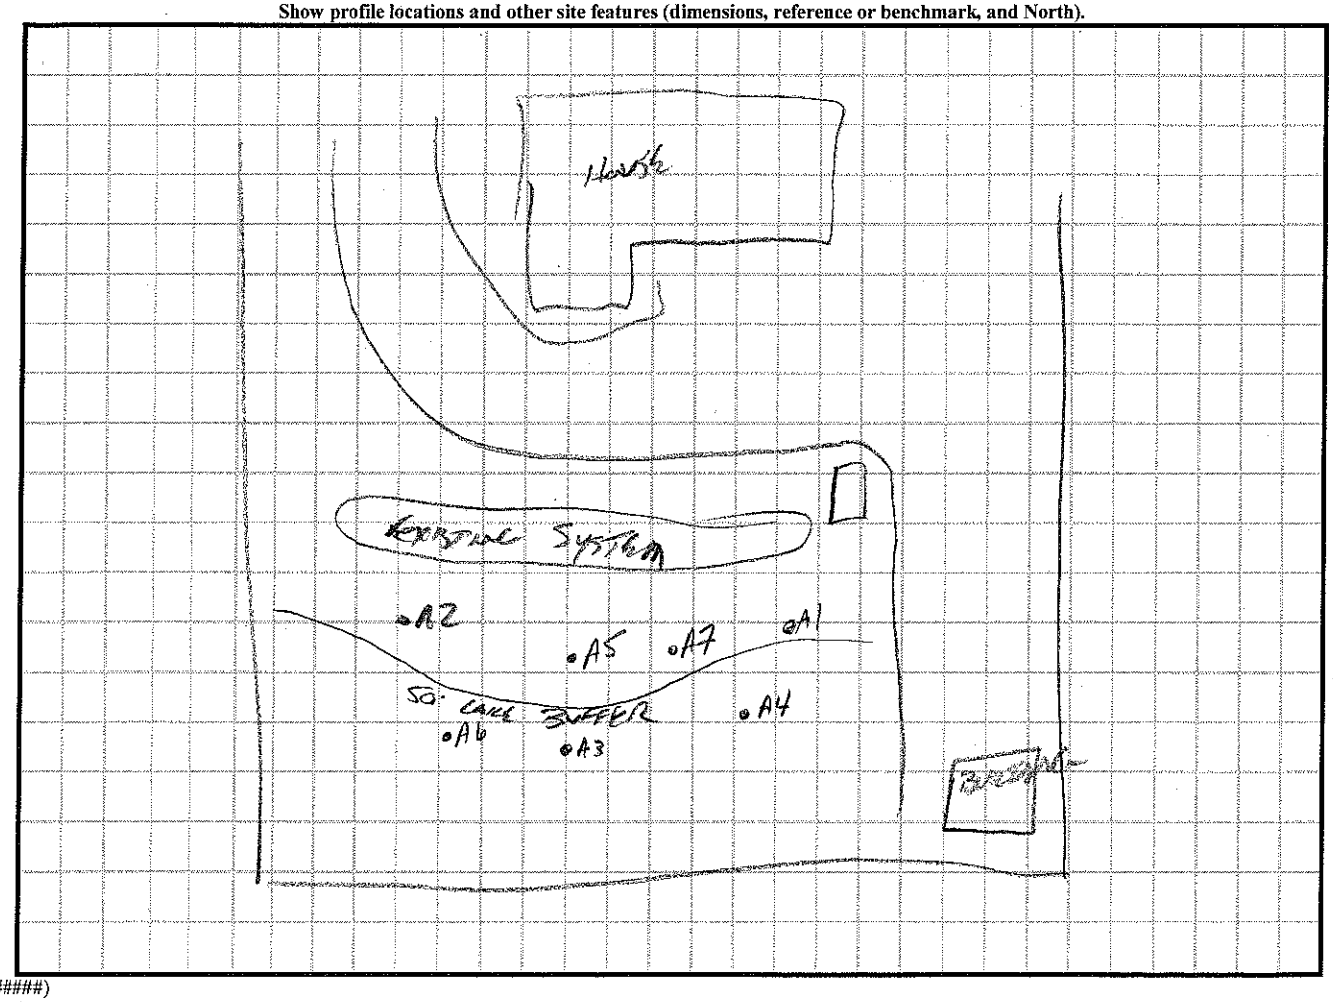

DENR (######)
Review (#####)

1 inch = 40 feet

1:480

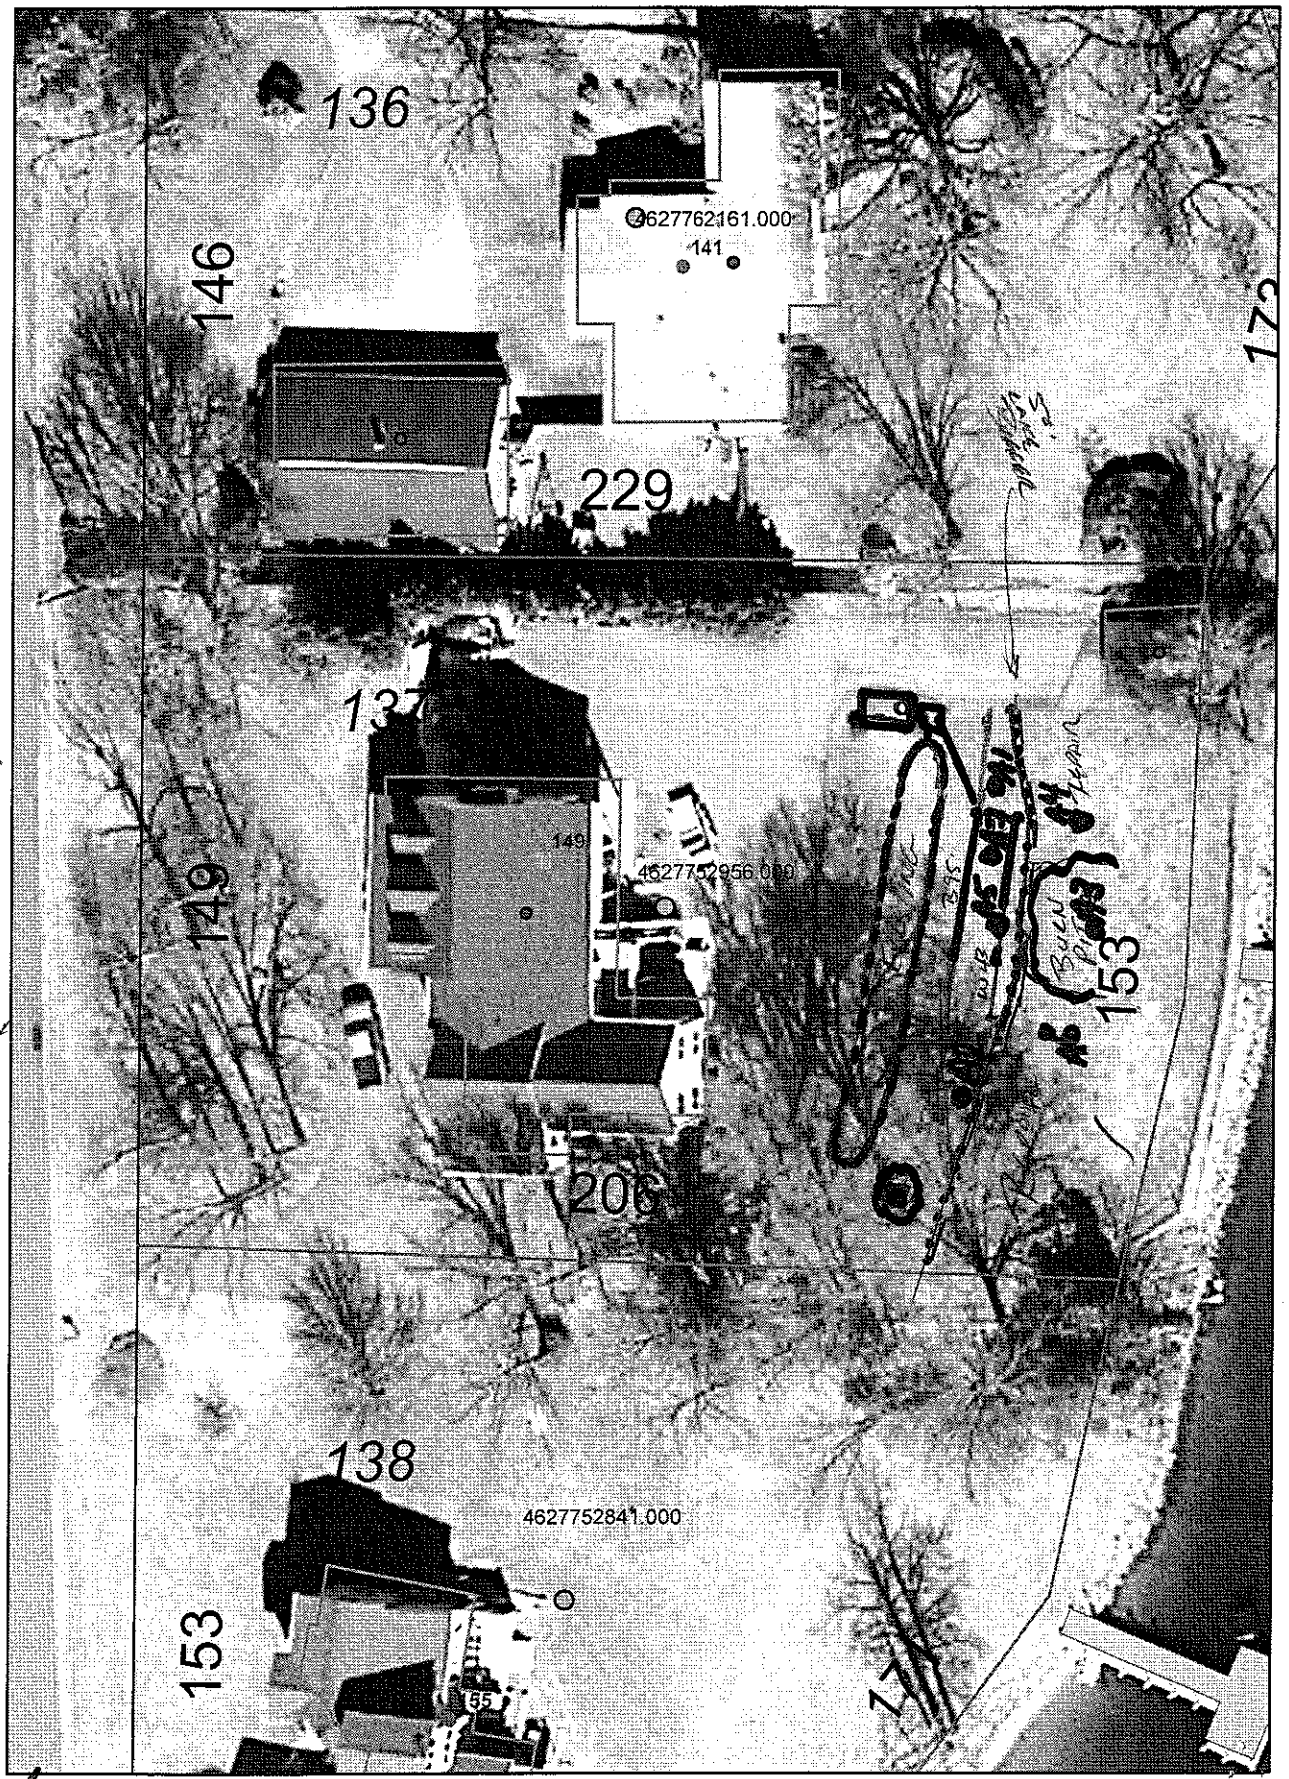

Soil Notes