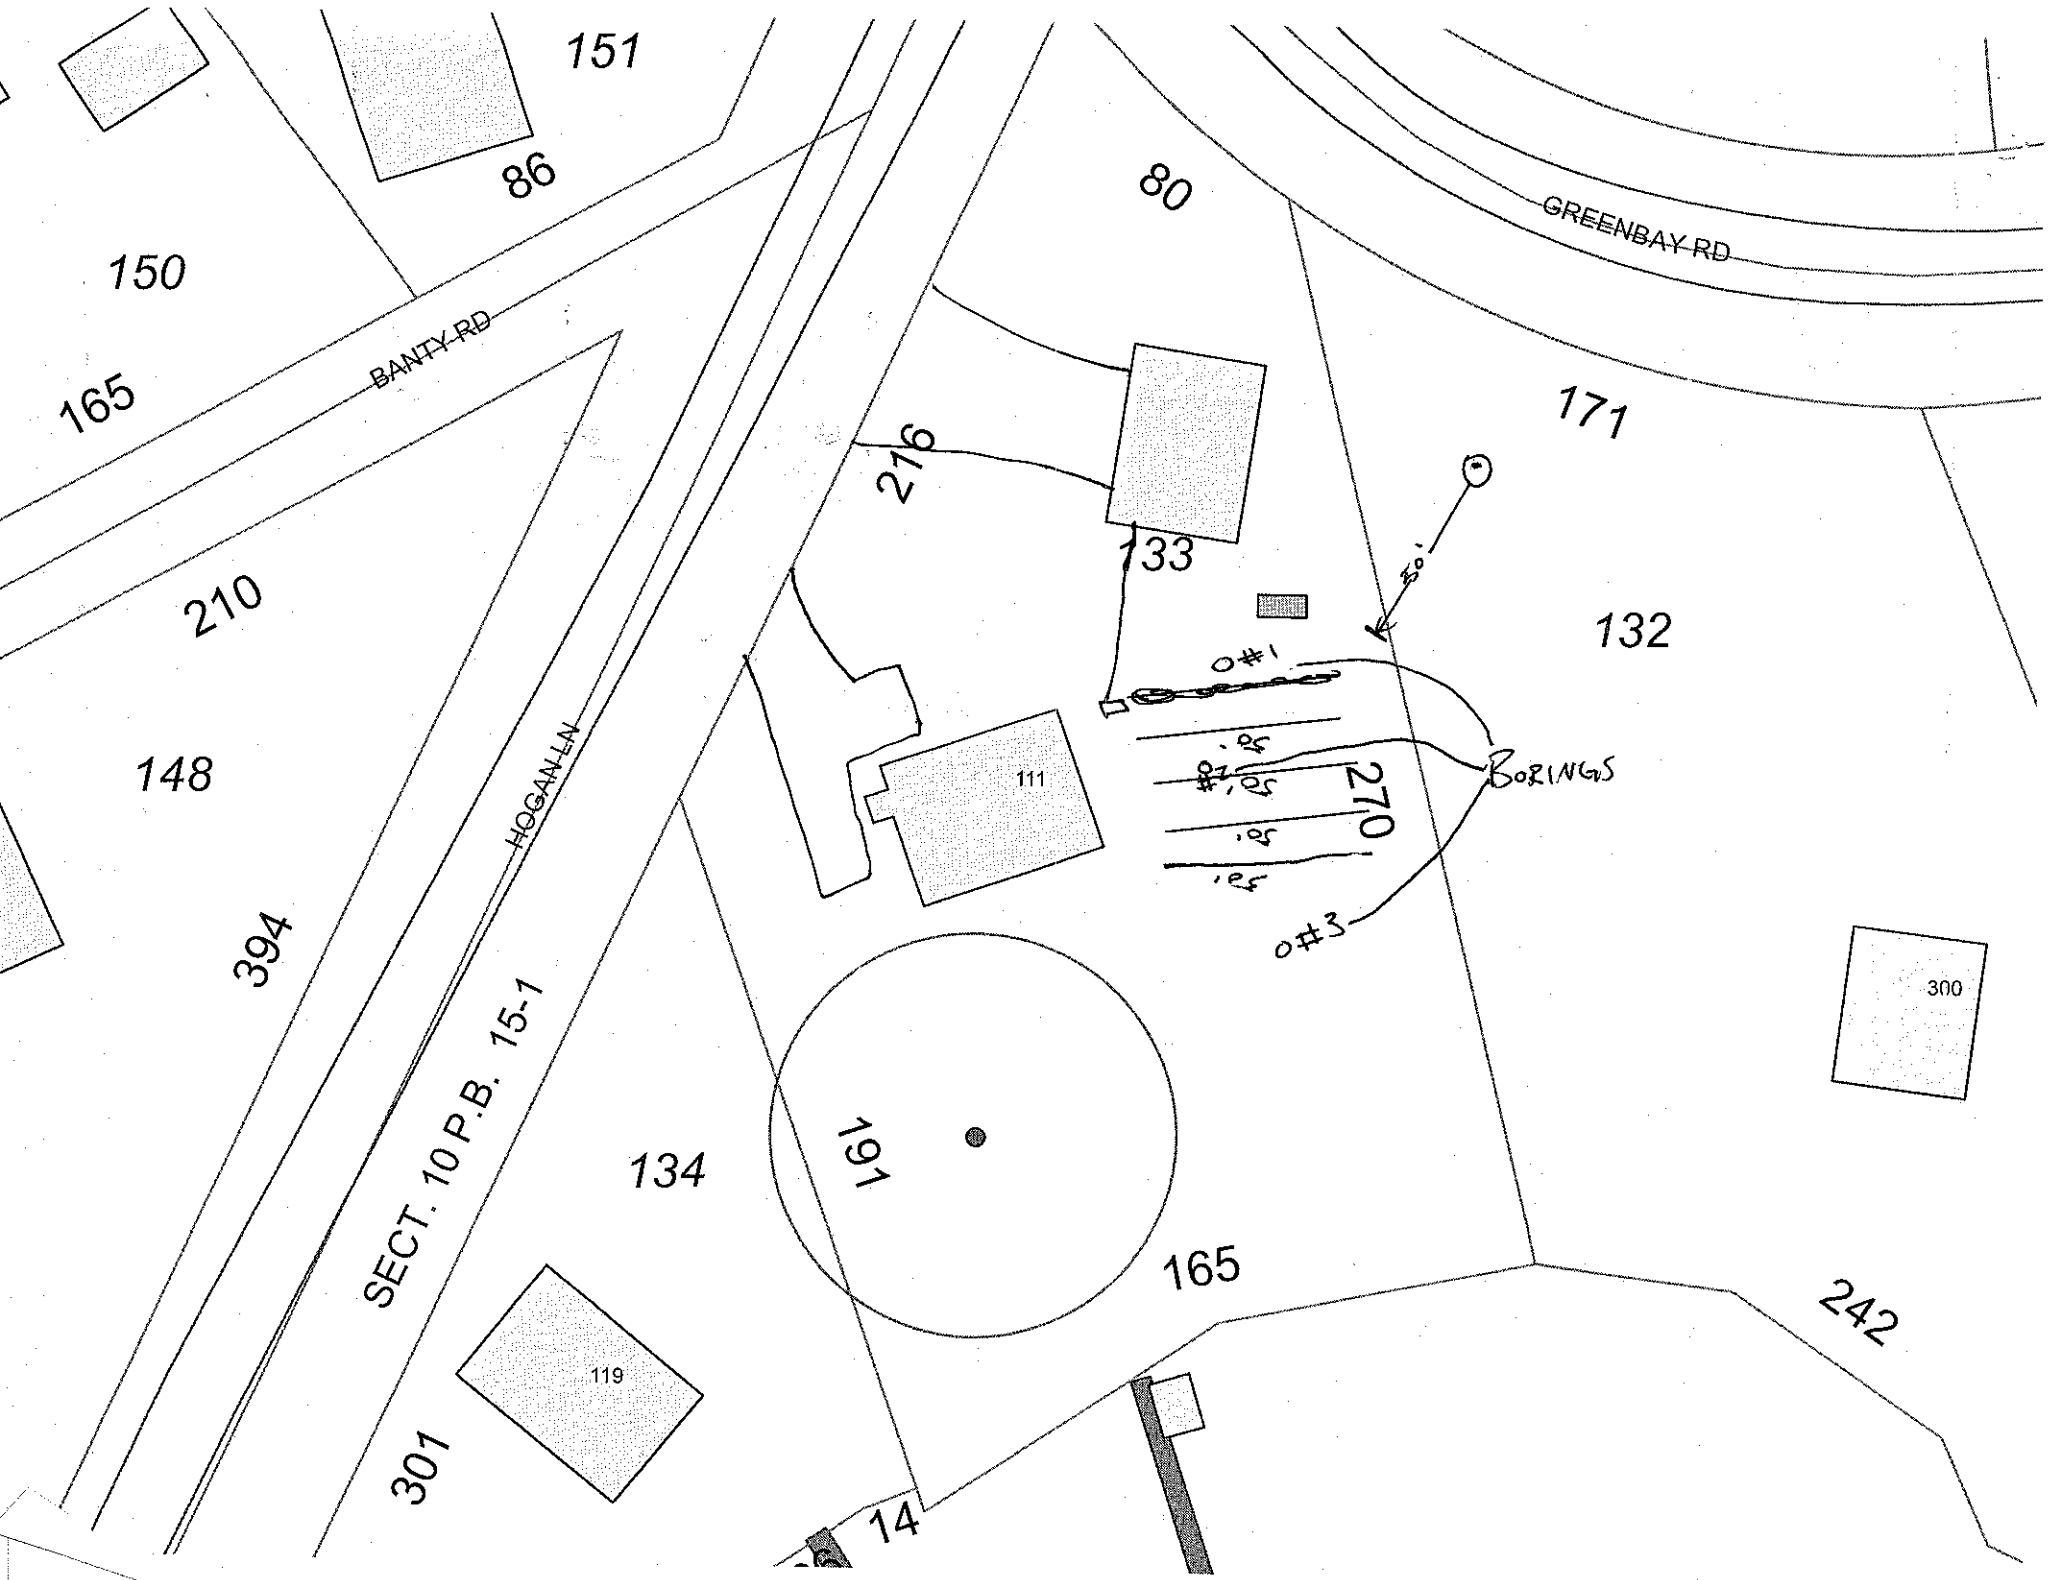
IREDELL COUNTY SOIL/SITE EVALUATION

OWNER	BAKER	GPD	240	LOT SIZE	1.08 AC
APPLICANT	SAME	P. FACILITY	SFR	RECORDED	Y
ADDRESS	111 HOGAN LN MOORESVILLE, NC 28117				
SUBDIVISION	CL&T		SECTION	10	LOT # 133
WATER SUPPLY		PUBLIC	X INDIVIDUAL	X WELL	SPRING OTHER

PROFILE LANSCAPE POSITION SLOPE	H. DEPTH	MORPHOLOGY STRUCTURE TEXTURE	MORPHOLOGY CONSISTENCE MINEROLOGY	PROFILE FACTORS WETNESS	SOIL DEPTH	SAP CLASS	REST. HORIZO	LTAR
AB 1	0-6	C,M,SBK	SS,FR	NA	31"	S	48+	0.35
	6-31	CL,W,SBK	SS,VFR					
LINEAR	31-48	SSAP,MASS	NS,VFR					
6%								
AB 2	0-24	CL,W,SBK	SS,VFR	NA	24"	S	48+	0.30
	24-48	LSAP,MASS	NS,VFR					
LINEAR								
6%								
AB 3	0-28	CL,M,SBK	SS,FR	NA	28"	S	48+	0.30
	28-48	LSAP,MASS	NS,VFR					
LINEAR								
6%								

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM	OTHER FACTORS	
AVAILABLE SPACE	S	S	SOIL EVALUATION BY	BEN ALDRIDGE
SYSTEM TYPE	GRAVITY 25%	SAME	SITE EVALUATION BY	BEN ALDRIDGE
SITE LTAR	0.3	0.3	OTHERS PRESENT	ROBERT BAKER


151
86
150
BANTY RD
165
210
148
394
HOGAN LN
SECT. 10 P.B. 15-1
301
119
134
191
165
14
80
GREENBAY RD
216
133
171
132
50'
O#1
O#2
O#3
BORINGS
270
111
300
242