...RTMENT OF ENVIRONMENT AND NATURAL RESOURCES
...ION OF ENVIRONMENTAL HEALTH
...ITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

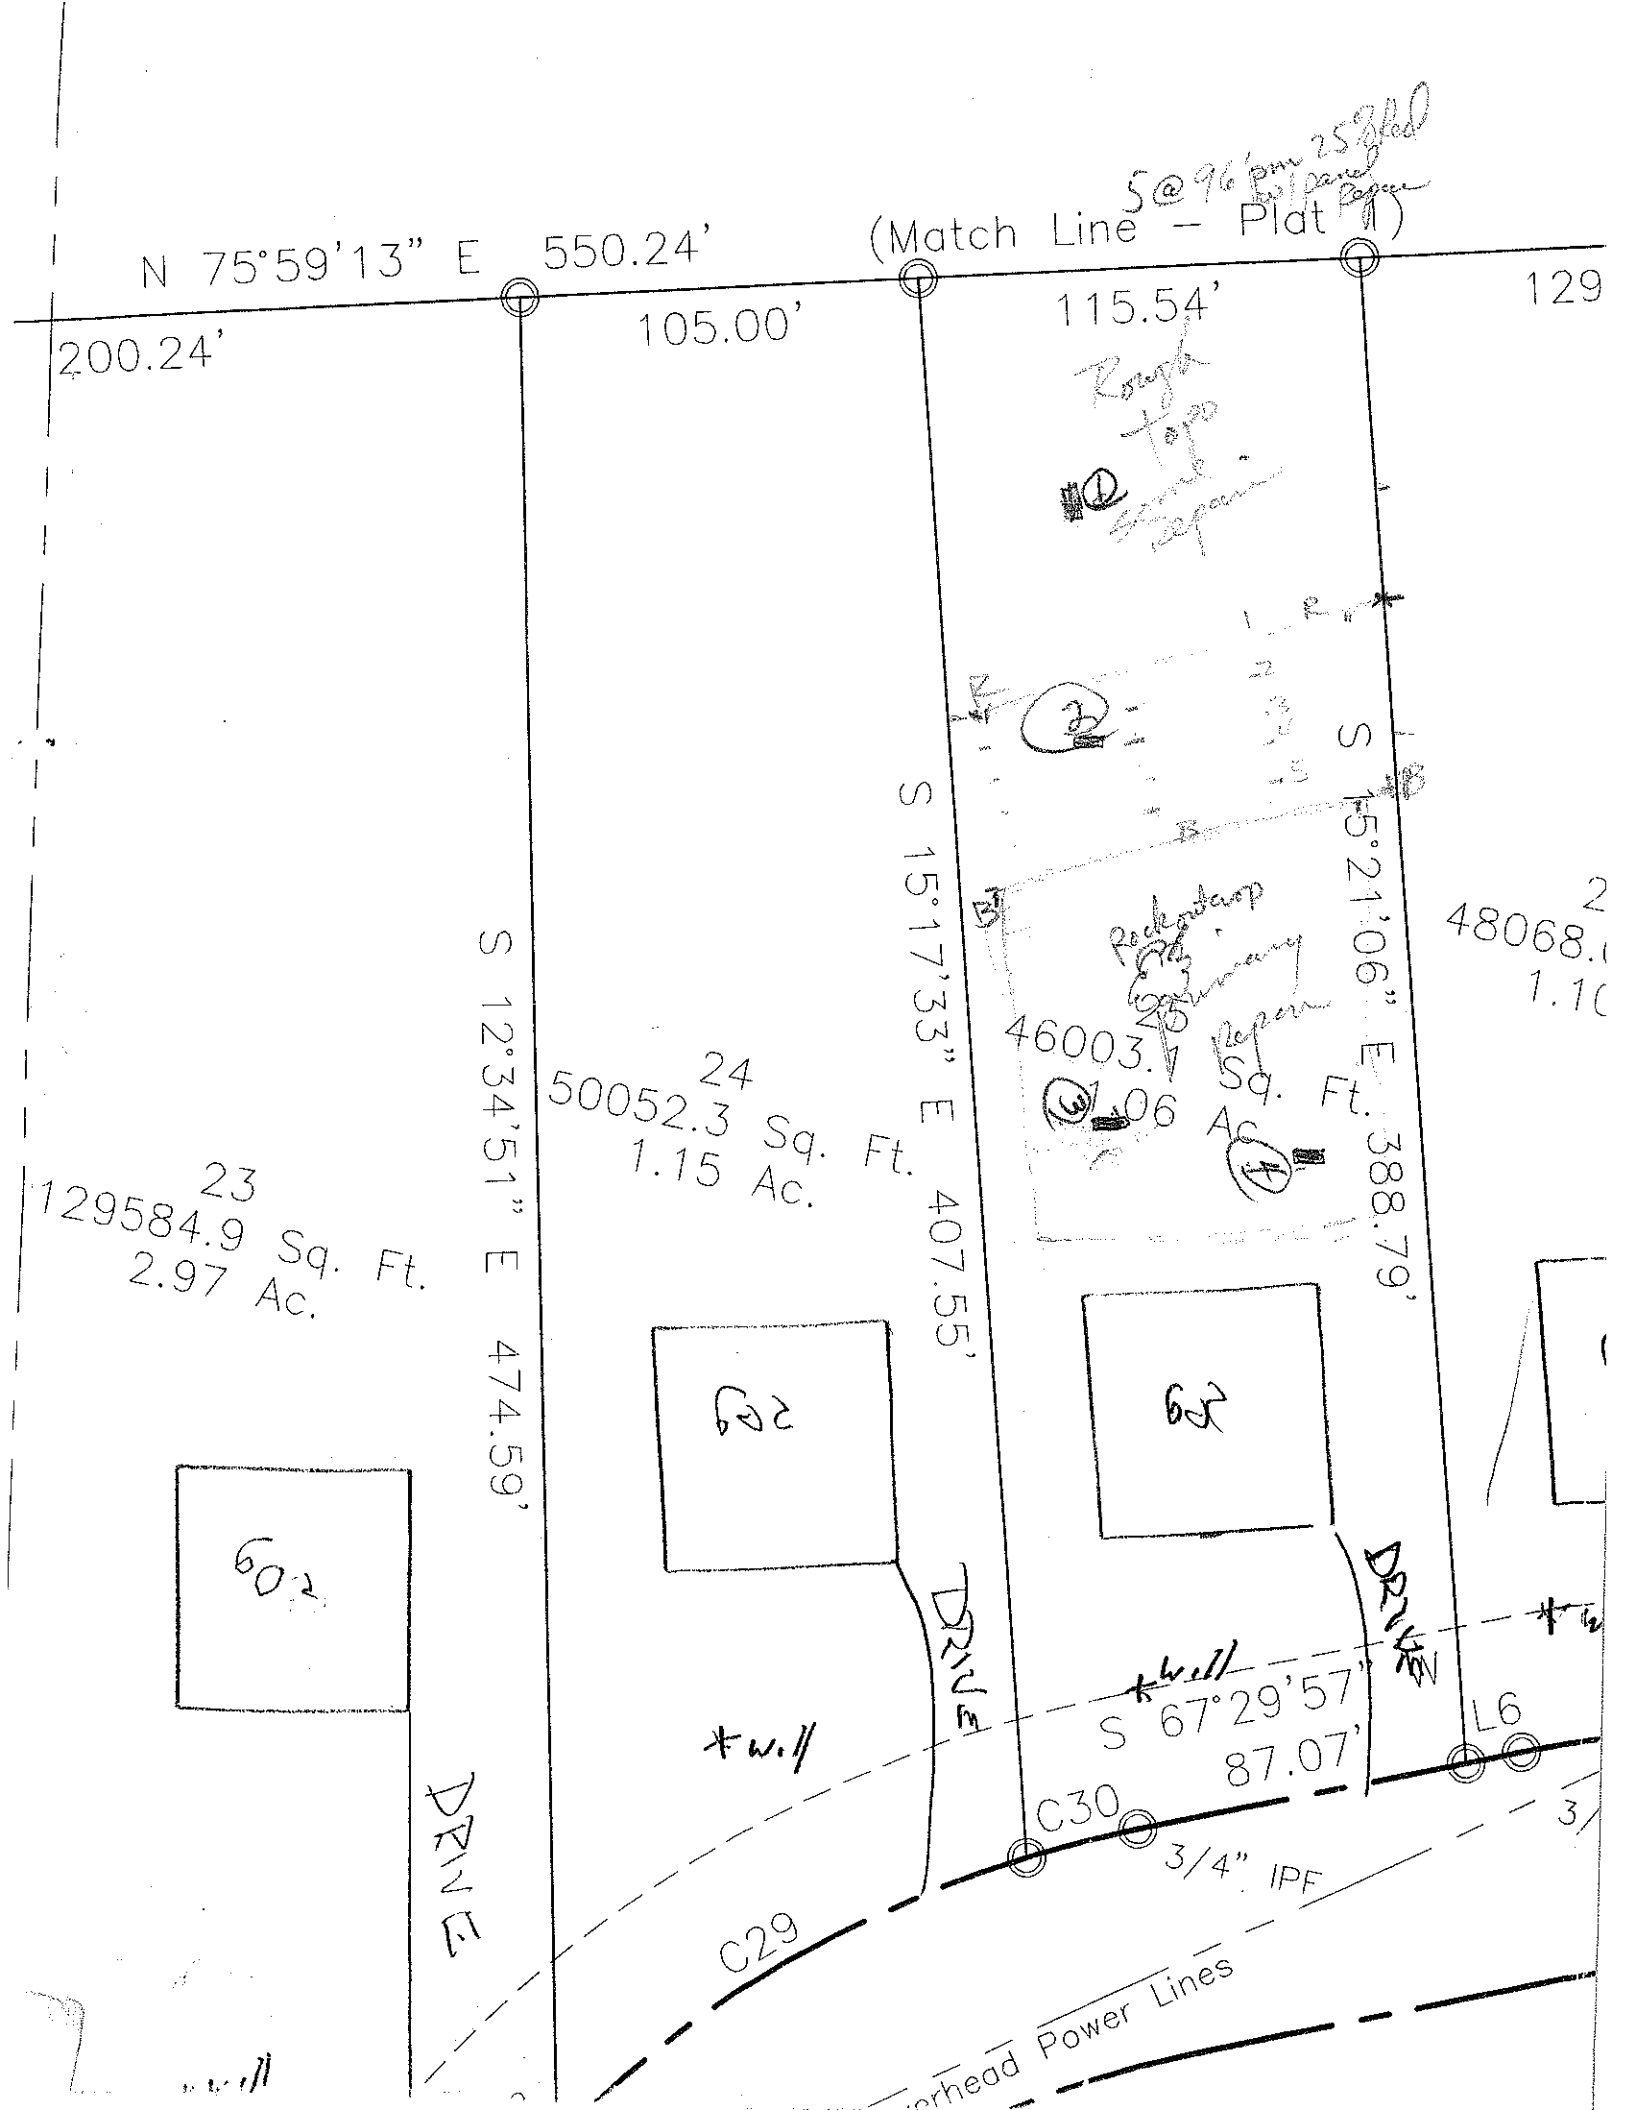
...WNER: _____ APPLICATION DATE _____
...DDRESS: _____ DATE EVALUATED: 8-7-03
...ROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 4bedroom PROPERTY SIZE: _____
...OCATION OF SITE: Lot 25 Cranfam PROPERTY RECORDED: _____
...WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
...TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-24	gr fsl	fr sso p	common yellow mottles				.25
		24-52	mk sbk yr sc	fr sso p					
2		0-21	gr fsl	fr sso p	few common yellow mottles				.3 .25
		21-38	wk sbk ry scl	fr sso p					
		38-48	wk sbk rp-ry sl sc	fr sso p					
3		0-8	gr fsl/sl	fr sso p	common yellow mottles				.25
		8-39	wk m fm sbk ry-yr sl c	fr sso p					
		39-51	wk sbk yr scl	fr sso p					
4		0-16	gr fsl	fr sso p	common mottles/wet.				.25
		16-35	wk sbk yr sc	fr sso p					
		35-49 (B-C)	wk sbk yr-ry scl	fr sso p					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	PM 75% Red	LPP 25% Red
Site LTAR	.25	.25

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: [illegible]
OTHER(S) PRESENT: [illegible]

COMMENTS: _____


N 75°59'13" E 550.24'
(Match Line – Plat 1)
200.24'
105.00'
115.54'
S 15°17'33" E 407.55'
S 15°21'06" E 388.79'
S 12°34'51" E 474.59'
23
129584.9 Sq. Ft.
2.97 Ac.
24
50052.3 Sq. Ft.
1.15 Ac.
46003.1 Sq. Ft.
1.06 Ac.
S 67°29'57" E
87.07'
C29
C30
L6
3/4" IPF
DRIVE
DRIVE
DRIVE
+w.l.l
+w.l.l
Overhead Power Lines