DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

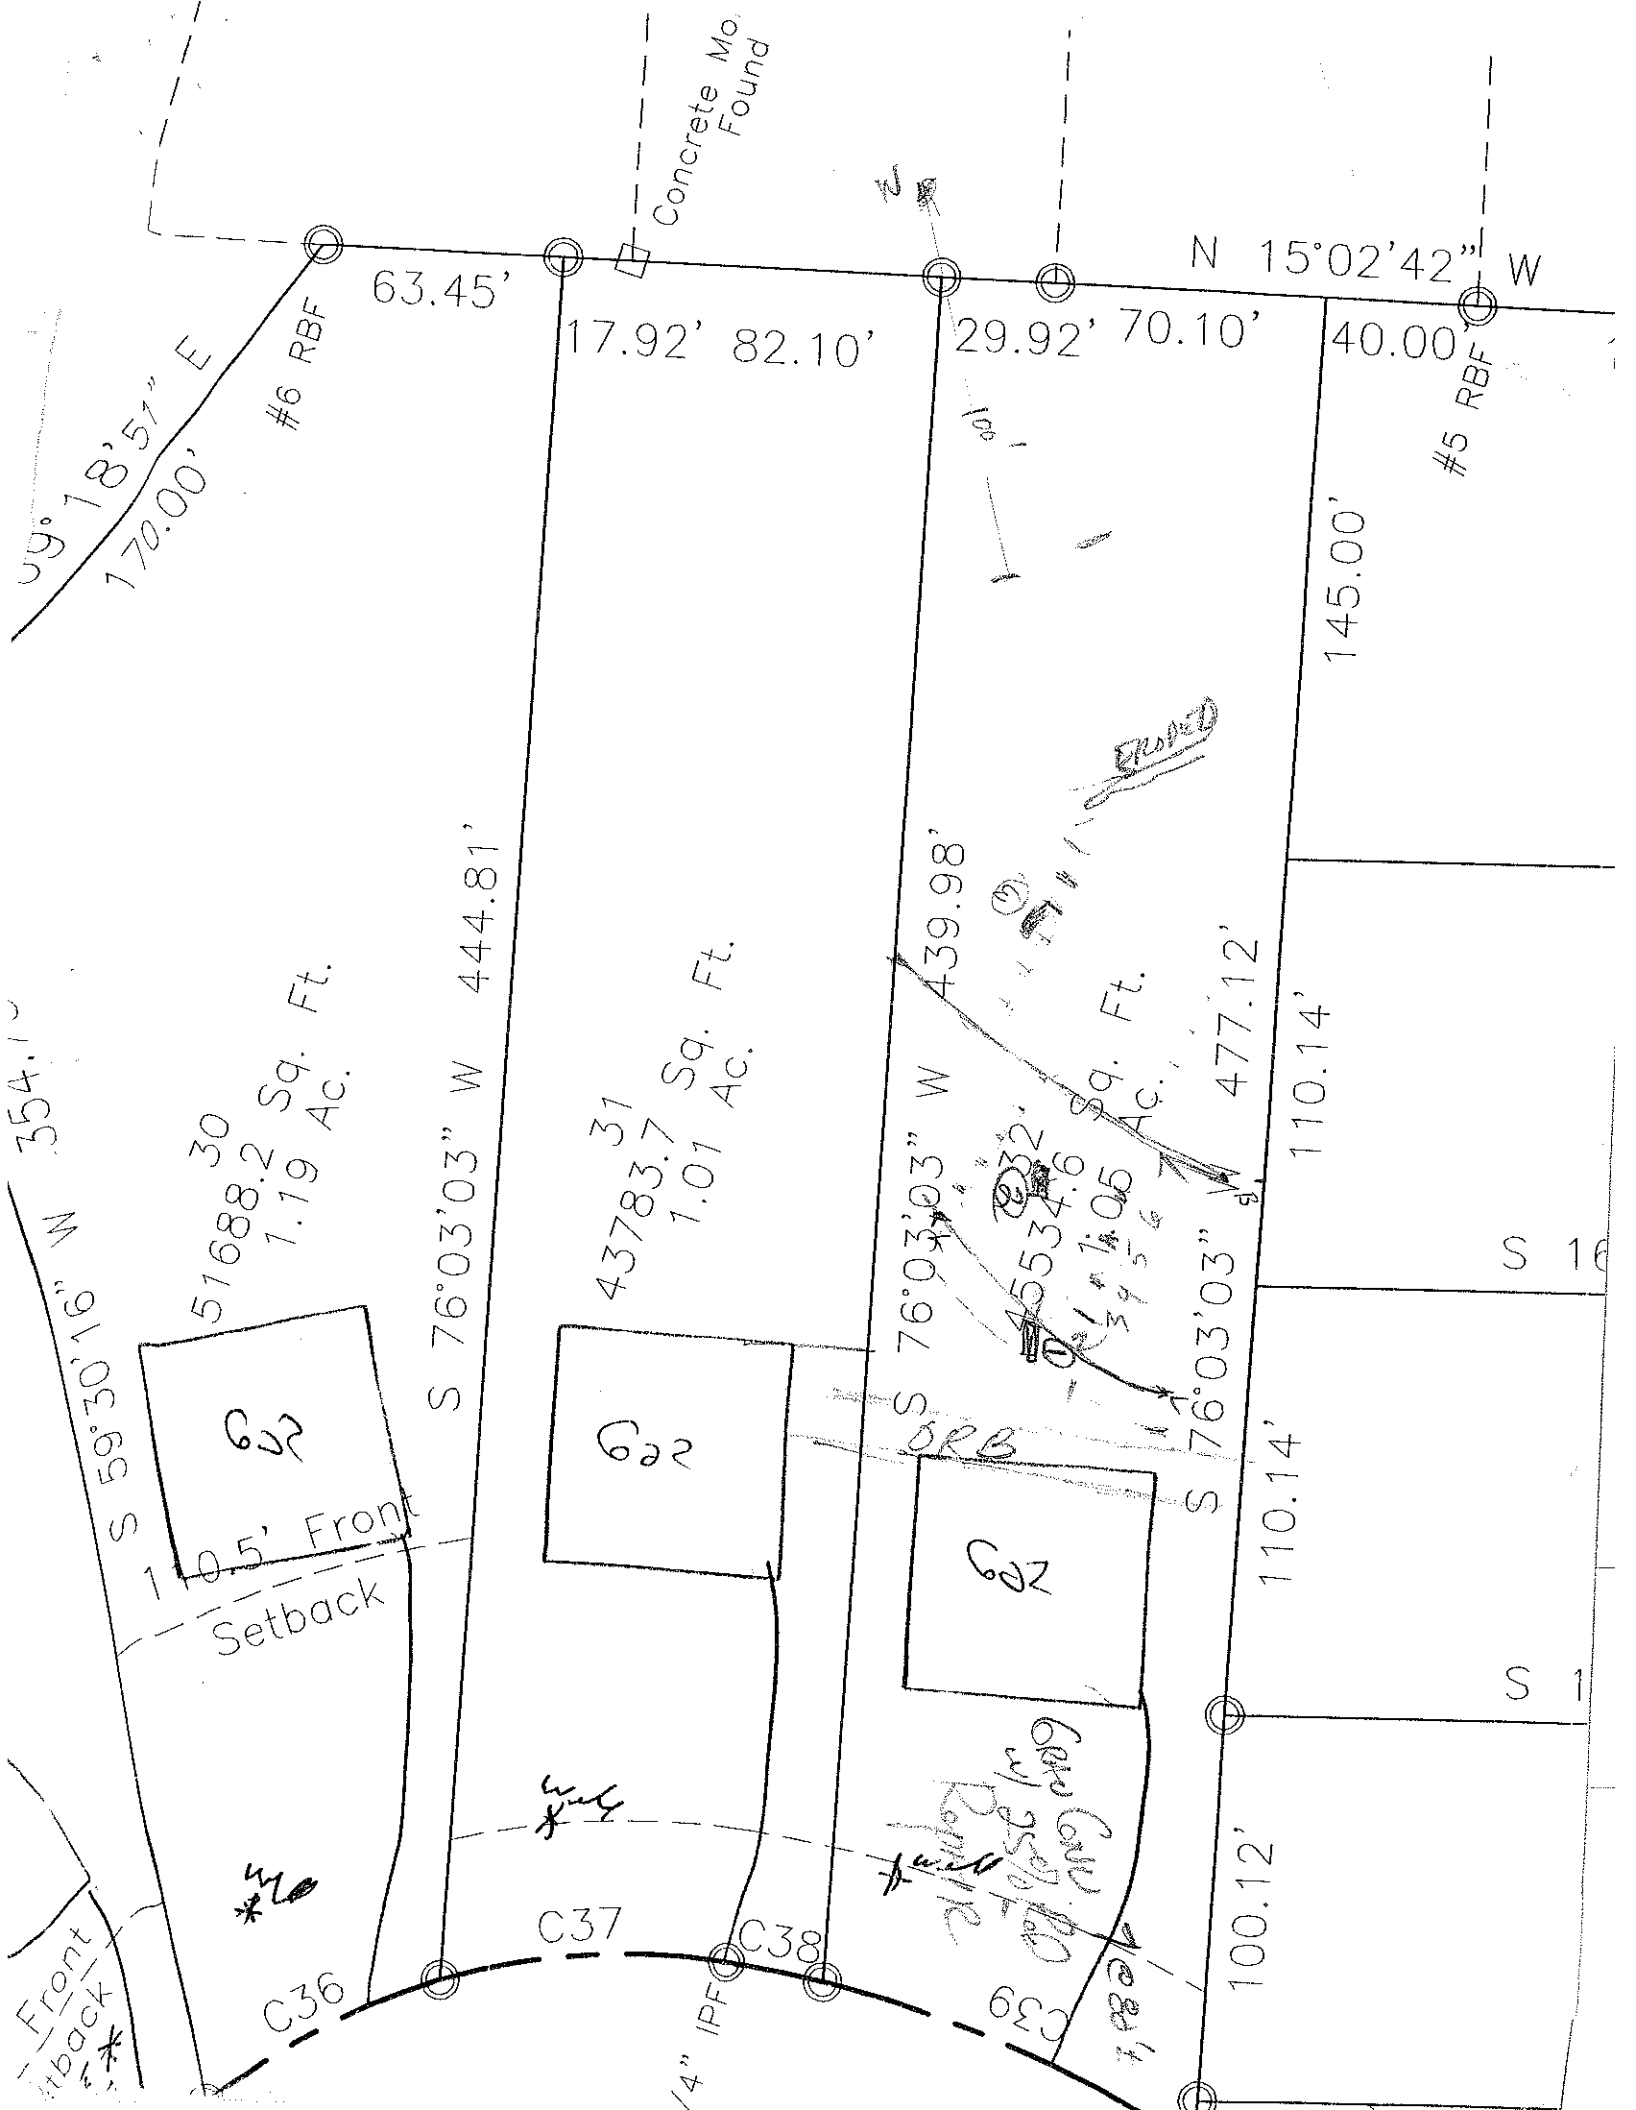
OWNER: _____ APPLICATION DATE _____
ADDRESS: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 4 bdrm DATE EVALUATED: 8-7-03
LOCATION OF SITE: Lot 32 Green Farm PROPERTY SIZE: _____
WATER SUPPLY: ☐ Private ☐ Public ☒ Well ☐ Spring ☐ Other PROPERTY RECORDED: _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	V 12%±	0-3	gr brwn sl	fr sss p					.3
		3-32	mod sbk brwn sl	fr sss p common mica/sap					
		32-50	massive gry l/sl/sap	fr sss p					
2		0-4	gr brwn sl	fr sss p					.3
		4-24	mod sbk RC	fr sp sss p					
		24-50	massive gry l/sap	fr sss sp sap					
3		0-8	gr brwn sl	fr sss p					.3
		8-21	wk fsbk brwn sl	fr sss p					
		21-48	mod sbk RSC fi-fn sss p sap						
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	Gen Conv.	Gen 25% Red.
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: DBH
OTHER(S) PRESENT: Paul Zimmerman

COMMENTS: _____


Concrete Mo Found
N 15°02'42" W
63.45'
17.92'
82.10'
29.92'
70.10'
40.00'
#6 RBF
#5 RBF
170.00'
145.00'
444.81'
439.98'
477.12'
110.14'
110.14'
100.12'
30
51688.2 Sq. Ft.
1.19 Ac.
31
43783.7 Sq. Ft.
1.01 Ac.
Sq. Ft.
Ac.
S 76°03'03" W
S 59°30'16" W
S 76°03'03"
S 16
S 1
G2
G2
G2
10.5' Front
Setback
ORB
C36
C37
C38
C39
Front
Back
Easement