DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

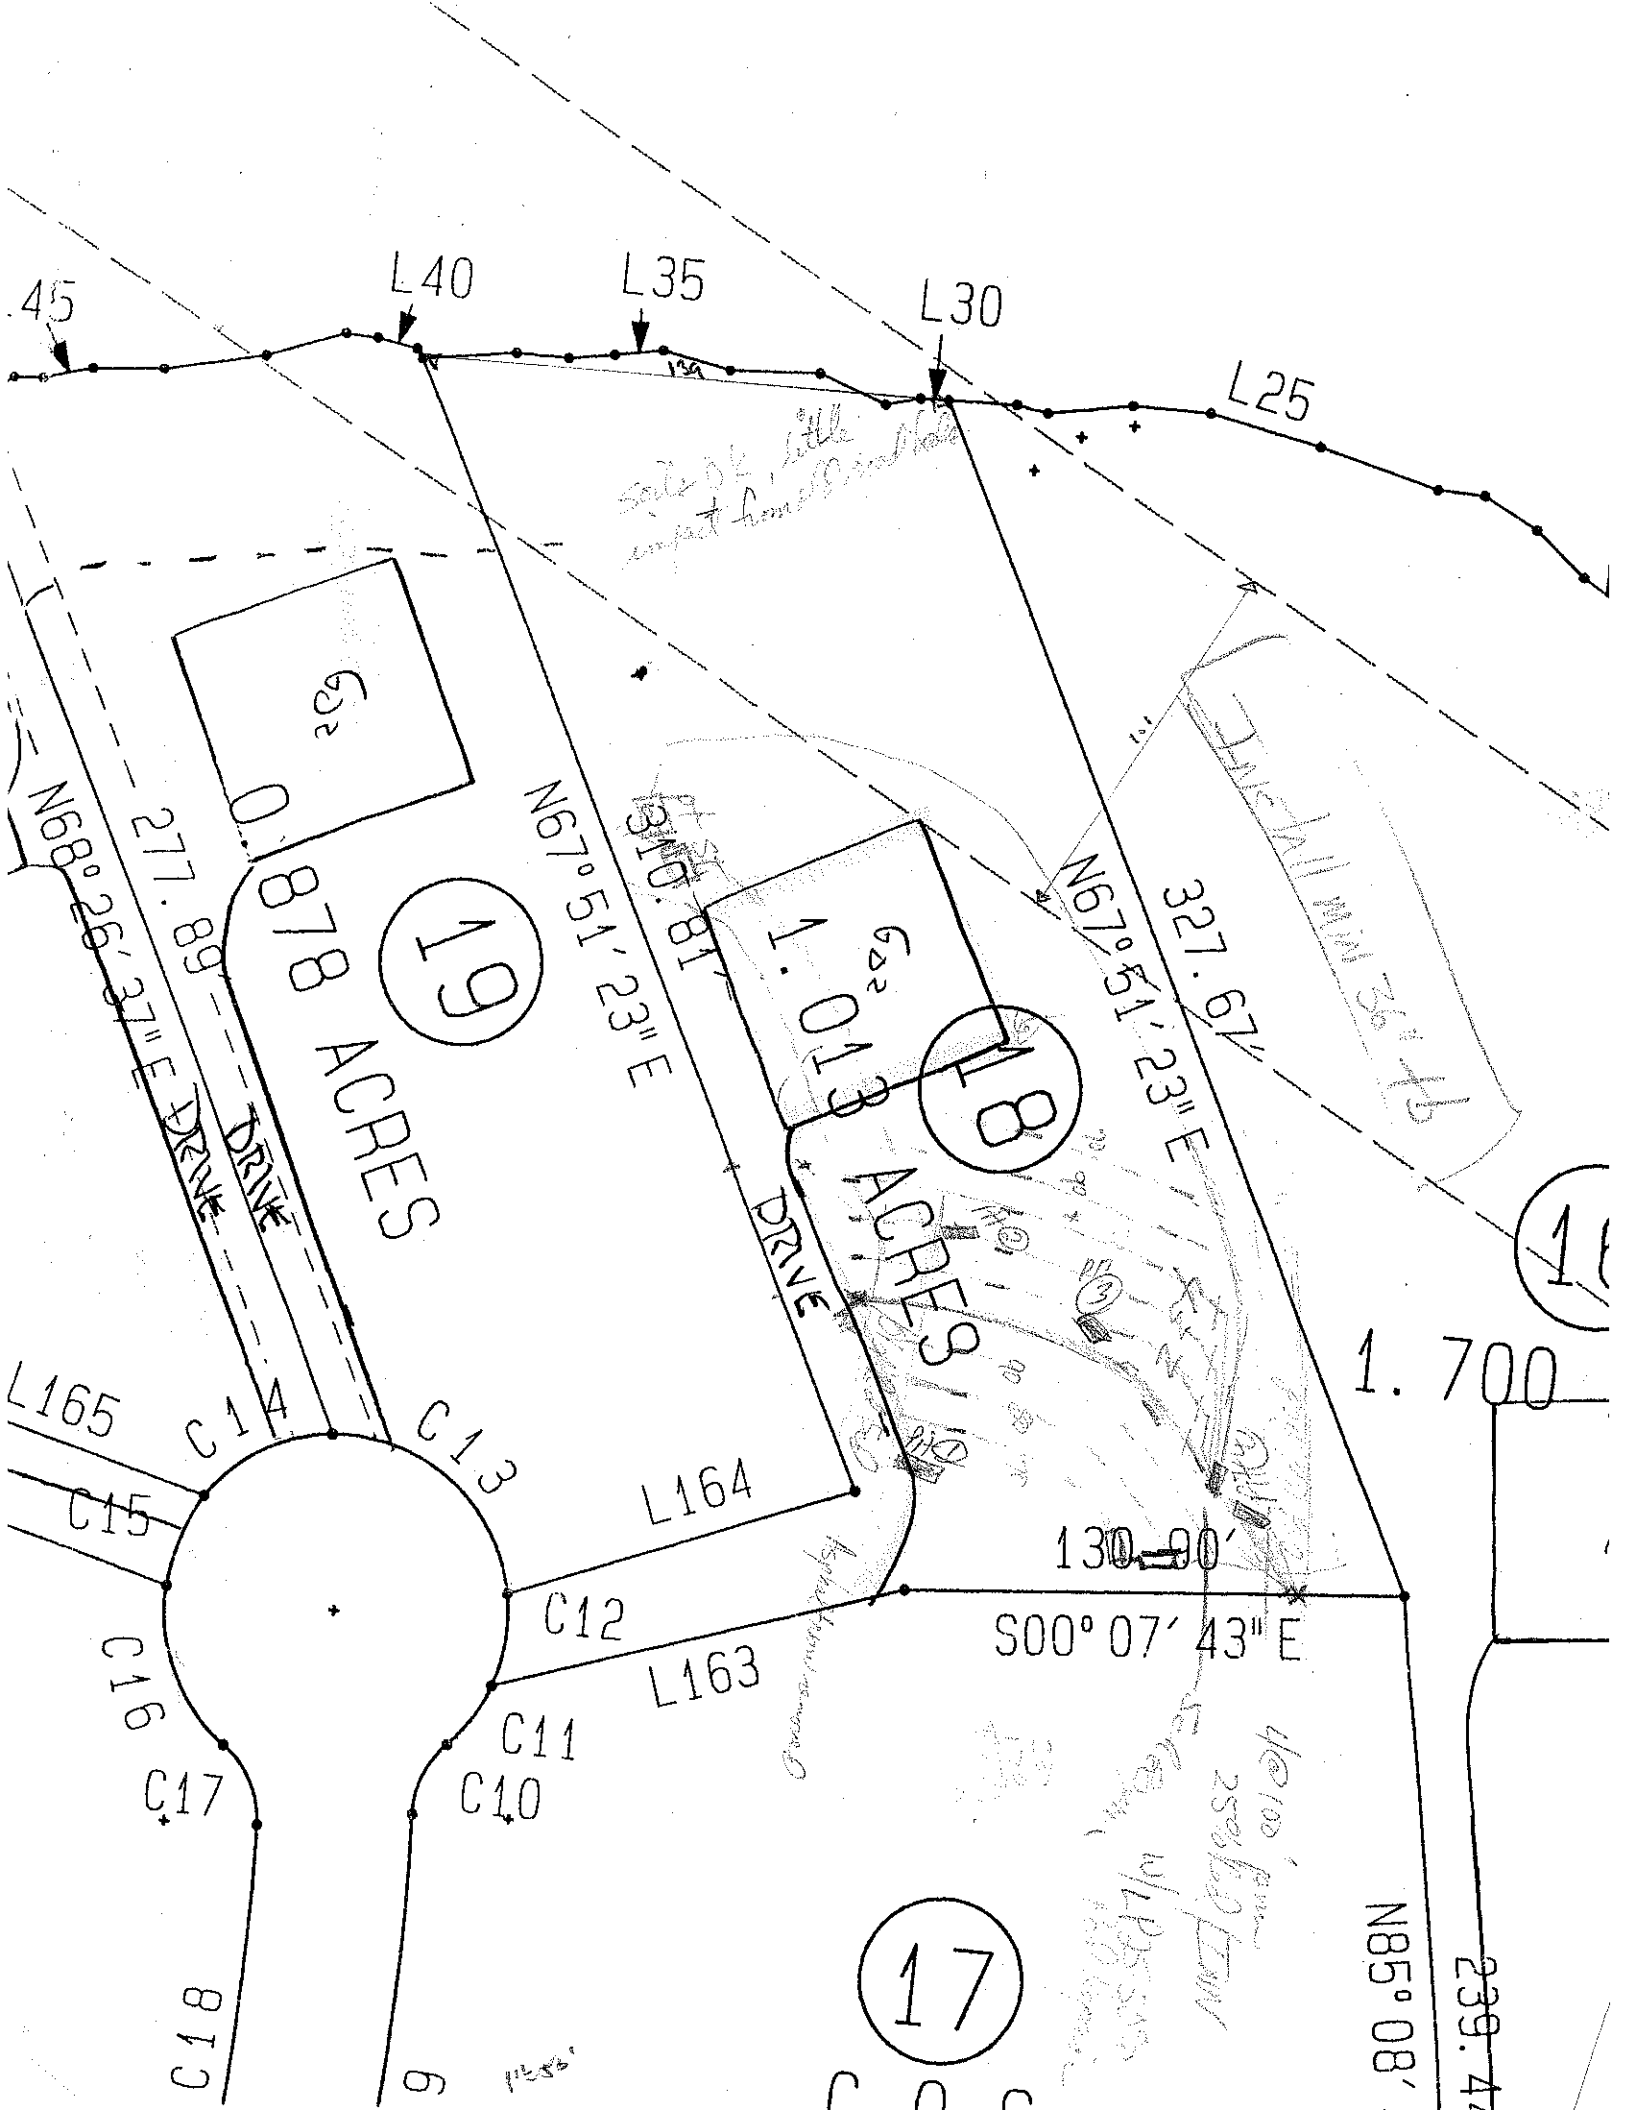
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: KT APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 10-12-98
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: Lot 18 Pinnacle Shores phase 4 PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-8	gr bnr sL	fr					PS .3
		8-33	mf SAB RC/CL	fr sss p					
		33-57	m/SAB RCL	fr sss p SP					
			few rnd						
2		0-5	gr bnr sL	fr					PS .3
		5-20	SAB rc	fr ss p					
		20-64	m/SAB RCL	fr ss p ss p					
			few fine rnd SAP						
3		0-5	gr sL	fr					PS .3
		5-17	m/SAB RC	fr ss p					
		17-68	m/SAB yr-brn CL	fr ss p					
			common fine rnd SAP						
			filled AREA 1-16" deep (old sewer pipe removed)						
4		0-6	bnr sL/sd						PS .3
		6-28	m/SAB RC	fr ss p					
		28-63	m/SAB yr CL	fr ss p					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


L45
L40
L35
L30
L25
N68°26'37"E
277.89'
DRIVE
0.878 ACRES
19
N67°51'23"E
310.81'
1.013 ACRES
18
N67°51'23"E
327.67'
1.700
L165
C14
C13
C15
L164
130.00'
S00°07'43"E
C12
C16
L163
C11
C17
C10
C18
17
N85°08'
239.4