DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

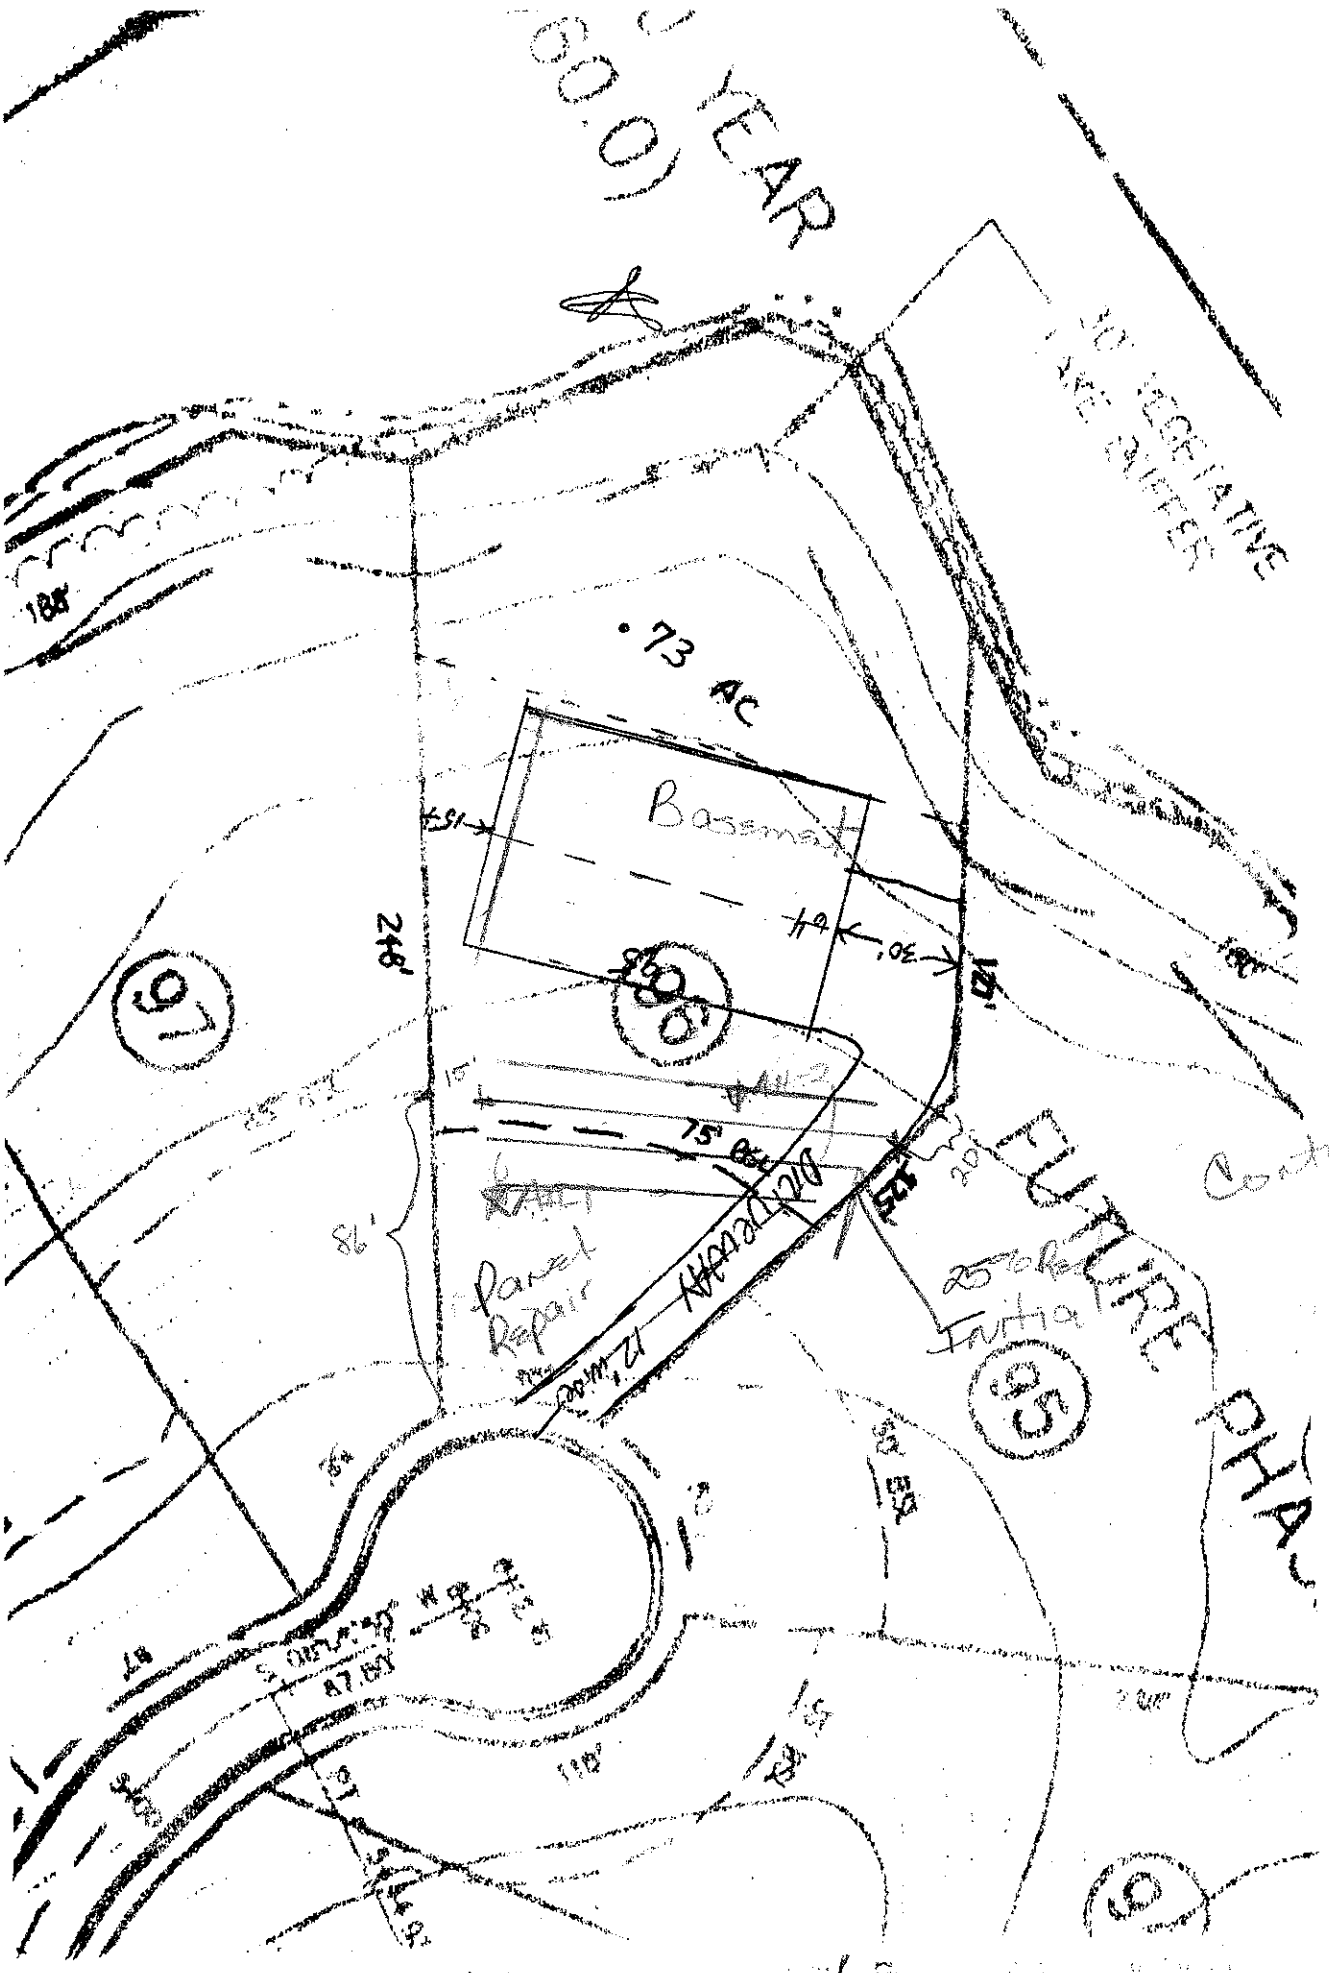
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Randy & Abby Rutkai APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 10/11/2018
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: Lot #96 Pinnacle Shores PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☒ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☒ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-10"	Brn SCL	GR/FR					PS .34
		10"-24"	Rd/Brn C	M-WSBK S-SS,SP,SE FR					
		24-40"	Rd/Brn C	WSBK SS,SP,SE FR					
			Many Yel/Brn L	SAP Indics					
		40-48	L	SAP					
2		0-10	Brn SCL	GR/FR					PS .35
		10-20	Rd/Brn C	M-WSBK S-SS, SP, SE		FI-FR			
		20-38	Rd/Brn/Yel/Brn L	WSBK SS SP SE FR					
		38-48	Yel/Brn/LFSL	SAP				w/few to many SAP Indics	
3	Pit 1	0-13	Brn SCL						PS .3
		13-38	RC M-WSBK SS,SP,SE			FI-FR			
		38-44	RC w/few to many	SAP Indics					
		44-48	L/SL	SAP					
					gets better downward				
4	Pit 2	0-6	Brn SCL						PS .3-.35
		6-15	RC M-WSBK S-SS,SP,SE			FI-FR			
		15-36	RC M-WSBK SS,SP,SE FR			Lots few to many		SAP Indics	
		36-57	Brn L/SL	SAP					
			(Ores for Pit 3)						

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____
OVER- More soil notes on back


.73 AC
Basement
Parcel Repair
Contours 85'
25' to Property Line
(6)
(7)
(8)
(9)
(10)