DEPARTMENT OF ENVIRONMENT,
HEALTH, & NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH

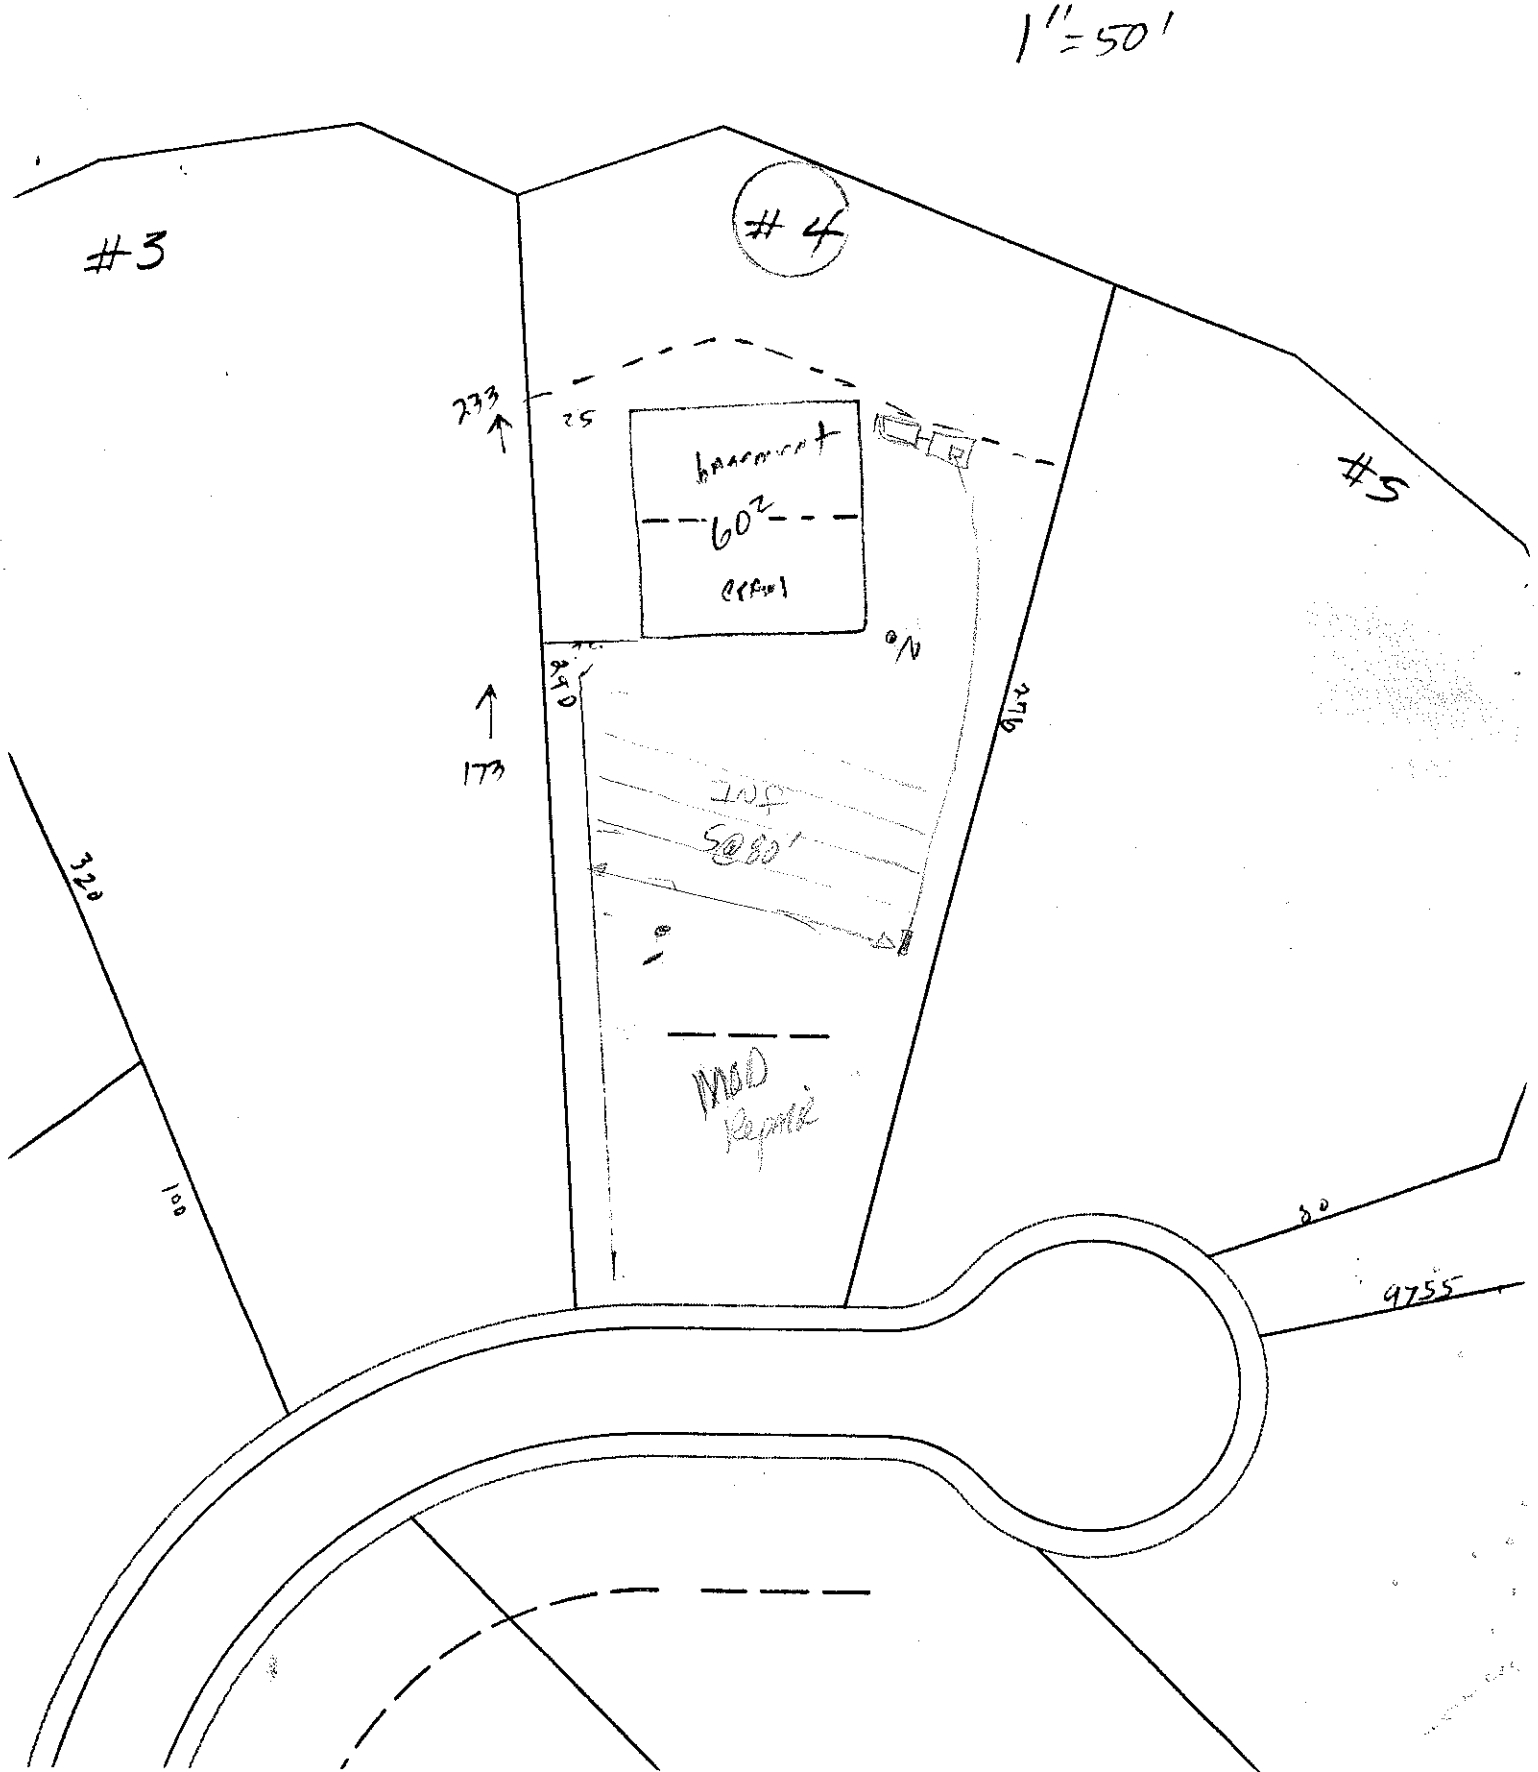
SHEET ____ OF ____
PROPERTY I.D.#: ____
PROPERTY RECORDED: ____
COUNTY: ____

SOIL/SITE EVALUATION
FOR
ON-SITE WASTEWATER SYSTEM

APPLICANT: CRI OWNER: AGENT: PHONE: ____
ADDRESS: ____ APPLICATION DATE: ____ DATE EVALUATED: 8/25/95
PROPOSED FACILITY: ____
PROPERTY SIZE: ____
LOCATION OF SITE: Lot 4, Pinnacle II
WATER SUPPLY: On-Site Well ____ Comm. Well ____ Public ____ Other ____ EVAL. METHOD: Auger Boring ✓ Pit ____ Cut ____

PROFILE #	.1940 LANDSCP POS. (%)	HORIZON DEPTH (IN.)	.1941 STRUCTURE/TEXTURE	.1941 MINERALOGY/ CONSISTENCE	.1942 WETNESS COND.	.1944 RESTRICT HORIZONS	.1948 CLASS OF HORIZ	1943/ 1956 SAPRLT CLASS.	HORIZON LTAR
1		0-11	gr - SCL	fr					.3
		11-30	MSAB- R heavy cl	fi					
		30-46+	WKSAB- CL w/ sc inclusions	fr					
2		0-6	gr- SL	fr					.3
		6-11	WKSAB R/H SCL	fr, ss, sp					
		11-38	MSAB R/H CL	fi s,p					
		38-43	MFSAB RCL Common ochreous mottles	fr ss sp					
3									
4									
5									

AVAILABLE SPACE (.1945) ✓ SITE CLASSIFICATION (.1948): ____ SITE LONG-TERM ACCEPTANCE RATE: ____
EVALUATED BY: DRT OTHER(S) PRESENT: ____
COMMENTS: ____


1" = 50'
#3
#4
#5
basement
60²
crawl
233
25
173
320
100
275
N/O
IWP
5@60'
MSD
Repair
9755