DEPARTMENT OF ENVIRONMENT,
HEALTH, & NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH

SHEET____OF____
PROPERTY I.D.#:_____
PROPERTY RECORDED:_____
COUNTY:_____

SOIL/SITE EVALUATION
FOR
ON-SITE WASTEWATER SYSTEM

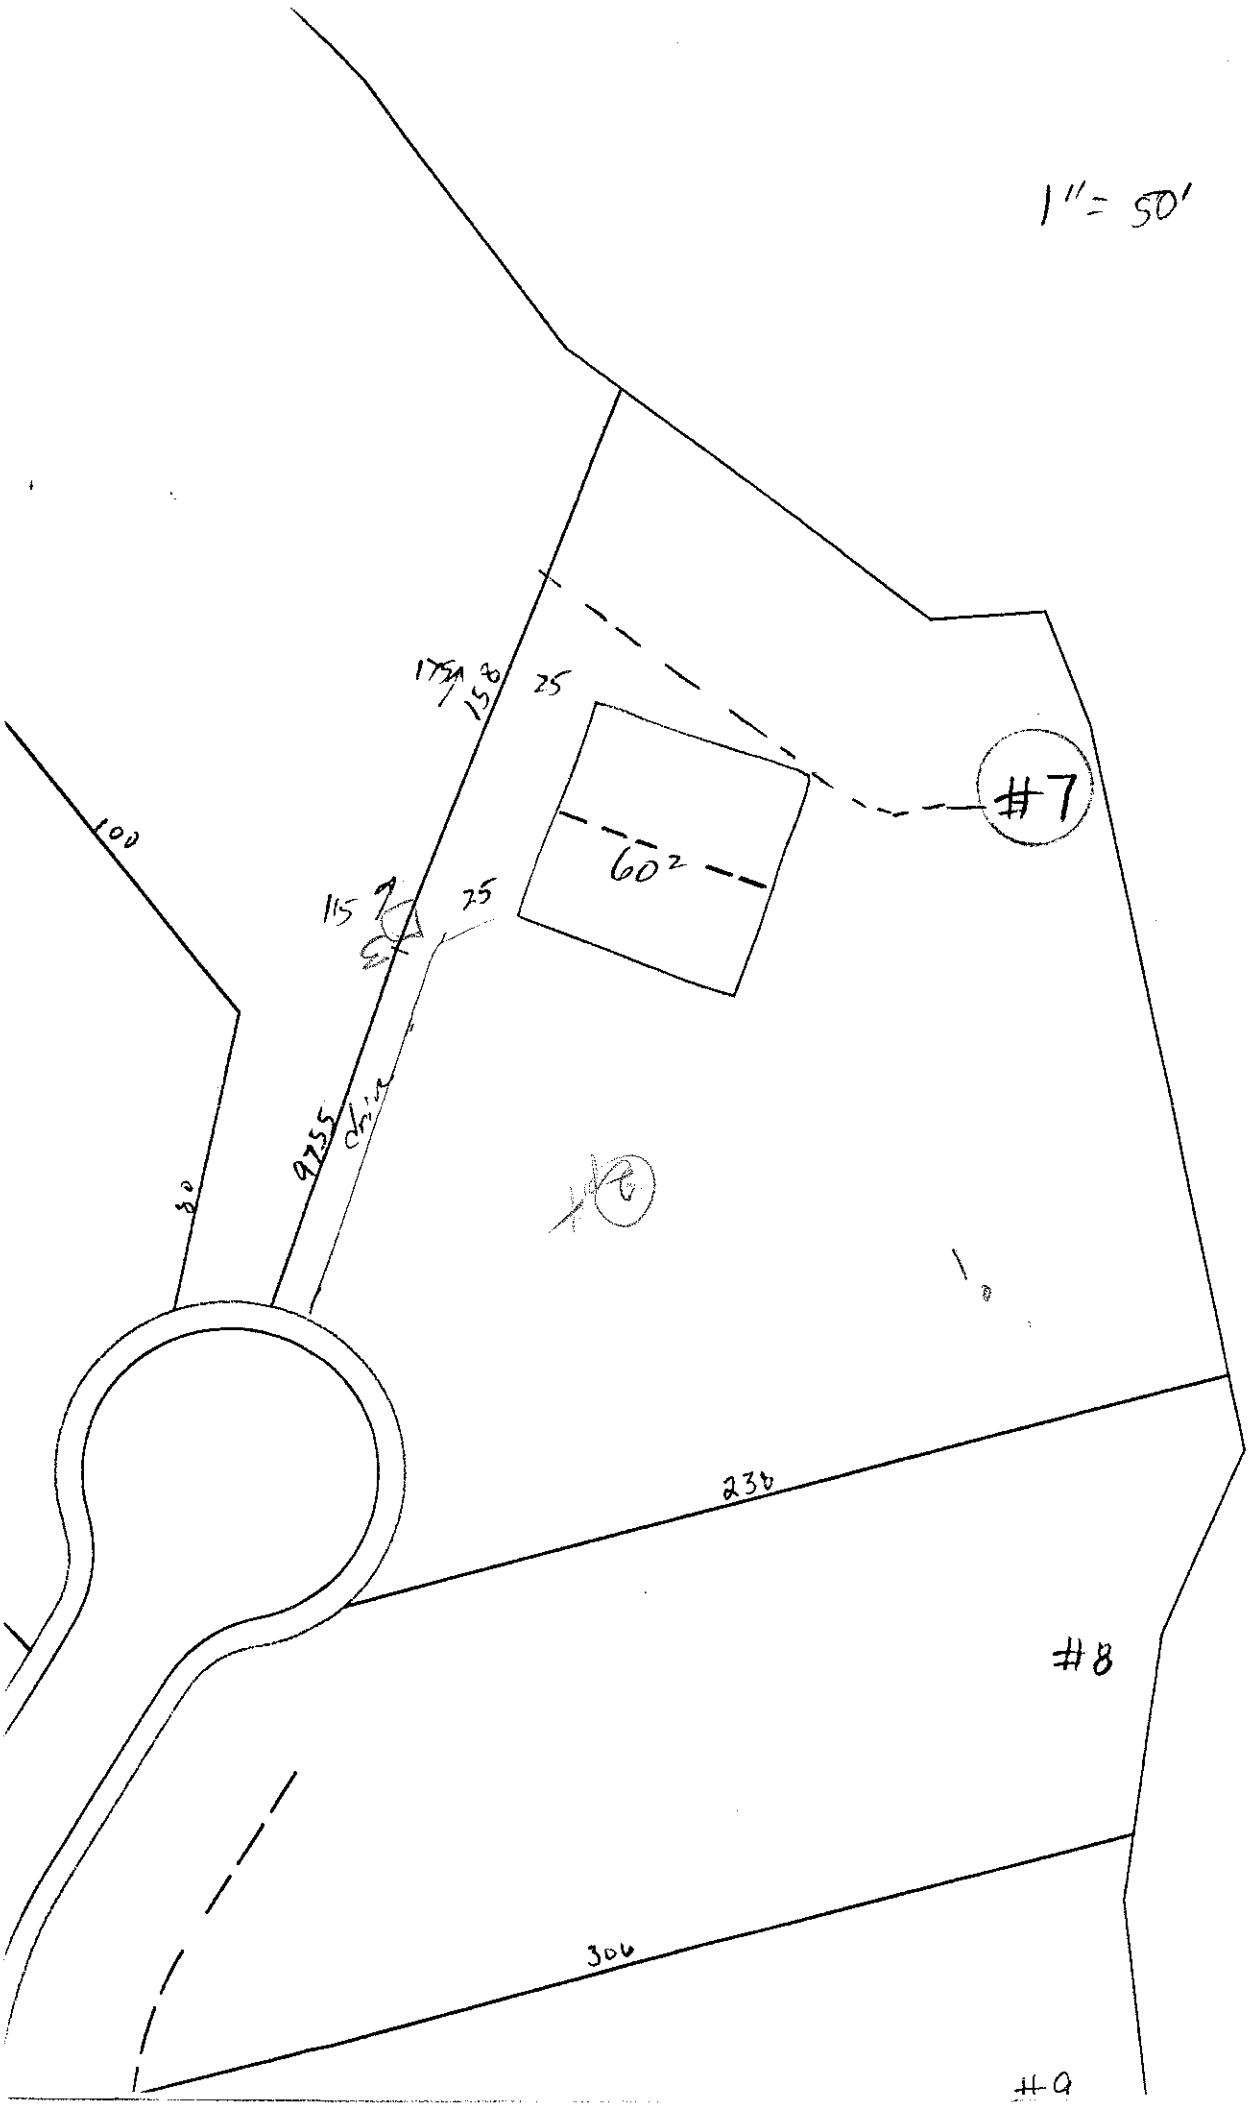
APPLICANT: CRI OWNER:__AGENT:__ PHONE:_____
ADDRESS:_____ APPLICATION DATE:_____ DATE EVALUATED: 8/21/95
_____ PROPOSED FACILITY:_____
_____ PROPERTY SIZE:_____
LOCATION OF SITE: Lot 7, Pinnacle Shores II
WATER SUPPLY: On-Site Well____Comm. Well___Public___Other_____ EVAL. METHOD: Auger Boring ✓ Pit___Cut___

PROFILE #	.1940 LANDSCP POS. (%)	HORIZON DEPTH (IN.)	.1941 STRUCTURE/TEXTURE	.1941 MINERALOGY/ CONSISTENCE	.1942 WETNESS COND.	.1944 RESTRICT HORIZONS	.1948 CLASS OF HORIZ	1943/ 1956 SAPRLT CLASS.	HORIZON LTAR
1	LSS	0-10	gr brn SL	fr					
		10-31	mottled yb scl	fr ss sp					
		31-42	wk subsb scl (sap)	fr	ss sp				
2 P1		0-10	wk sbk SL/scl	fr, ss sp					
		10-40	mm sbk C	fr, ss sp					
		40-56	sap - w/ gray mottles						
3 P1		0-10	SL/scl						
		10-36	m sbk scl/cl	fr ss sp					
		36-68	m-wk sbk scl	fr - ss sp (sap)					
4									
5									

AVAILABLE SPACE (.1945)_____ SITE CLASSIFICATION (.1948):_____ SITE LONG-TERM ACCEPTANCE RATE:_____

EVALUATED BY:_____ OTHER(S) PRESENT:_____

COMMENTS:_____


1" = 50'
175
150
25
#7
60²
100
115
25
9255
drive
30
238
#8
306
#9