09984

III
4628821097

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Daniel Rizzardi DATE April 18, '90 PERMIT NO. 2N-3-A302

PHONE: Business ______ Home ______

LOCATION 150 W TR Waddell Rd (1438) on left 2 houses before end S. R. No. ______


SUBDIVISION NAME CLT LAKE NORMAN LOT NO. 302 SECTION OR BLOCK NO. 11

House (✓) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 3 No. Bathrooms 2½
Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site ~~Suitable~~ PS Yes (✓) No ( )
Lot Area 20000 ft² +

Character & Porosity of Soil PS clay
Percolation Rate ~0.35
Topography ~6%
Depth to Water Table 44"
Rock or other impervious formations none obs.

✓ Basement with Plumbing ______ Basement without Plumbing ______ No Basement

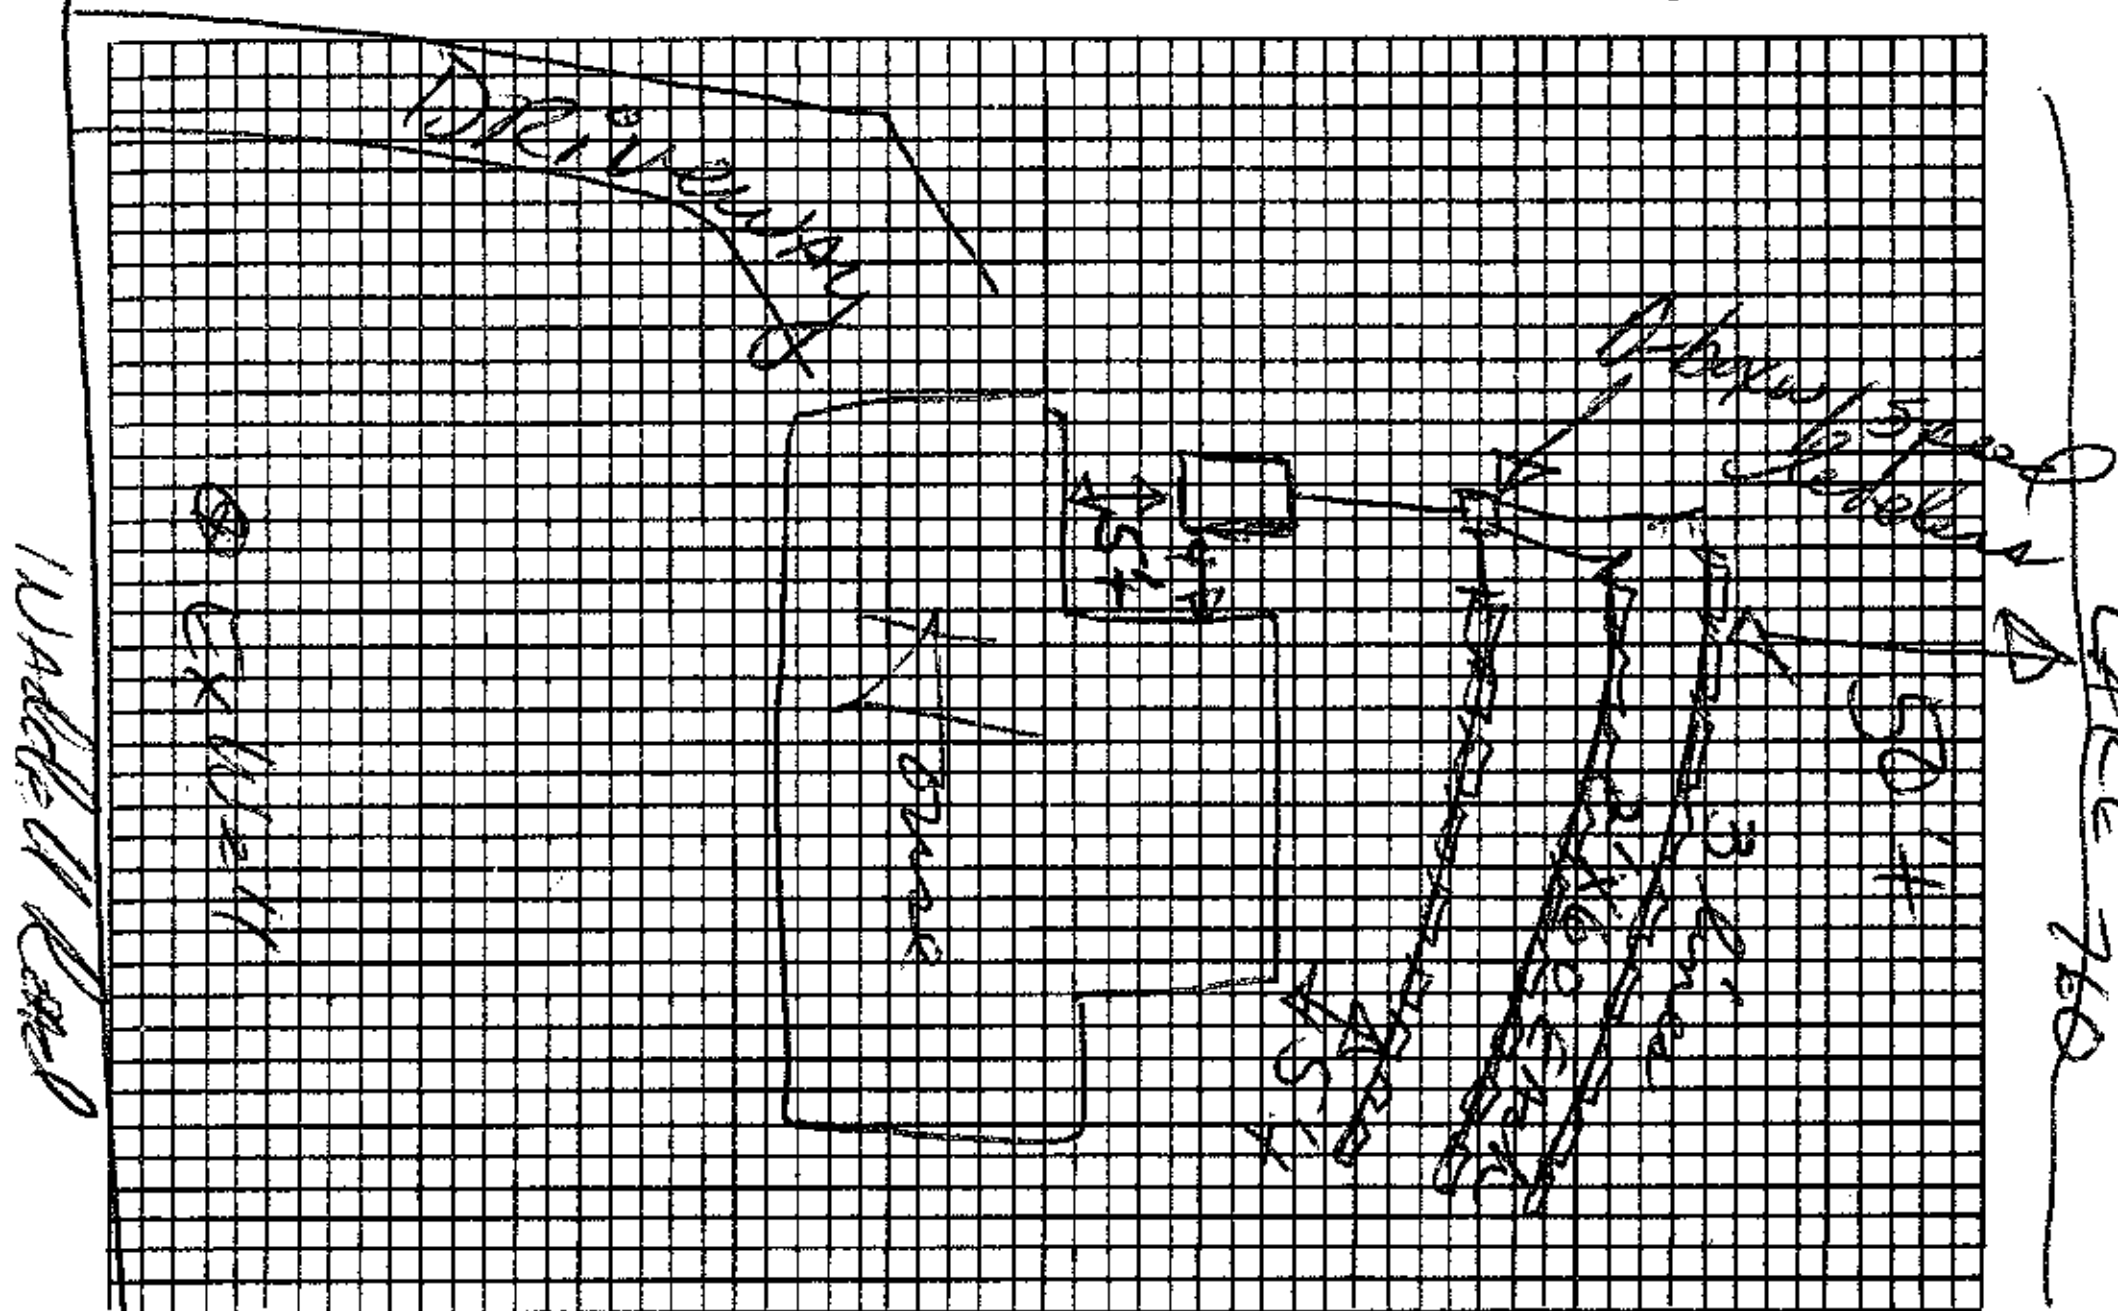

Plot of System

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 3
Sq. Ft. ______ Linear Ft. 180 ft
Depth of Stone in Lines 16" T&B
Water Supply: Individual (✓) panels gravity flow
Public ( )

Installed by Don Innes

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

IMPROVEMENTS PERMIT BY ACP

COMMENTS: Pipe off gutter drains & provide good surface drainage around sewage system

CERTIFICATE OF COMPLETION BY DR Hinson, EHS DATE 4-18-90

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

III

4628821097

09984

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Daniel Rizzardi/Robert Mowat DATE April 15, '90 PERMIT NO. 2N-3-A302

PHONE: Business _____ Home _____

LOCATION 150 W TR Waddell Rd (1438) on left 2 homes before end S. R. No. _____

SUBDIVISION NAME CLOT LAKE NORMAN LOT NO. 302 SECTION OR BLOCK NO. 11

House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2½

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site ~~Suitable~~PS Yes (✓) No ( )

Lot Area 20000 ft²

Character & Porosity of Soil PS clay


Percolation Rate 20 35

Topography 2% to 4%

Depth to Water Table 4'+

Rock or other impervious formations none obs.

_____ Basement with Plumbing _____ Basement without Plumbing No Basement

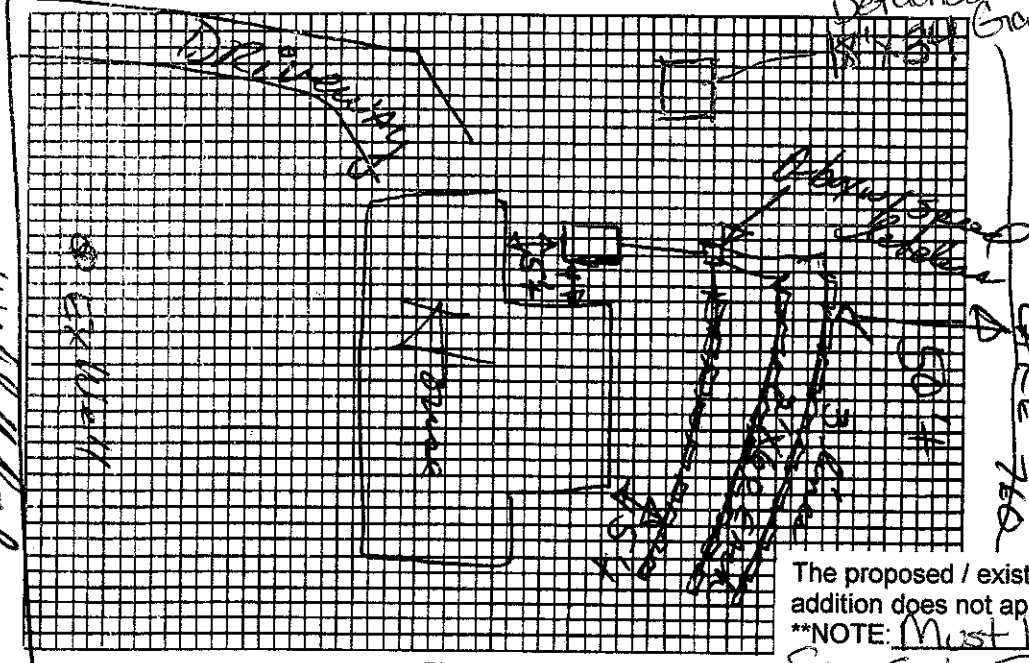

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. _____ Linear Ft. 150 ft

Depth of Stone in Lines 16" ft

Water Supply: Individual (✓) gravity flow

Public ( )

Installed by Don Innes

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

The proposed / existing Detached Garage addition does not appear to impact the existing septic system.

**NOTE: Must keep Bldg at least 5ft from Septic

Date: 10/20/2010

REHS

ICHD-Environmental Health Division

IMPROVEMENTS PERMIT BY ACP

COMMENTS: Pipe 5 ft gutter drains & provide good surface drainage around crawl spaces.

CERTIFICATE OF COMPLETION BY _____ DATE 4-18-90

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold