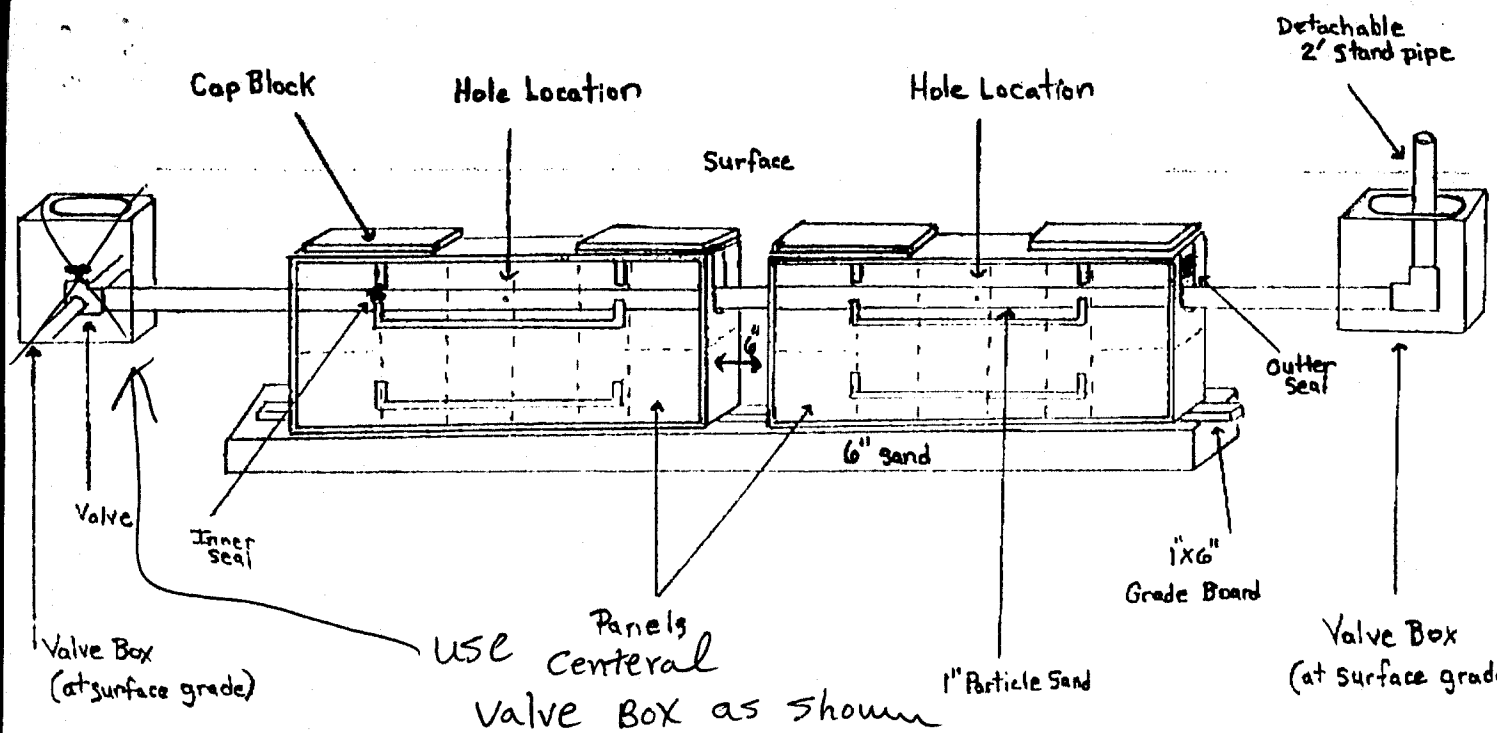


use centeral Valve Box as shown on Improvements Permit.

Pressure Dosed PPBPS

# of panels 46.
Size holes 3/16". 1 hole per panel.
Approximate amount of sand needed 33 Tons
100 lbs. of partical sand per 8 panels.
Sidewalls raked and limed.
GPM 30.
TDH 25.

Comments

08/25/98 TUE 09:40 FAX 704 454 5114 CCHD FIRST FLOOR 002