IREDELL COUNTY HEALTH DEPARTMENT

Statesville Office (704) 878-5305 Mooresville Office (704) 660-3625 PERMIT # 206090

IMPROVEMENT PERMIT / AUTHORIZATION TO CONSTRUCT / OPERATION PERMIT / EXISTING SYSTEM

PIN # 4629592779

APPLICANT: Mark Pope APPLICANT ADDRESS: P.O. Box 1363 Troutman NC 28166

SITE ADDRESS: 151 Eagle Chase Ln Troutman NC 28166 PHONE: 704-902-2000 ALT. PHONE: 704-902-6554

SITE DIRECTIONS: Perth Rd T/R State Park Rd T/L on Wildlife T/R Sierra Woods T/L Deer Run Dr T/R Eagle Chase


SUBDIVISION: Wildlife Bay SECTION: P1 LOT # 45 LOT AREA: 1.06 ac DESIGN FLOW: 100 L.T.A.R.: 0.25

Septic Tank	1000 (gal)	STB	1012	Date	9-29-14	[X] New System [ ] Repair [ ] Expansion	System Type: I II [III] IV V VI	[ ] Residence	No. Bedrooms / Bathroom
Pump Tank	N/A (gal)	PT	N/A	Date	N/A	System Description:	25% Reduction	[ ] Business	No. Persons
Pump Make	N/A	Model	Tuffline	Serial #	EE-4	Repair System Description:	25% Reduction	[X] Other Garage	No. Employees
# Nitrification Fields	1	# Lines	3	Linear Ft:	162'	Maintenance Agreement Required:	[ ] YES [X] NO	[X] Slab	[ ] Crawl Space
Trench Width	36"	Max. Trench Bottom Depth	20"	Gravel Depth	N/A	[X] GRAVITY	[ ] PRESSURE	[ ] Basement w/plumbing	[ ] Basement w/o plumbing


Water Supply: [ ] Private [ ] Public [X] Community

Comments / Conditions: Install 25% reduction on contour with serial distribution. Maintain 20' from existing system with any part of STS. If existing pump line is crossed with drive must be >30" below or sleeved in ductile Iron.

INITIAL SITE SKETCH

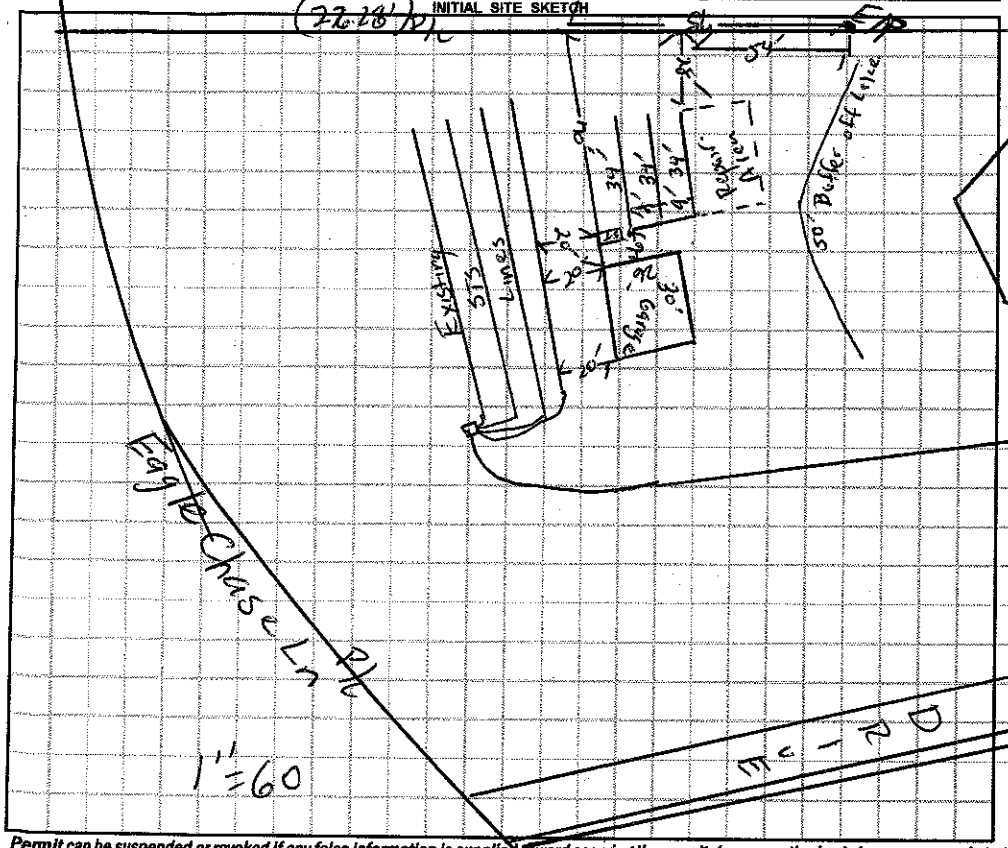

AS BUIL

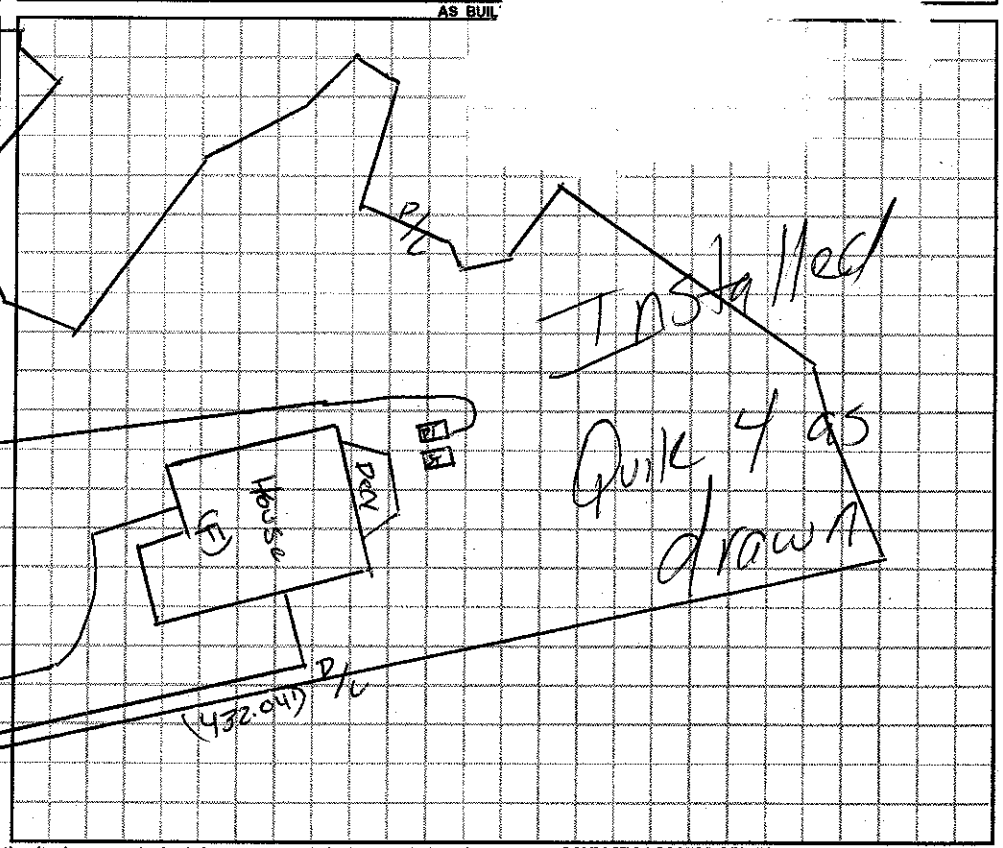

Permit can be suspended or revoked if any false information is supplied toward securing the permit / any unauthorized changes are made to the site / any unauthorized changes are made in the installation of the system. **CONTACT A LOCATOR SERVICE PRIOR TO ANY EXCAVATION**

[ ] **IMPROVEMENT PERMIT** *with plat valid without expiration.* [X] **IMPROVEMENT PERMIT** *with site plan valid for 60 mos.* [X] **AUTHORIZATION TO CONSTRUCT** *valid for period equal to IMPROVEMENT PERMIT--not to exceed 60 mo.*

Owner / Applicant Signature: D. Mark Pope Date: 12/3/14 Installed by: Young's Septic

IMPROVEMENT PERMIT by: Date: 10/29/14 OPERATION PERMIT by: Date: 05/07/15

AUTHORIZATION TO CONSTRUCT by: Date: 12/03/14 Existing System Inspected by: Date:

Health Dept. Copy - WHITE Applicant (Final Approval) - YELLOW Applicant (Conditional Approval) - PINK