DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

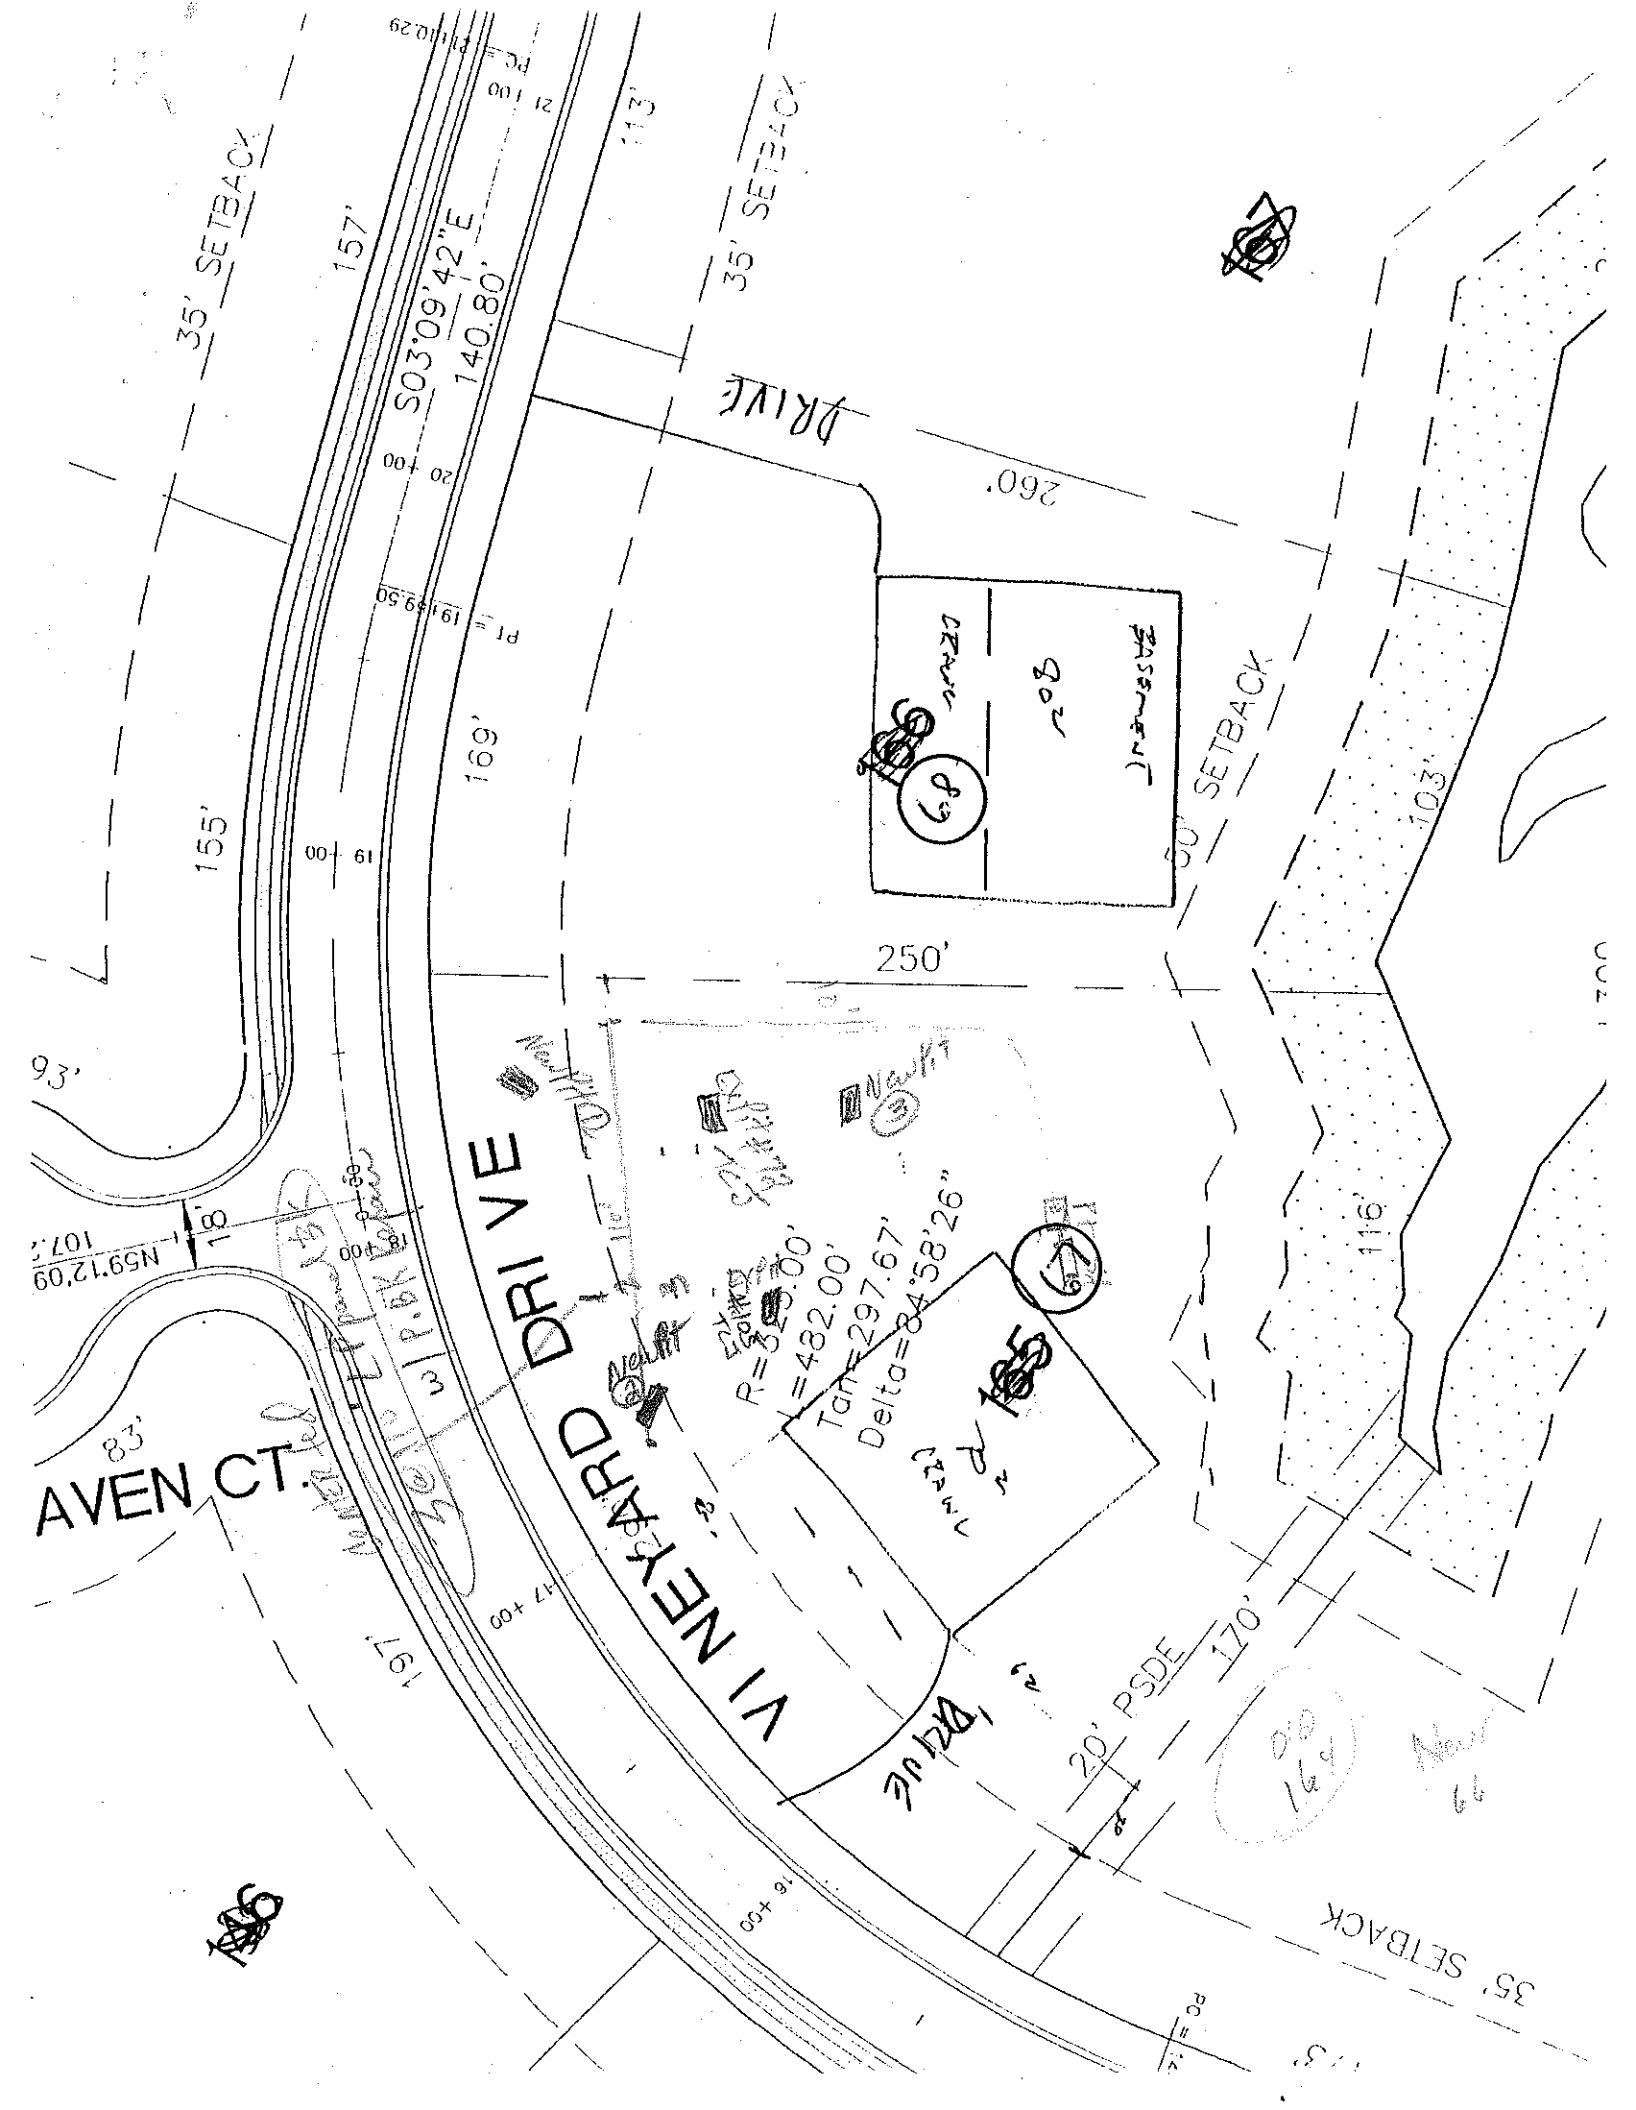
OWNER: CRI APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 4-21-98
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: lot 67 The Point PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

Now Lot 166

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-22	SAB RC/cl	fr sp sss p soap					PS .25 @ 42"
		22-42	w/c SAB red	fi sss p soap/mod sap/wr					
		42-48	hard wr						
2		0-48	SAB R-rbrn/cbl	fi sp soap					PS .25-.3
			few manganese coatings, ig-bar mottles						
3		0-22	gr-wk SAB RBRN-brn	scl fr					PS .25-.3 @ 38"
		22-38	SAB R c/cl	fr sp soap					
		38-49	wr/sap/soil mix						
4	#72 TOO	0-28	mn SAB RC	fr fi sp					PS .2-.25
		28-40	limb mn rock/sap						
	#105 TOO	0-27	wk-mod gr c	fr s-sp					
		27-48	mn SC	fi s-sp					
			common coarse silica						

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


35' SETBACK
157'
S03°09'42"E
140.80'
35' SETBACK
113'
DRIVE
260'
169'
155'
50' SETBACK
103'
250'
93'
N59°12'09"
107.2'
83'
AVEN CT.
VI NEYARD DRI VE
R=530.00'
=482.00'
Tan=297.67'
Delta=54°58'26"
20' PSDE
170'
35' SETBACK