DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

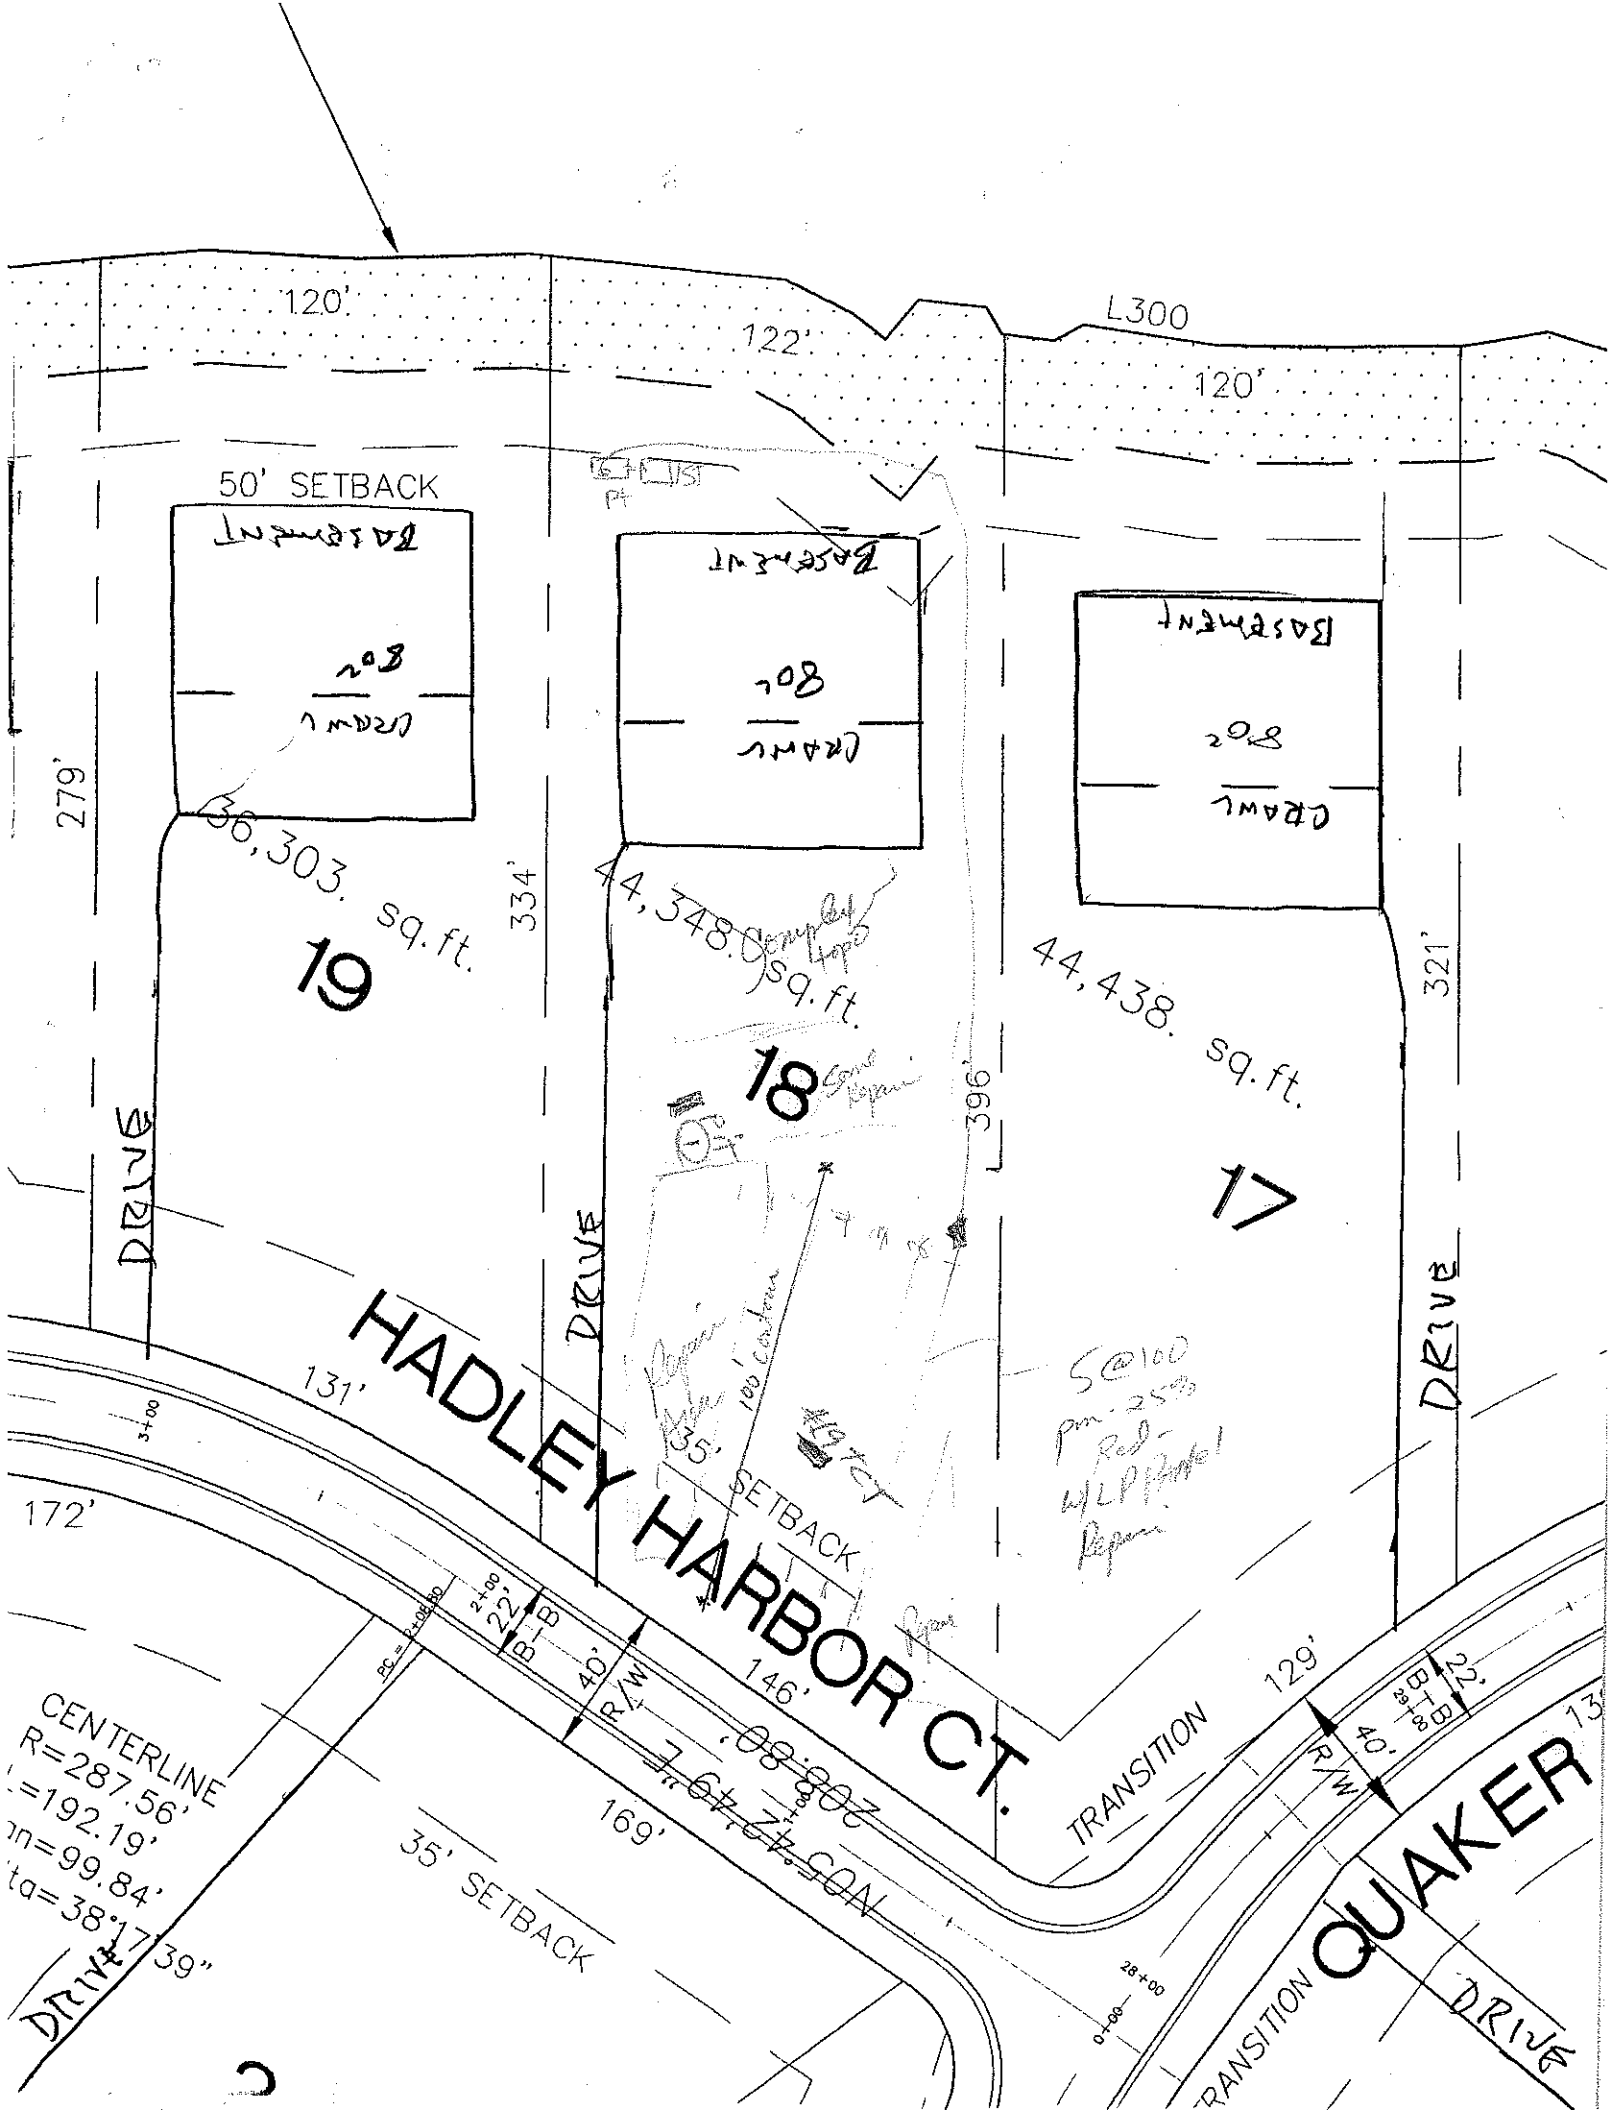
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: ORT APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 9-17-98
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: Lot 18 Place 1 Theft PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		06	bwsbk						PS .3
		6-30	m fri RC	fsp					
		30-49	SBK cl	fi sscp fsl mi sscp					
2	#19 XCS	0-8	gr bwsbk fsl						PS .25
		8-42	m fri RC	fi sp					
			Sandy Saprolite						
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


120'
122'
L300
120'
50' SETBACK
279'
334'
396'
321'
36,303. sq. ft.
19
44,348. sq. ft.
18
44,438. sq. ft.
17
DRIVE
DRIVE
DRIVE
HADLEY HARBOR CT.
131'
172'
35' SETBACK
146'
129'
TRANSITION
40' R/W
22'
169'
35' SETBACK
CENTERLINE
R=287.56'
=192.19'
n=99.84'
ta=38°17'39"
QUAKER
DRIVE
TRANSITION