DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

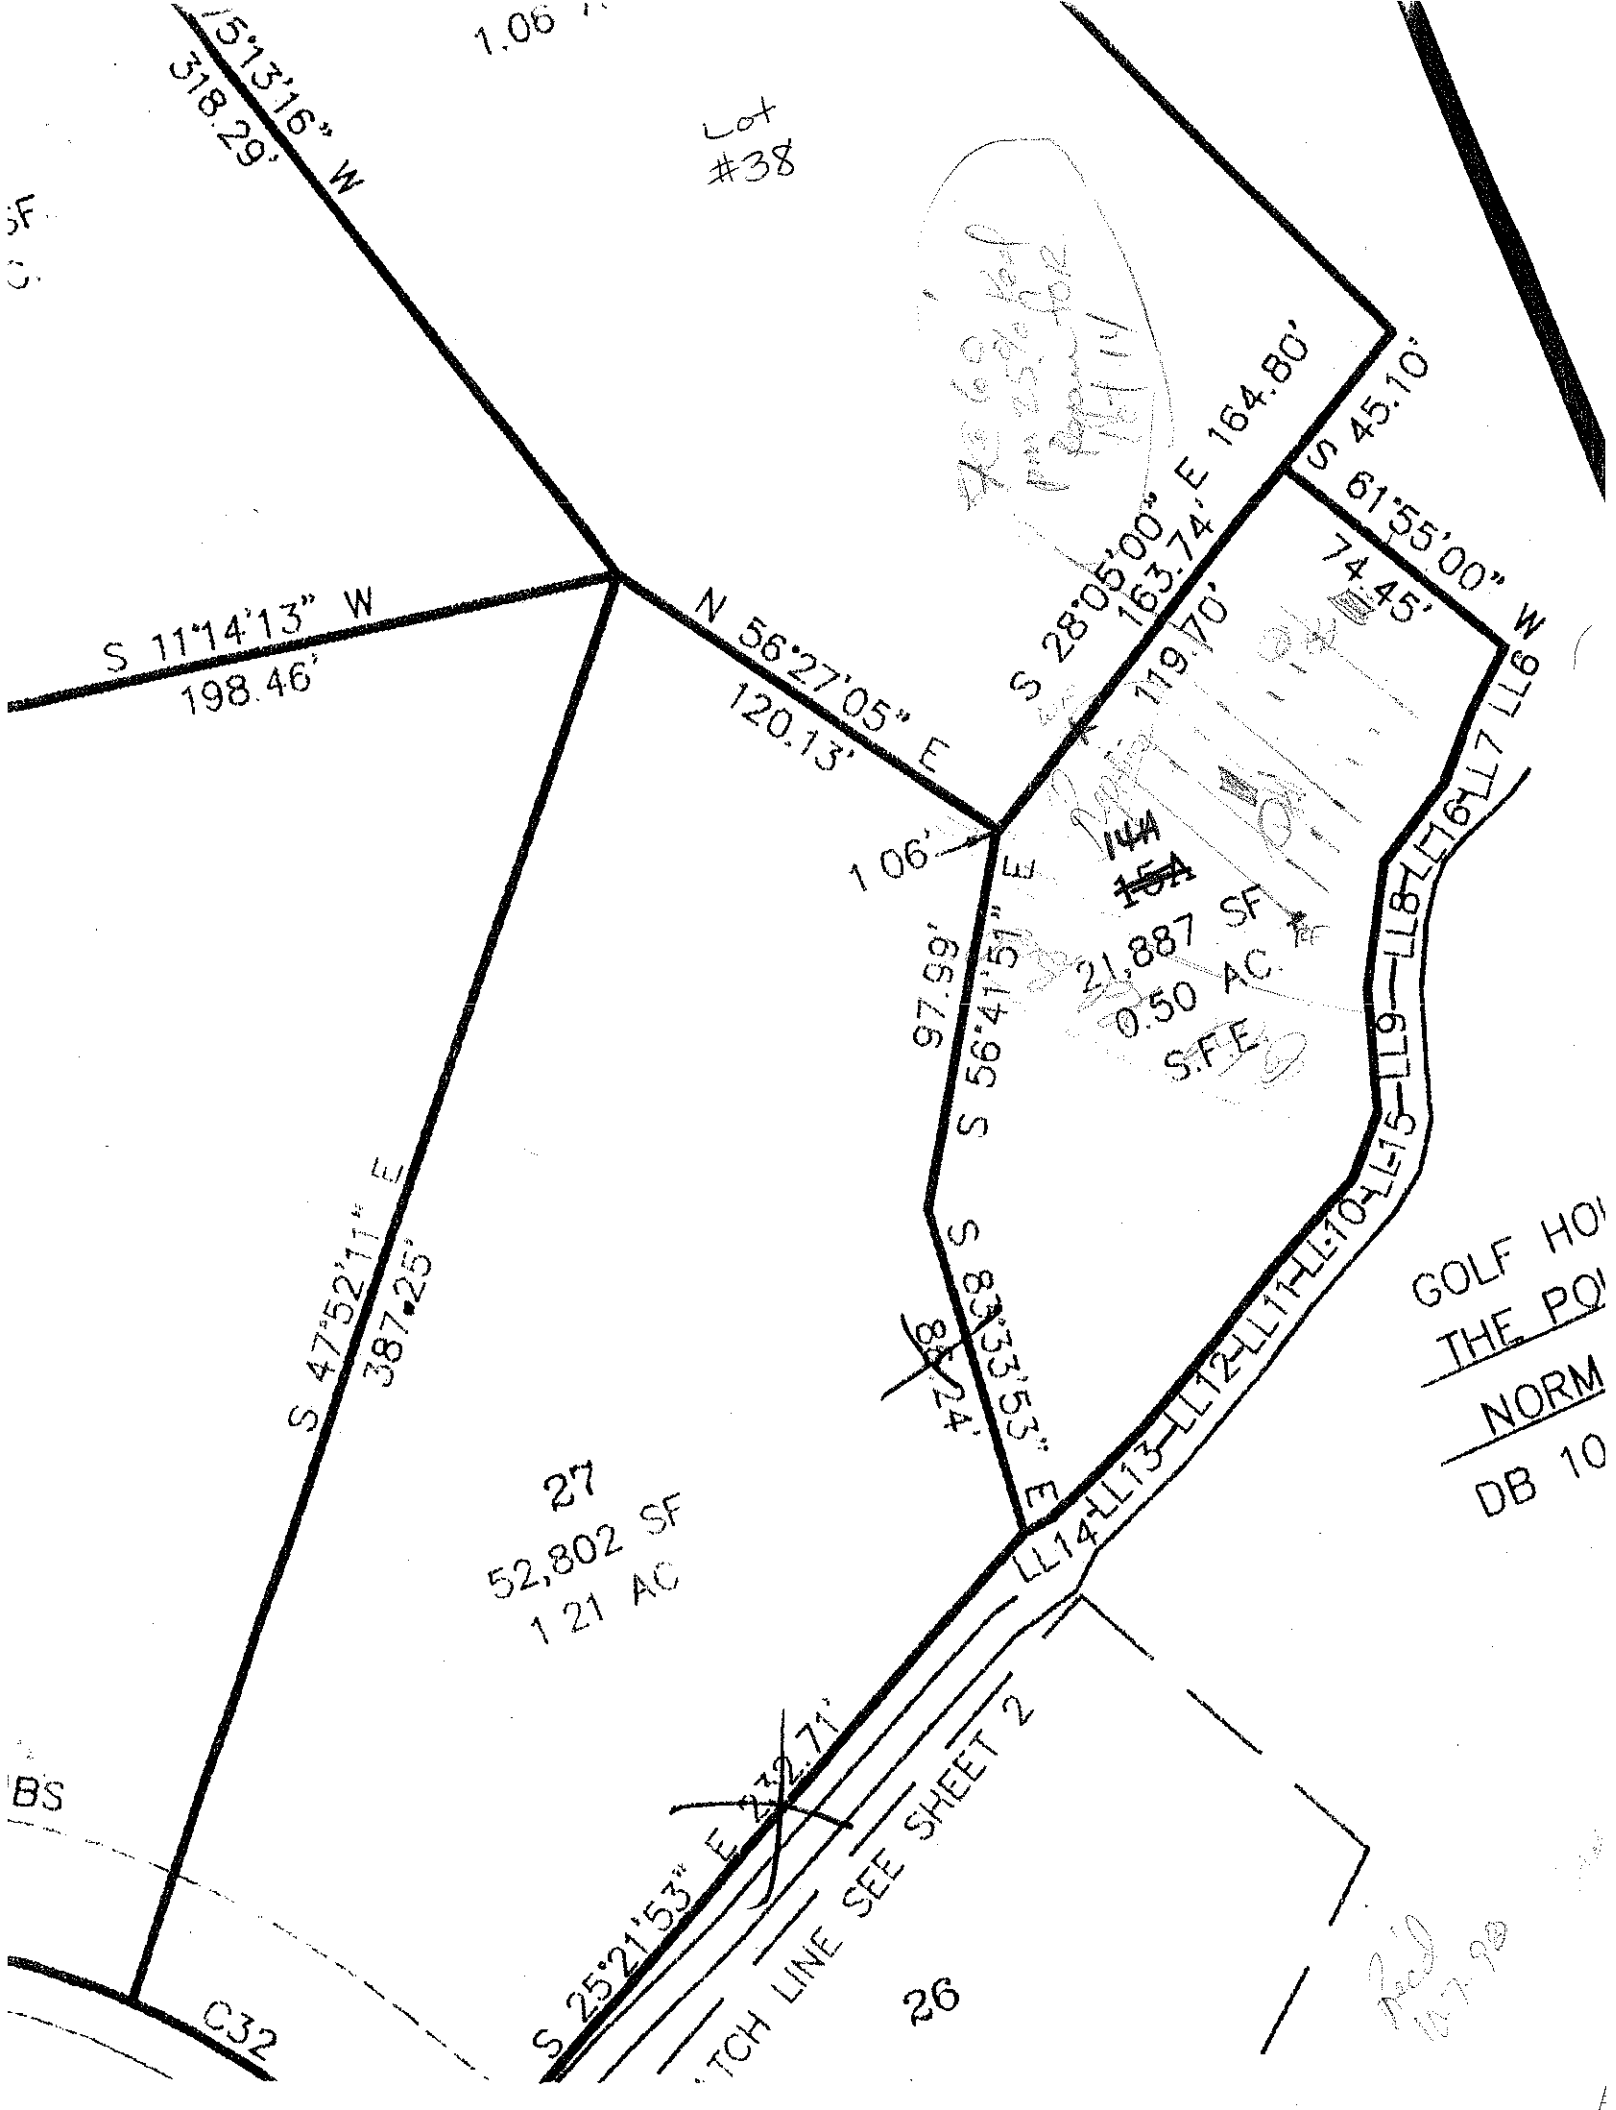
OWNER: CRS APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 9-18-96
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: lot 14 phase IC The 84 PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

Pit #5 0-20" stonier and rib - L sp - [illegible] PS
Pit #6 0-3" gravelly fsl / 3-19" sbk rc-cl ; 19-31 [illegible] 31-60 sl/l sap

PROFILE #	1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-24	sbk rc						PS 1.25-.3
		24-49	sbk grsl						
			common med Sap						
2		0-9	gr loamy sl	fr					PS 3
		9-27	sbk rc	fr Sap					
			[illegible] rock	[illegible]					
			common med Sap						
3		0-9	[illegible] brn sl/scl			U		U	U
		9-18	massive brnc	vfi-fi exp					
		18-43	wh / Sap						
			RVERY H2O Pit						
4		0-12	brn scl/c						
		12-31	mott-brn/wh/c	vfi-fi exp		U		U	U
		31-46	mott-brn/wh/c / Sap						

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


Lot
#38
S 13'16" W
318.29'
S 11°14'13" W
198.46'
N 56°27'05" E
120.13'
S 28°05'00" E 164.80'
163.74'
119.70'
S 45.10'
S 61°55'00" W
74.45'
1.06'
S 56°41'51" E
97.59'
S 83°33'53" E
88.24'
144
15A
21,887 SF
0.50 AC.
S.F.E.
S 47°52'11" E
387.25'
27
52,802 SF
1.21 AC
LL14-LL13-LL12-LL11-LL10-LL9-LL8-LL7 LL6
S 25°21'53" E 232.71'
MATCH LINE SEE SHEET 2
26
C32
GOLF HO
THE PO
NORM
DB 10