14011

IREDELL COUNTY HEALTH DEPARTMENT

IMPROVEMENT PERMIT AND CERTIFICATE OF COMPLETION / OPERATIONS PERMIT

OWNER OR CONTRACTOR MI Homes DATE 2/18/92 PERMIT NO 26-23-A-38

PHONE: Business ______ Home 542-7469

LOCATION Isle of Pines Rd., TR into Pinedale, to last lot on (L) on cul'de sac. S.R. No. ______

SUBDIVISION NAME Pinedale LOT NO. 38 SECTION OR BLOCK NO. ______

House ☑ Mobile Home ☐ Business ☐ Other ______

No. Bedrooms 4 No. Bathrooms 2.5

Garbage Disposal Unit Yes ☐ No ☑

Auto. Dishwasher Yes ☑ No ☐

Auto. Wash. Machine Yes ☑ No ☐

Lot Area 20,000 FT²

Soil Characteristics P - scl / sic + transition


Application Rate .3

Topography 2-4%

Depth to Water Table > 48"

Rock or other impervious formations None observed

______ Basement with Plumbing ______ Basement without Plumbing ✓ No Basement ✓ Crawl Space

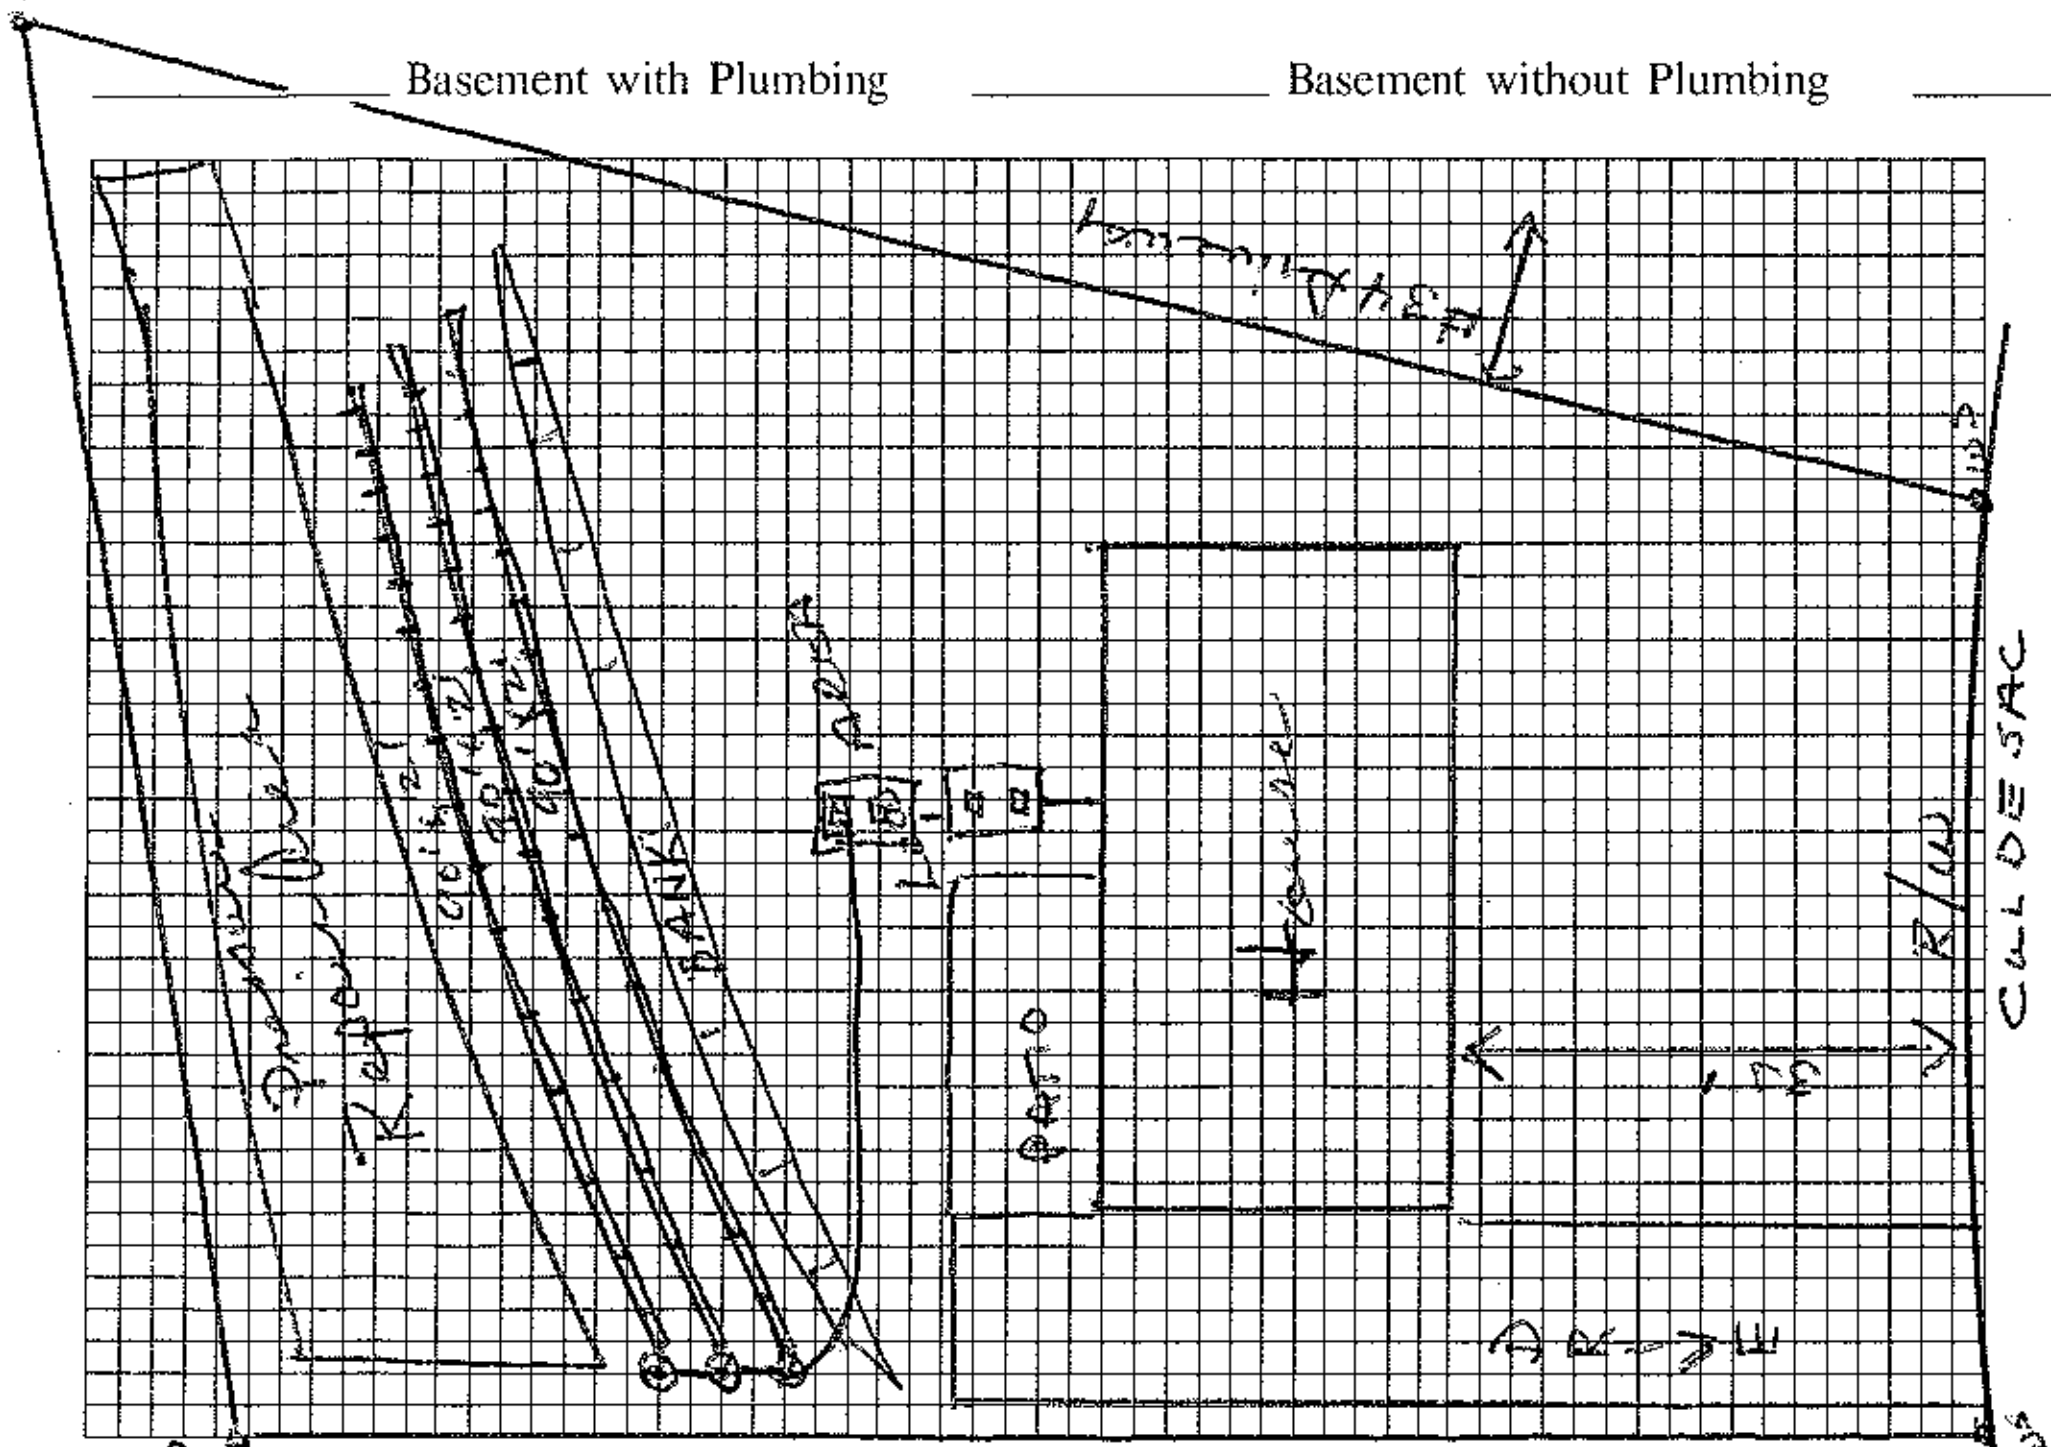

Plot of System (Not to Scale)

Size of Tank PT 1000 / ST 1000 Gals.

Nitrification Field:

No. of Lines 3 @ 90' x 2'

Sq. Ft. 1600 Linear Ft. 270

Depth of ~~Stone~~ in Lines 6" SAND

Water Supply: Individual ☐ Public ☑ COMM SYSTEM

Installed by ______

I understand and agree to install a septic tank system as specified on this Improvement Permit.

Signed: [signature]

(IMPROVEMENT PERMIT IS VALID FOR 60 MONTHS FROM DATE OF ISSUE.)

IMPROVEMENT PERMIT BY Wesley Sparks R.S.

COMMENTS 16" Pressure Distribution Prefab. Permeable Panel Drainfield. Lines installed as drawn with gate valves at beginning of each line. 1 1/4" PVC through panels with one 3/16" hole drilled per panel, hole turned down. 2' pressure head at end of each lateral. 38 GPM minimum pump capacity.

CERTIFICATE OF COMPLETION BY ______ DATE ______

EXISTING SYSTEM CHECKED BY ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS

Permit is VOID if any unauthorized changes are made in installation of system, and/or if any unapproved changes are made to the site, and/or if any false information is supplied toward securing Improvement Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold