DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM


OWNER: Mike Fox / Easter Dev APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 4/7/99
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: LAKE HIS Est. Lot #1 PROPERTY RECORDED: _____
WATER SUPPLY: ☒ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☒ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

SE = Slightly Exp

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	LL AH	D-46"	Rd/Brn	L m-w SBK S,SS,SP,SE,FR	—	46"+	—	—	PS .3
2	LL AH	D-22" 22-48"	Brn SCL / Rd/Brn	GR FR / L m-w SBK S,SS,SP,SE,FR	—	48"	—	—	PS .3
3	LL AH 10/28/10	D-6" 6-48"	Brn SCL / Rd C/CL	GR,FR,SS,SP,SE / m-w SBK SS,SP,SE,FR	—	48"	—	—	PS .3
4	LL H-6 old AH 9/13/10	D-6" 6-48"	Brn SCL / Rd C/CL	GR FR SS,SP,SE / m-w SBK SS,SP,SE,FR	—	48"	—	—	PS .3

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	II 25% Red. Grav	II Same
Site LTAR	.3	.3

OTHER FACTORS (.1946): None
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: Maria Dotson
OTHER(S) PRESENT: _____

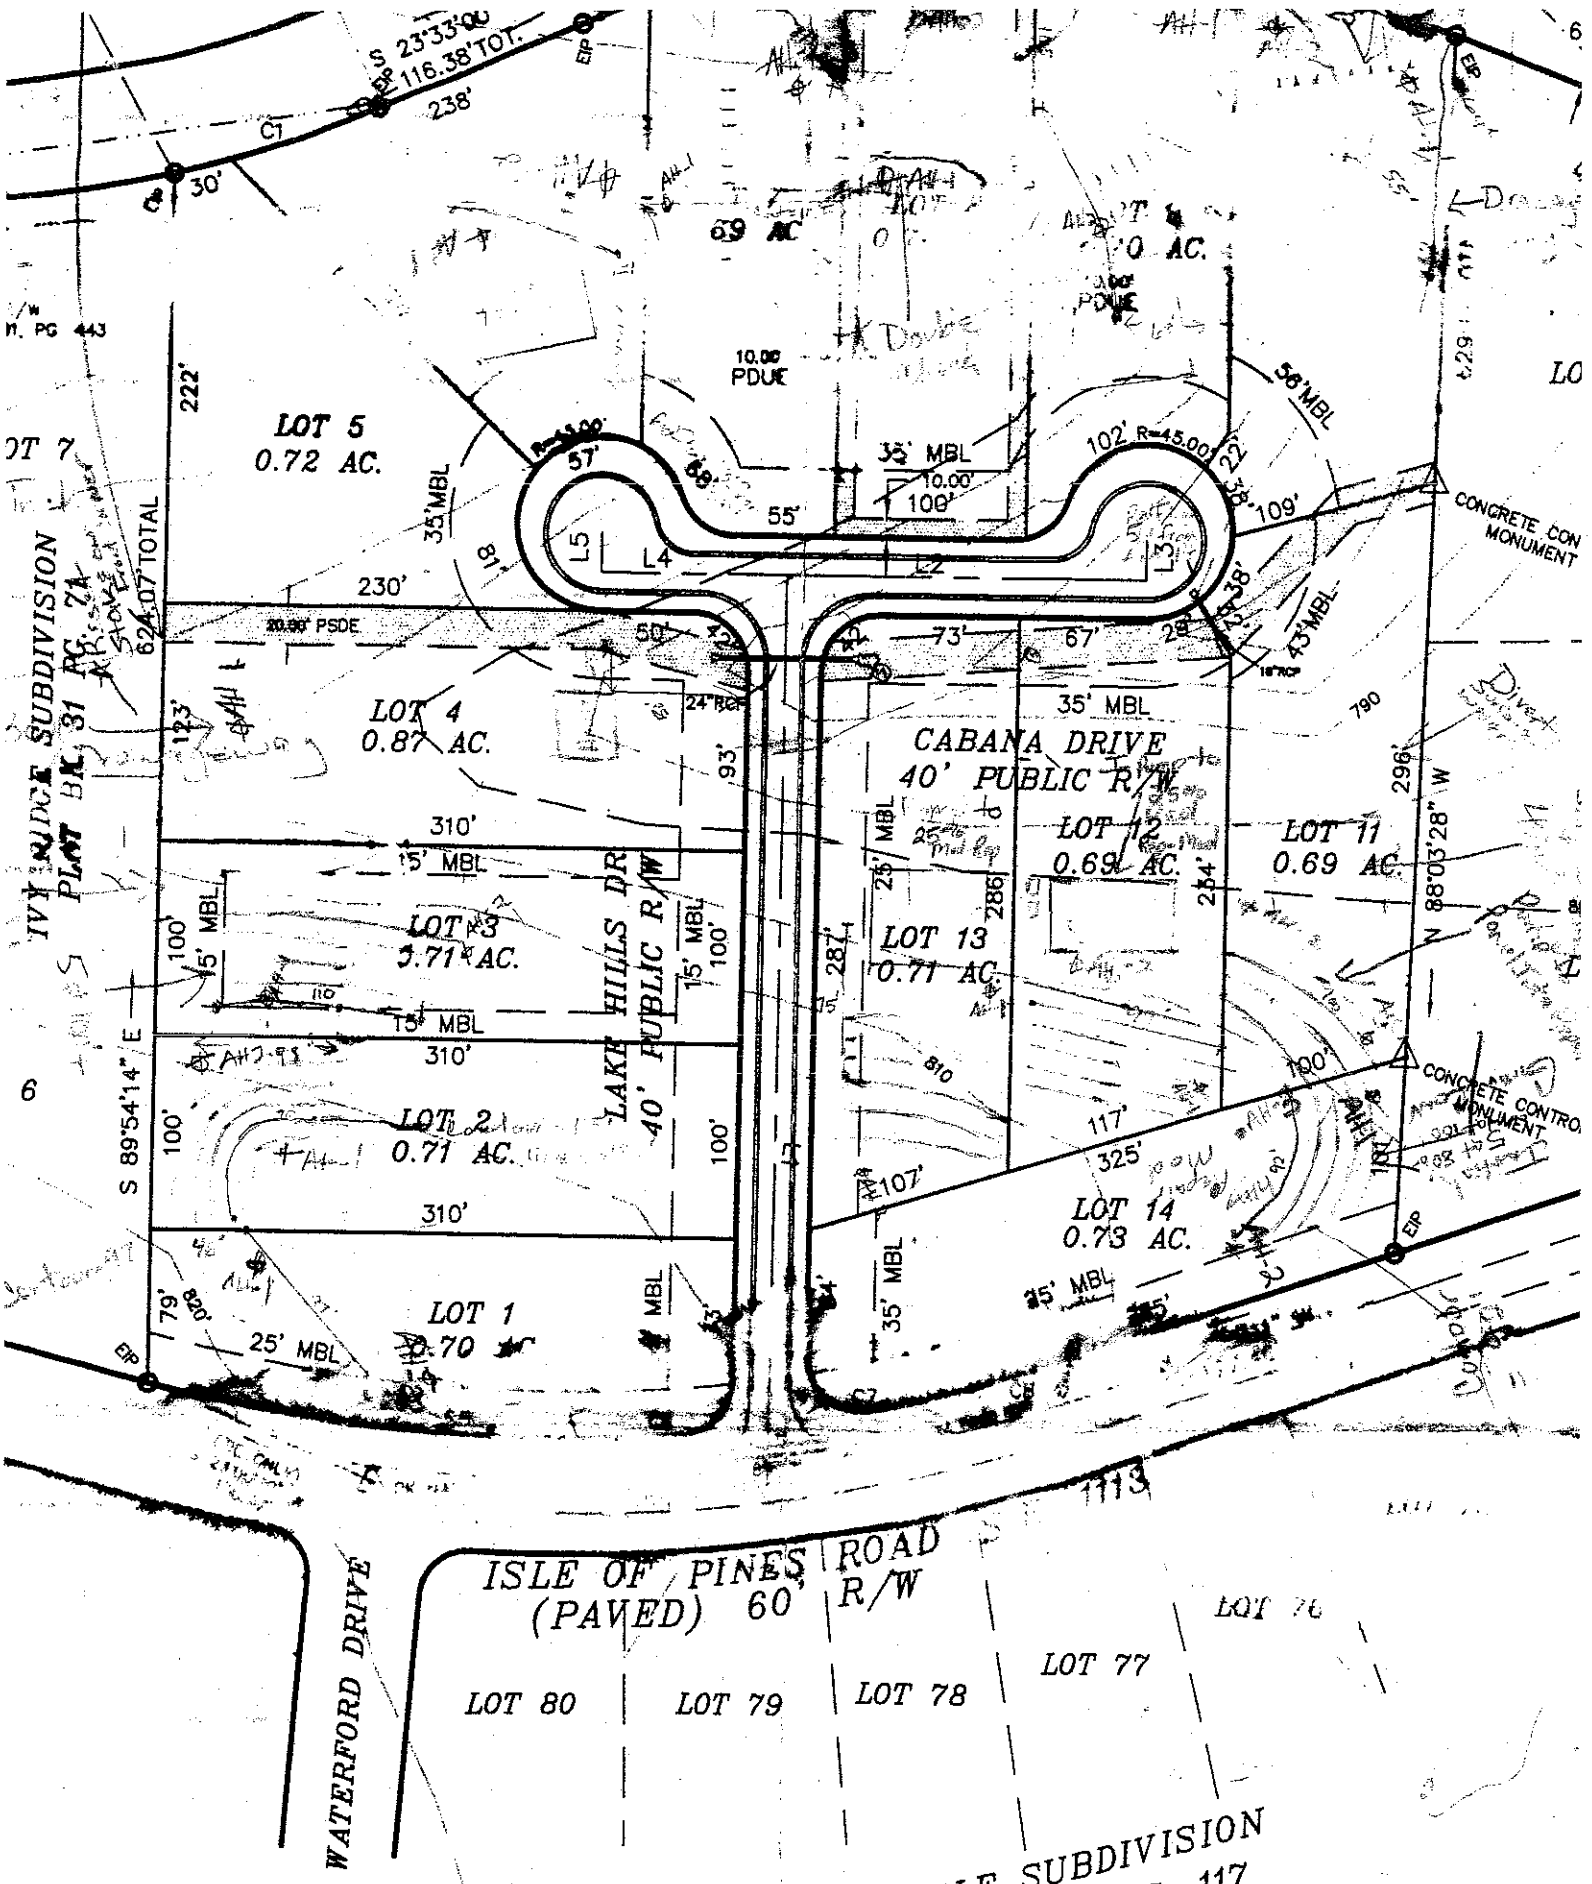

DIUS	LENGTH	CHORD	BEARING
853.62'	110.98'	110.90'	S 10°43'13" W
853.62'	109.25'	109.17'	S 03°19'46" W
853.62'	109.35'	109.28'	S 04°00'25" E
853.62'	111.32'	111.24'	S 11°24'46" E
853.62'	56.19'	56.18'	S 17°02'03" E
613.77'	114.03'	113.87'	S 18°13'39" E

PRELIMINAR
OF A REV