IREDELL COUNTY HEALTH DEPARTMENT 4635 79 6715

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR C.W. Brewer, Const. DATE 8-16-83 PERMIT NO. 277

PHONE: Business Brawley School → Stutts Rd. → Commodore Loop Home

LOCATION 1100 TL 1112 TL 2nd 1212 ~3/4 mile on left

S. R. No.

SUBDIVISION NAME Commodore Peninsula LOT NO. 176 SECTION OR BLOCK NO.

House (X) Mobile Home ( ) Business ( ) Other


No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (X)
Auto. Dishwasher Yes (X) No ( )
Auto. Wash. Machine Yes (X) No ( )
Site Suitable Yes (X) No ( )

Character & Porosity of Soil Clay loam
Percolation Rate ~ 3 gal/ft²/day
Topography 2-6%
Depth to Water Table 4'+
Rock or other impervious formations NONE observed

Lot Area Existing

Basement with Plumbing Basement without Plumbing Lot Line X No Basement

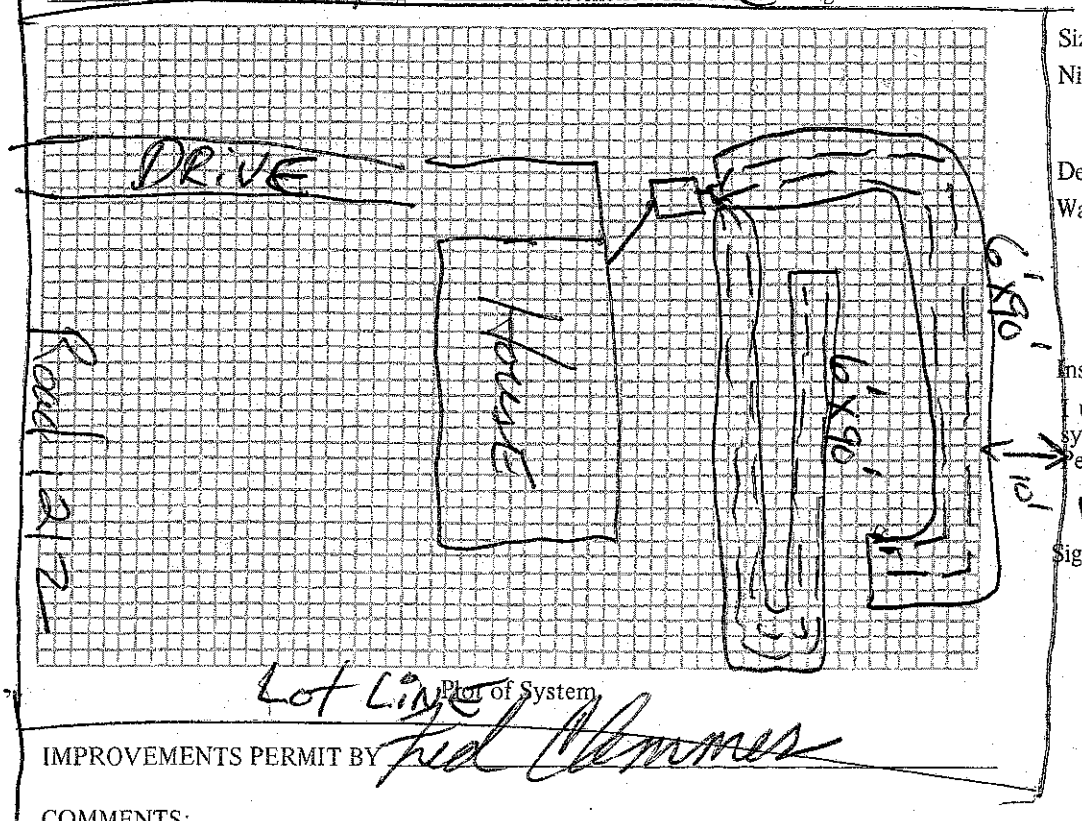

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 2X2
Sq. Ft. 1080 Linear Ft. 360
Depth of Stone in Lines 12"
Water Supply: Individual ( )
Public (X)

Installed by Bill Woolridge

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed:

IMPROVEMENTS PERMIT BY Fred Clemmer

COMMENTS:

CERTIFICATE OF COMPLETION BY Fred Clemmer DATE 8-16-83

EXISTING SYSTEM CHECKED BY: DATE

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.
Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold