~~4635-91-2044~~
4635-90-3807

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Norby Fourester DATE 2-13-86 PERMIT NO. 68

PHONE: Business ____ Home ____

LOCATION 1102 TR Lakeshore Drive Lot on corner of Lakeshore Drive + Aqua S. R. No. ____


SUBDIVISION NAME ~~Lakeshore Estates~~ Lakeview Shores LOT NO. 18 SECTION OR BLOCK NO. 32 Blk A

House (X) Mobile Home ( ) Business ( ) Other ____ Existing System

No. Bedrooms 3 No. Bathrooms 2
Garbage Disposal Unit Yes ( ) No ( )
Auto. Dishwasher Yes ( ) No ( )
Auto. Wash. Machine Yes ( ) No ( )
Site Suitable Yes ( ) No ( )
Lot Area Existing

Character & Porosity of Soil Clay
Percolation Rate 0.5 gal/ft²/day
Topography ____
Depth to Water Table ____
Rock or other impervious formations Rock, fill material

____ Basement with Plumbing ____ Basement without Plumbing (X) No Basement

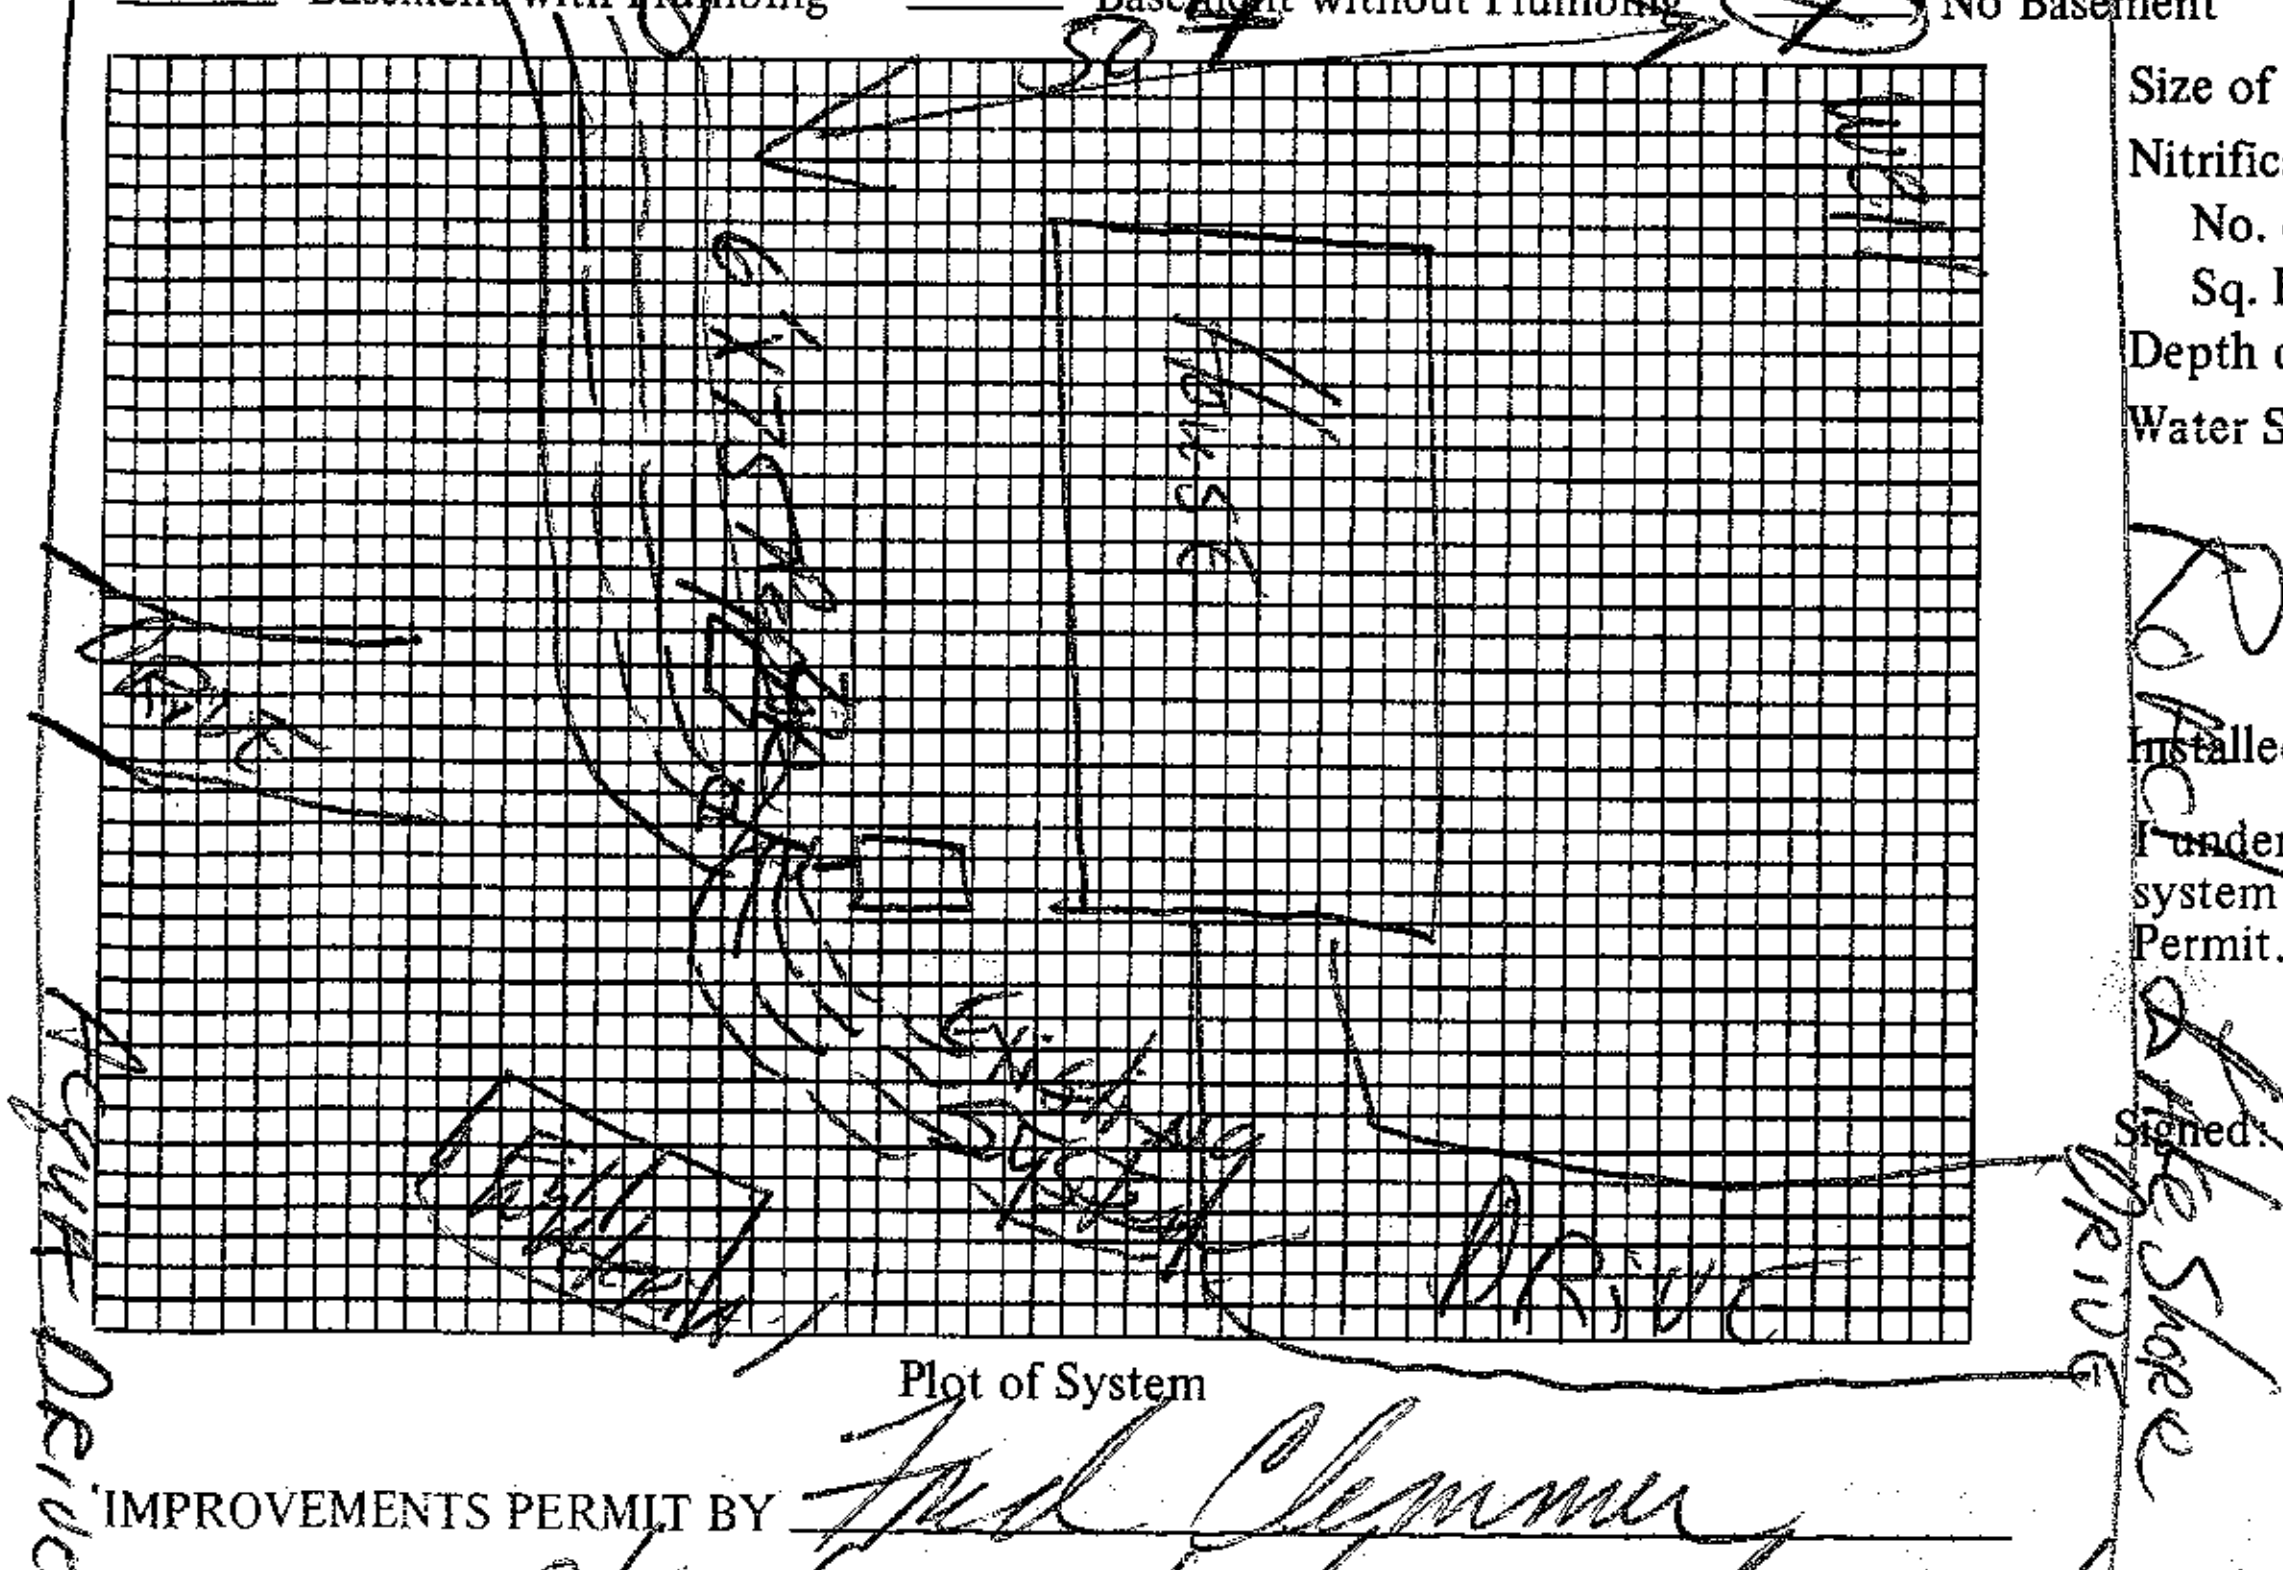

Plot of System

Size of Tank Existing Gals.
Nitrification Field: 2
No. of Lines 2
Sq. Ft. 460 Linear Ft. 150+
Depth of Stone in Lines 12"
Water Supply: Individual (X)
Public ( )

Installed by J. Ervin Co

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ____

IMPROVEMENTS PERMIT BY Fred Clemmer

COMMENTS: OK Layout change due to Rock, fill material etc

CERTIFICATE OF COMPLETION BY Fred Clemmer DATE 2-13-86

EXISTING SYSTEM CHECKED BY: ____ DATE ____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold