
Robert
In Graham
Home Northshore 2
lot 46

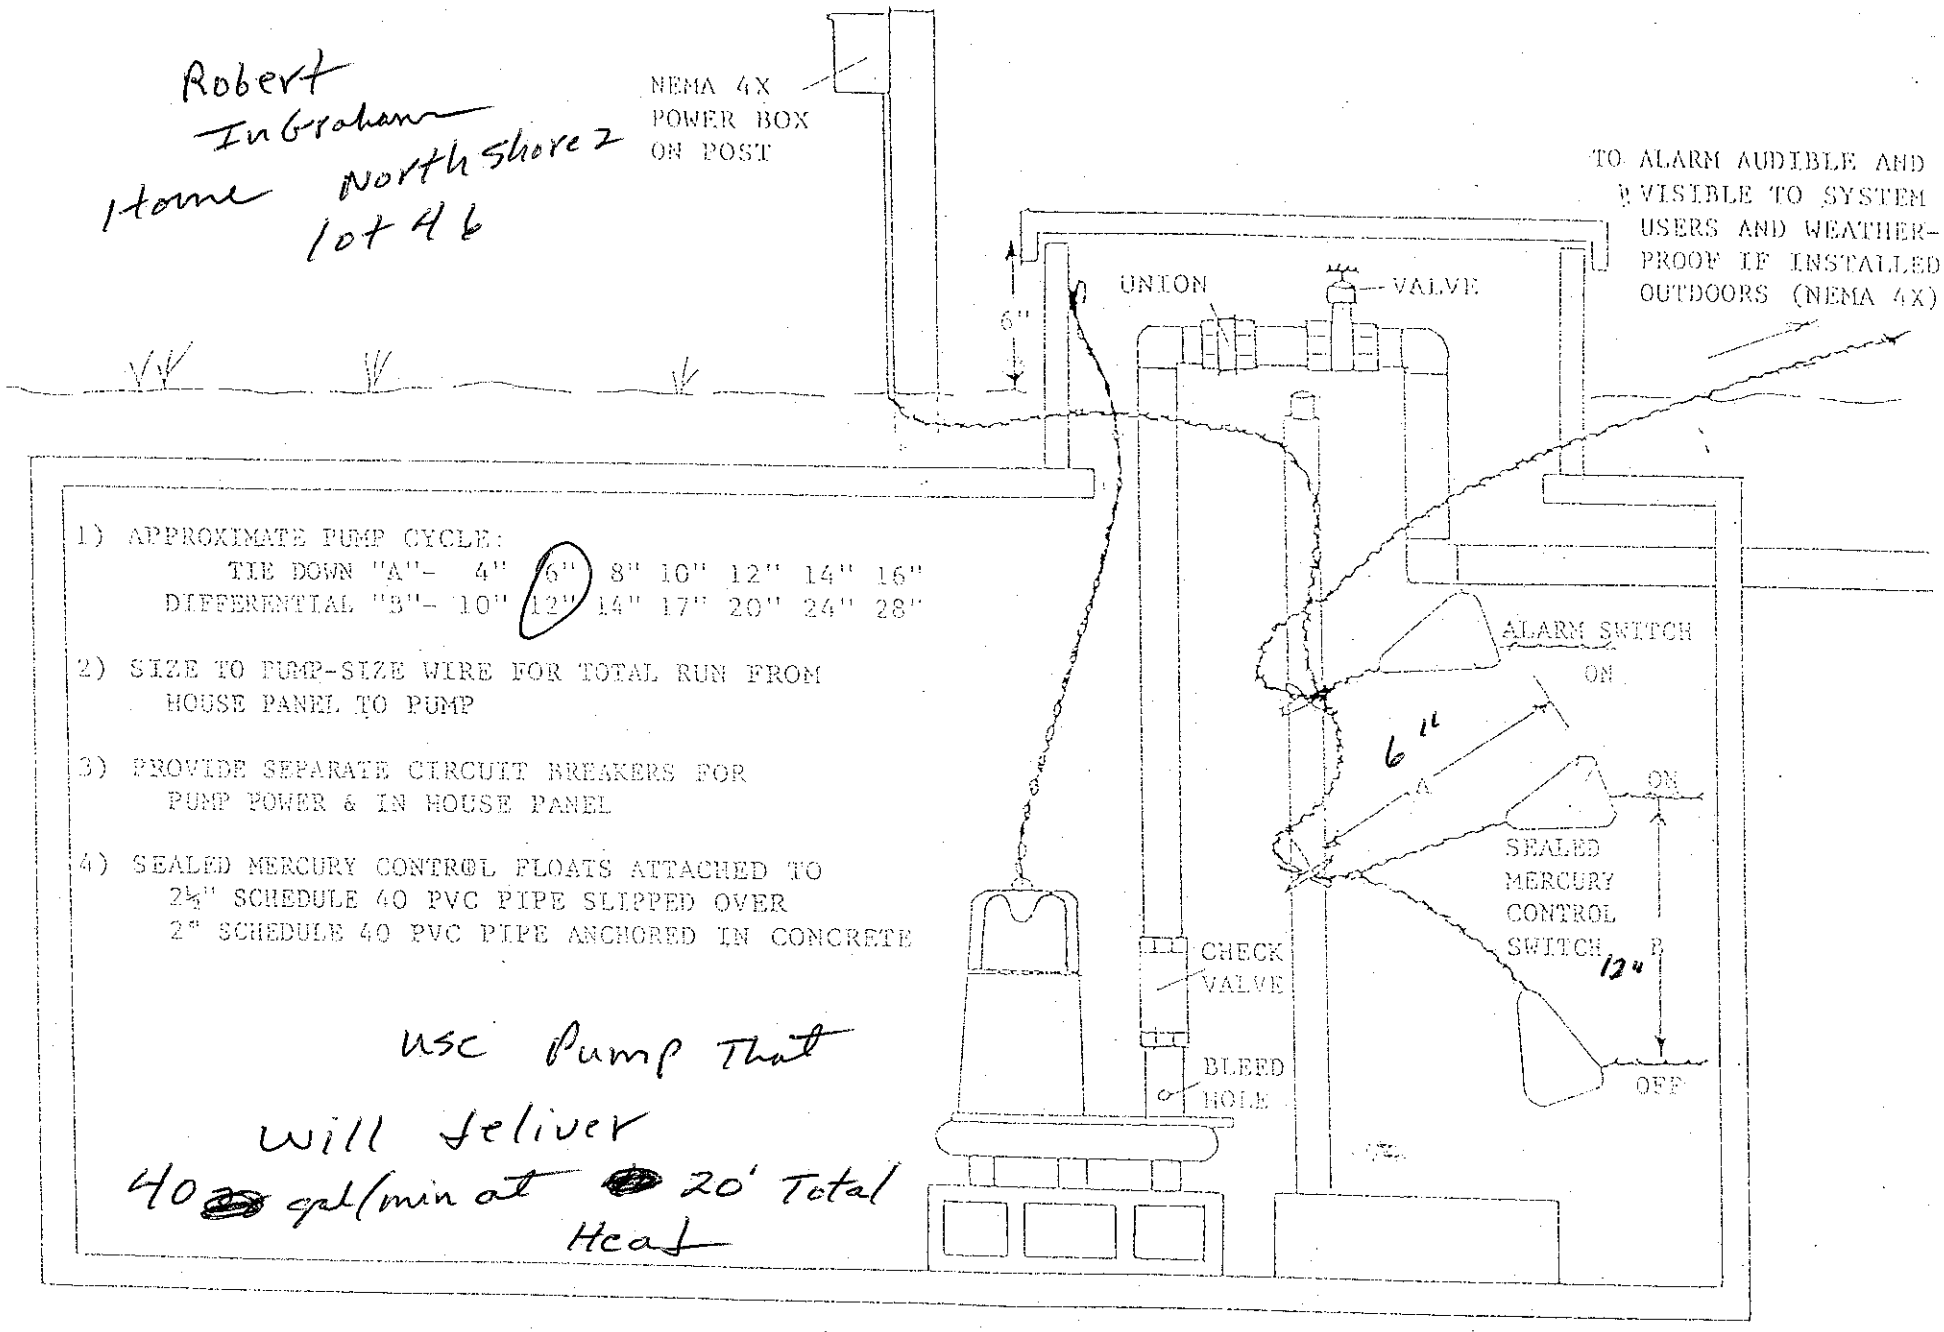

1) APPROXIMATE PUMP CYCLE:
TIE DOWN "A"- 4" 6" 8" 10" 12" 14" 16"
DIFFERENTIAL "B"- 10" 12" 14" 17" 20" 24" 28"

2) SIZE TO PUMP-SIZE WIRE FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

USC Pump That
Will Deliver
40 gal/min at 20' Total Head

- PUMP TANK DESIGN -

PRESSURE MANIFOLD DESIGN


Attachment to P.D.# 20788

Tax Map # 26-23-B-46


For: Robert InGraham Homes

Lot 46 Northshore phase 2

TOP VIEW

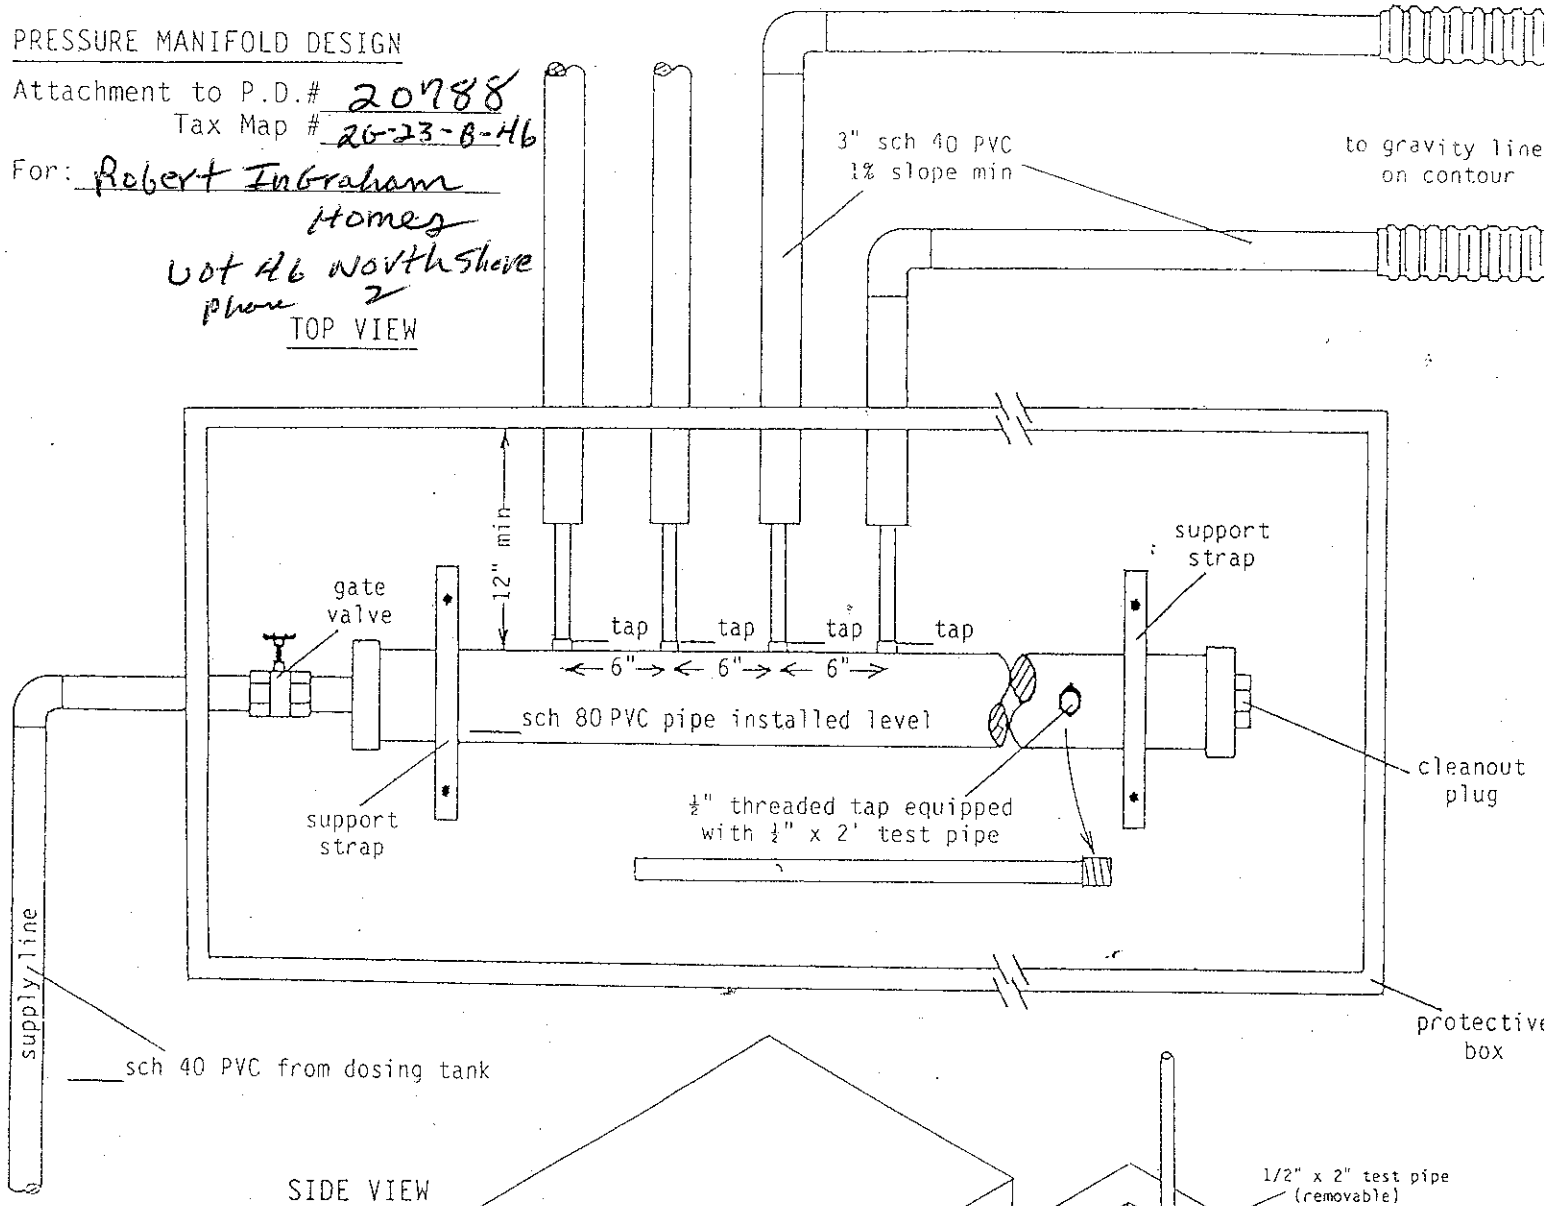

SIDE VIEW

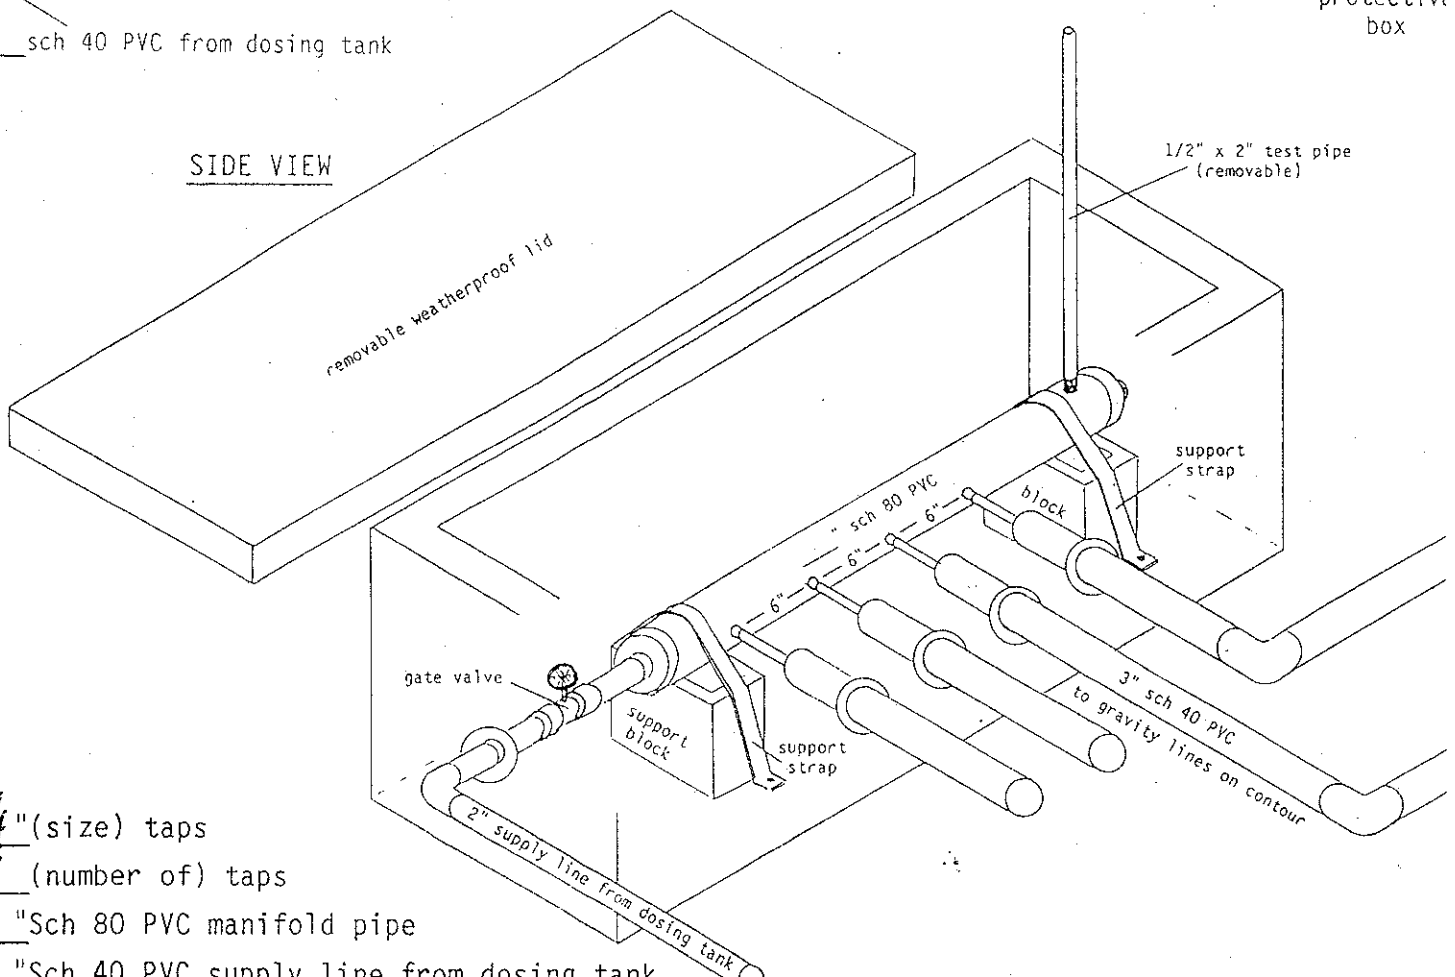

Use 3/4 "(size) taps

Use 3 (number of) taps

Use 4 "Sch 80 PVC manifold pipe

Use 3 "Sch 40 PVC supply line from dosing tank