10139

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C) 4636-18-3836

OWNER OR CONTRACTOR C.W. Brewer DATE 10/29/90 PERMIT NO. ZL-9-A-4

PHONE: Business _____ Home _____

LOCATION 1100 TR Blume TL Beechtree TR Meadow Creek Lane 4th lot on left S. R. No. _____

SUBDIVISION NAME Springfield LOT NO. 4 SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2


Garbage Disposal Unit	Yes ( )	No (✓)	
Auto. Dishwasher	Yes (✓)	No ( )	
Auto. Wash. Machine	Yes (✓)	No ( )	
Site Suitable	Yes (✓)	No ( )	

Character & Porosity of Soil clayey
Percolation Rate .35
Topography 6%
Depth to Water Table 4'+
Rock or other impervious formations none obs.

Lot Area .519 ac

1000 PT

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

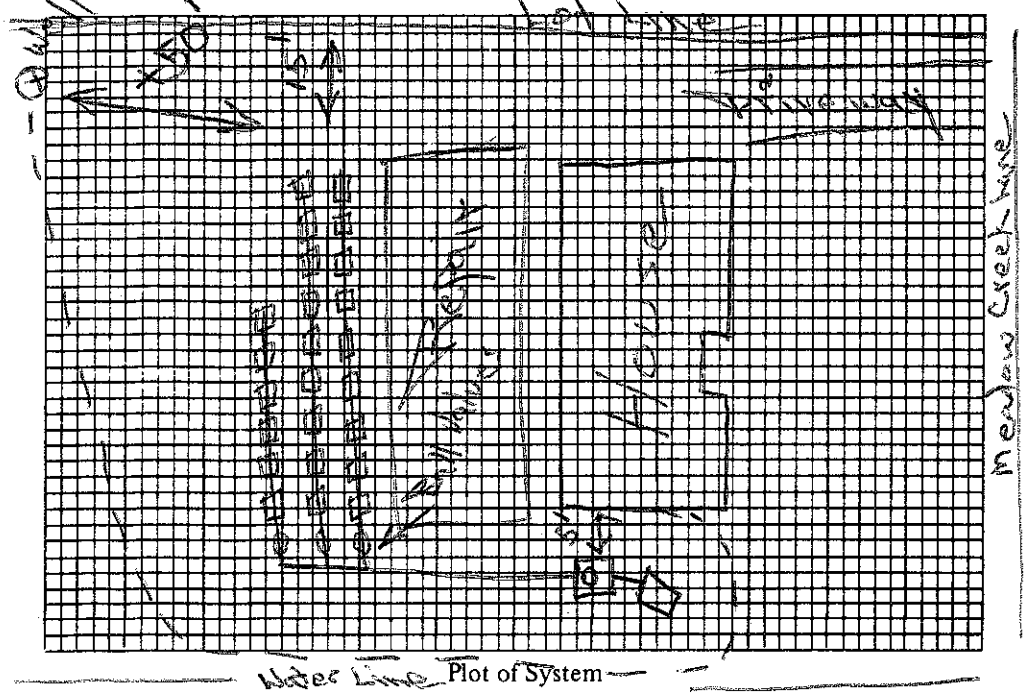

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 3
Sq. Ft. — Linear Ft. 200'
Depth of Stone in Lines 16"

Water Supply: Individual (✓) T+T
Public ( ) Panel

Installed by Richard Abernathy

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY _____

COMMENTS: _____

Operation Permit

CERTIFICATE OF ~~COMPLETION~~ BY Sam Ingram EHS DATE 10/29/90

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

10139

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR C. W. Brewer DATE 9/14/89 PERMIT NO. 2L-9-A-4

PHONE: Business _____ Home 663-4669

LOCATION 1100 TR Blume TL Beechtree TR Meadow Creek Lane 4th lot on left S. R. No. _____

SUBDIVISION NAME Springfield LOT NO. 4 SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2


Garbage Disposal Unit	Yes ( )	No (✓)	
Auto. Dishwasher	Yes (✓)	No ( )	
Auto. Wash. Machine	Yes (✓)	No ( )	
Site Suitable	Yes (✓)	No ( )	

Character & Porosity of Soil Clayey
Percolation Rate 35 gpd/ft²
Topography Gds
Depth to Water Table 4'+
Rock or other impervious formations none obs.

Lot Area .519 Acres

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

P.T.: 1000 gals

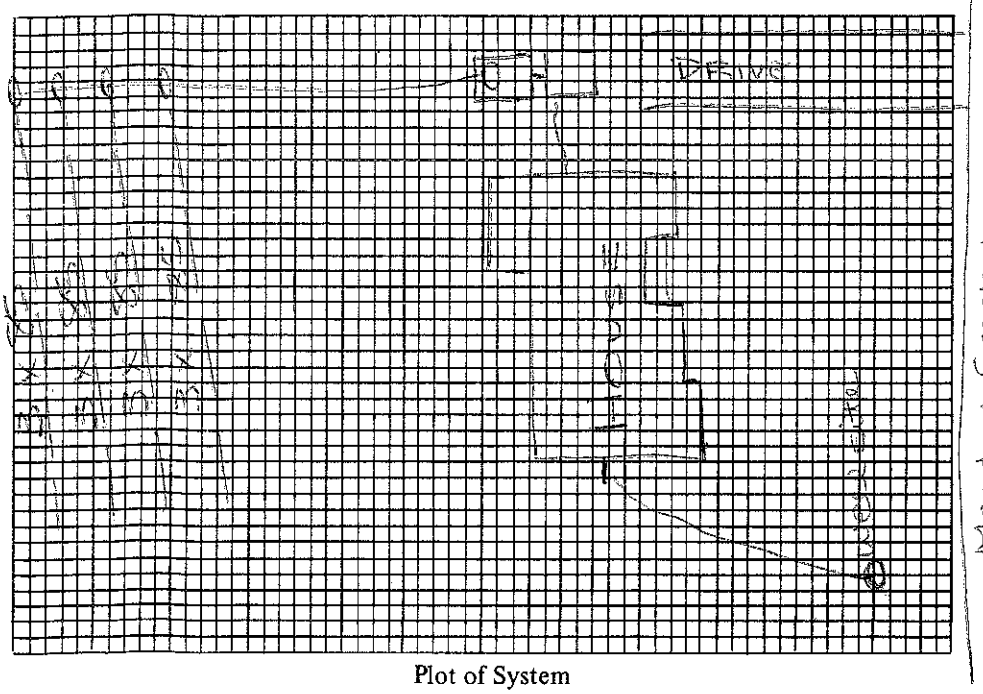

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 4
Sq. Ft. 1020 Linear Ft. 340
Depth of Stone in Lines 12"

Water Supply: Individual (✓)
Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: C W Brewer

IMPROVEMENTS PERMIT BY Andrè C. Price, R.S.

COMMENTS: System should be installed @ a shallow depth of 30" to the bottom of the drainfield. Run lines on contour. Pump through 2" Sch. 40 PVC and lift to field. Reduce to 1½"-1¼" PVC Sch. 40 w/ a 5/32" hole every 5'. Leave a 2' trap at the end of each ditch.

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Oct 16, System to be installed as LPP Model (200 ft Panels) at rear - 50' from well due to placement of well at rear and grading / fill in front. DRT

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold