4636-19-5008

10142

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR C. W. Brewer DATE May 21, 1990 PERMIT NO. ZL-9-A-12

PHONE: Business _____ Home 663-4669

LOCATION 1100 TR Blume TL Beechtree TR Meadowcreek Lane On R. S. R. No. _____

SUBDIVISION NAME Springfield LOT NO. 12 SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other Belayout


No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes ( )	No (✓)	Character & Porosity of Soil	clayey
Auto. Dishwasher	Yes (✓)	No ( )	Percolation Rate	.55 gal/sq ft
Auto. Wash. Machine	Yes (✓)	No ( )	Topography	6-8%
Site Suitable	Yes (✓)	No ( )	Depth to Water Table	4'+
			Rock or other impervious formations	none obs.

Lot Area .627 ac

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

P.T. 1000

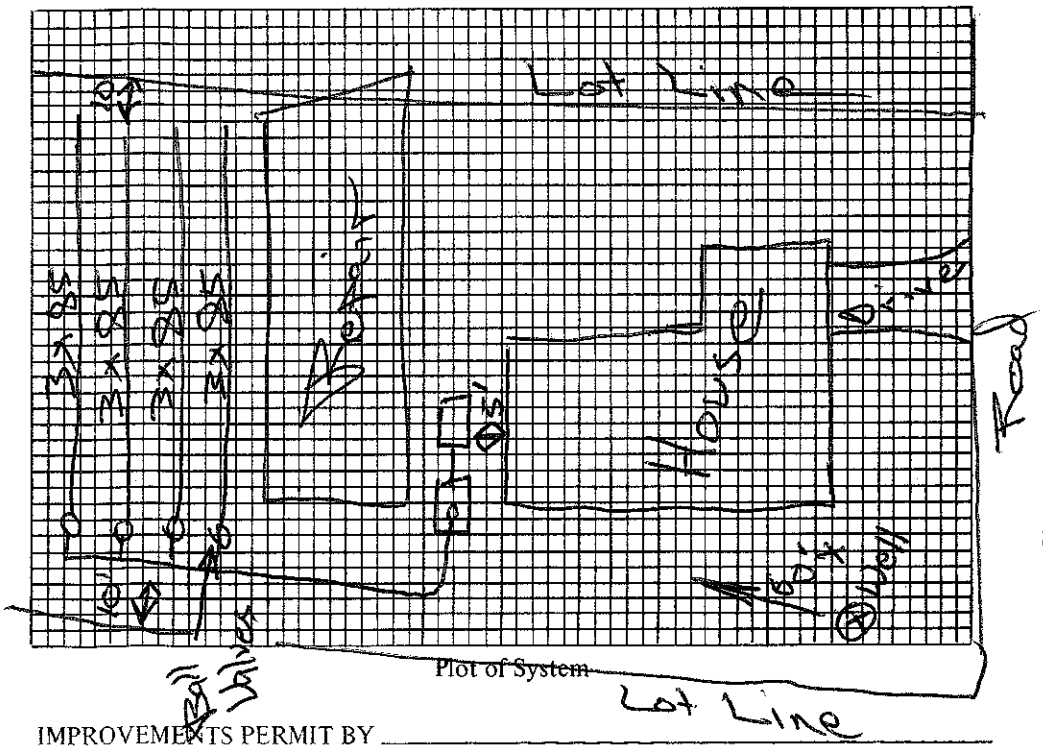

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 4
Sq. Ft. 1020 Linear Ft. 340
Depth of Stone in Lines 12"

Water Supply: Individual (✓)
Public ( )

Installed by Richard Abernathy

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY _____

COMMENTS: _____

CERTIFICATE OF COMPLETION BY Sam Ingram EHS DATE May 21, 1990

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

#0142

1:00

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR C W Brewer DATE 9/14/89 PERMIT NO. 2L-9-A-12

PHONE: Business _____ Home 663-4649

LOCATION 1100 TR Rume TL Beechtree TR. Meadow Creek Lane On R. S. R. No. _____

SUBDIVISION NAME Springfield LOT NO. 12 SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other Relayout

No. Bedrooms 3 No. Bathrooms 2


Garbage Disposal Unit	Yes ( )	No (✓)	
Auto. Dishwasher	Yes (✓)	No ( )	
Auto. Wash. Machine	Yes (✓)	No ( )	
Site Suitable	Yes (✓)	No ( )	

Lot Area .627 Acres

Character & Porosity of Soil Clayey
Percolation Rate 35 gpd/ft²
Topography 6-8%
Depth to Water Table 4'+
Rock or other impervious formations None obs.

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

P.T. - 1000 gals.

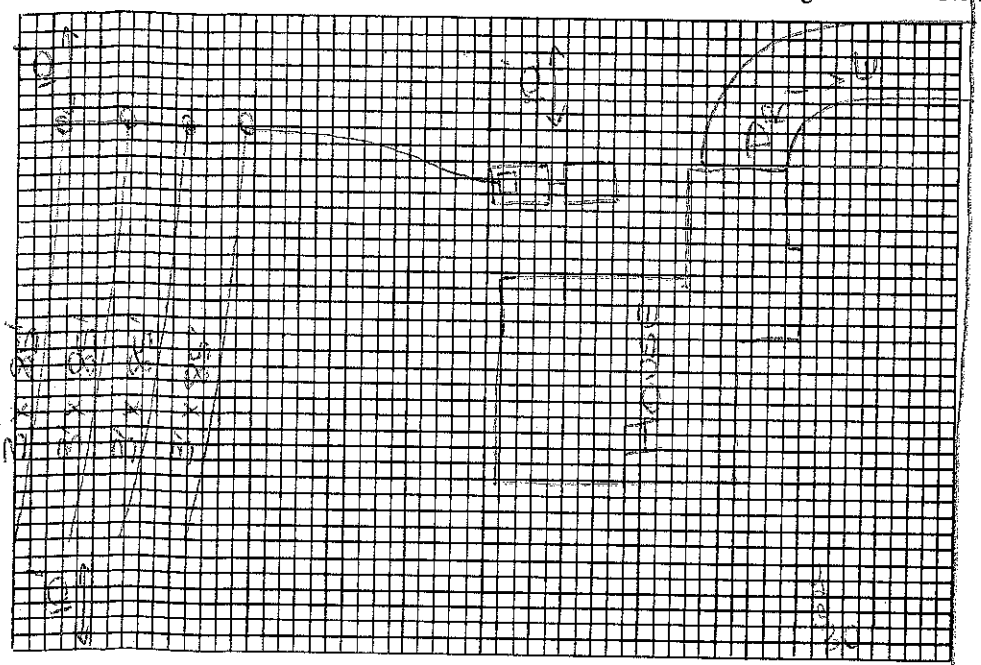

Plot of System NOT TO SCALE

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 4
Sq. Ft. 1020 Linear Ft. 340
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: C W Brewer

IMPROVEMENTS PERMIT BY Andrew C. Price, R.S.

COMMENTS: System should be installed @ a shallow depth of 30" to the bottom of the drainfield. Run lines on contour. Pump through 2" Sch. 40 PVC and lift to field. Reduce to 1½" - 1¼" PVC Sch. 40 w/ 5/32" hole every 5'.

CERTIFICATE OF COMPLETION BY Leave a 2' turnup at the DATE _____

EXISTING SYSTEM CHECKED BY: end of ea. ditch. DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold