CHAS. M. LINEBERRY

801 CENTRAL AVE. · EXECUTIVE CENTRAL · SUITE ONE
CHARLOTTE, NORTH CAROLINA 28204 · 704-333-8000

July 7, 1994

Mr. Charlie Wallace
Duke Power Company
P.O. Box 1928
Salisbury, NC 28144

Dear Mr. Wallace,

This letter is to reveiw our recent conversation regarding the acceptability to Duke Power of septic nitrification lines in your transmission line right-of-way. As I informed you the Iredell County Health Dept. requests your verification that installation of these drain lines is acceptable.

You have informed me that they are acceptable so long as your standard right-of-way restrictions are met, such as:

(1) "...Septic tanks...are not allowed".

(2) "Shall be atleast 20 ft. from a pole or tower leg..."

(3) "...Sewer lines...shall not parallel the center line ...but may cross at any angle not less than 30°..."

In addition, we acknowledge that Duke Power Company has no responsibility for our installation of septic nitrification drain lines and we are willing to assume liability for any and all damages that may occur.

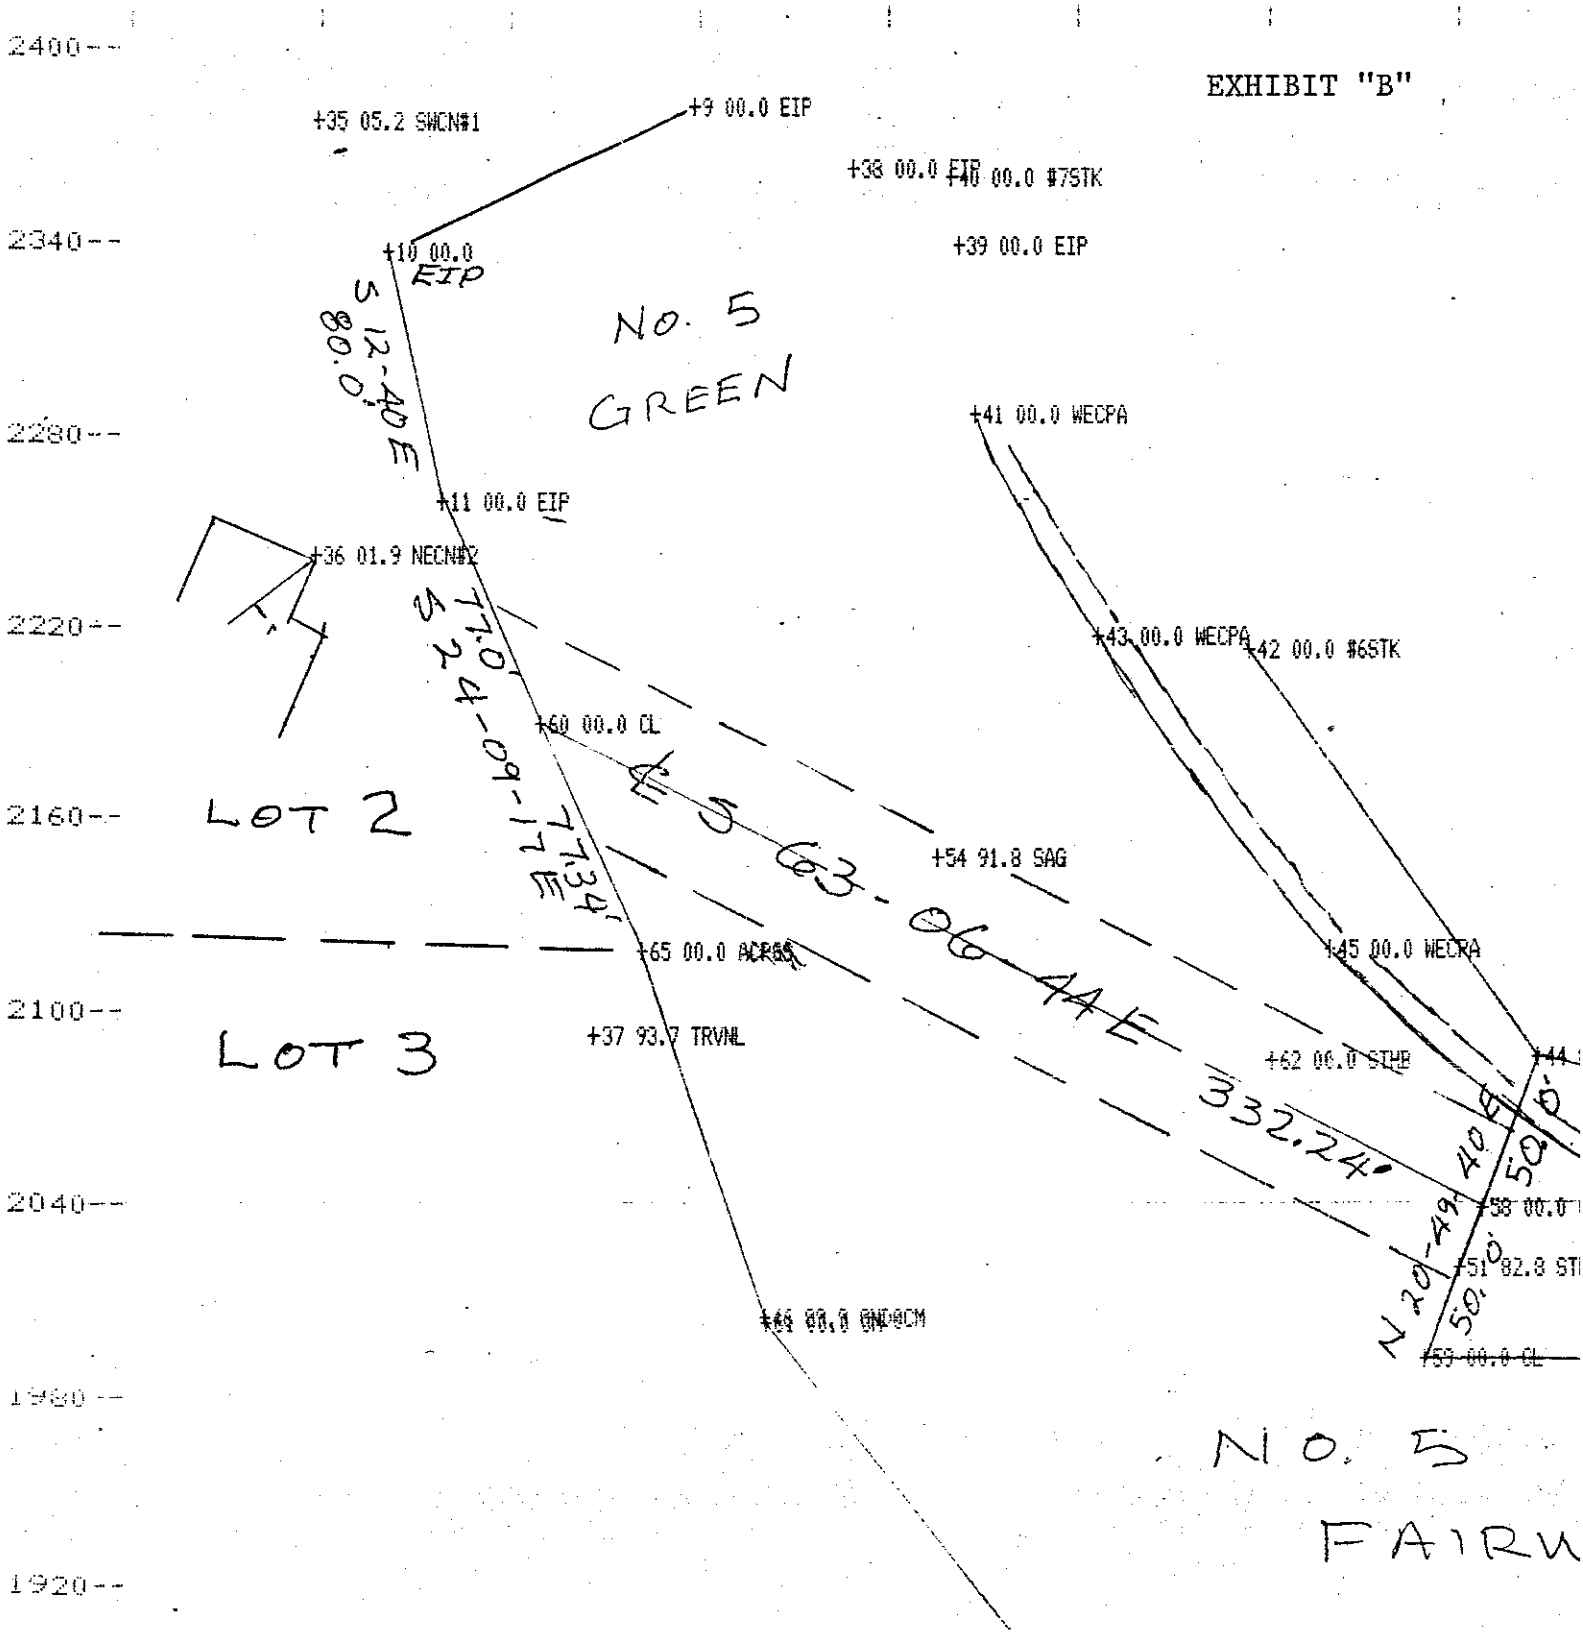
If you agree that we may inform the Iredell County Health Dept. that Duke Power Company approves these installations under these conditions, please sign one copy of this letter and return.

Very truly yours,

Chas. M. Lineberry, General Partner
TAFBO Partnership

Agreed To: Charlie Wallace Date: 7/20/94
Charlie Wallace for
Duke Power Company

CML/kd


EXHIBIT "B"
2400--
2340--
2280--
2220--
2160--
2100--
2040--
1980--
1920--
+35 05.2 SWCN#1
+9 00.0 EIP
+38 00.0 EIP
+40 00.0 #7STK
+10 00.0 EIP
+39 00.0 EIP
NO. 5 GREEN
S 12-40 E 80.0'
+41 00.0 WECPA
+11 00.0 EIP
+36 01.9 NECN#2
+43 00.0 WECPA
+42 00.0 #6STK
S 24-09-17 E 77.0'
+60 00.0 CL
LOT 2
S 63-06 44 E 332.24'
+54 91.8 SAG
+65 00.0 ACROSS
+45 00.0 WECPA
LOT 3
+37 93.7 TRVNL
+62 00.0 STHB
+44
+38 00.0
+51 82.8 ST
N 20-49 40 E 50.0'
50.0'
+59 00.0 CL
+69 00.0 BNDRCM
NO. 5
FAIRW