DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

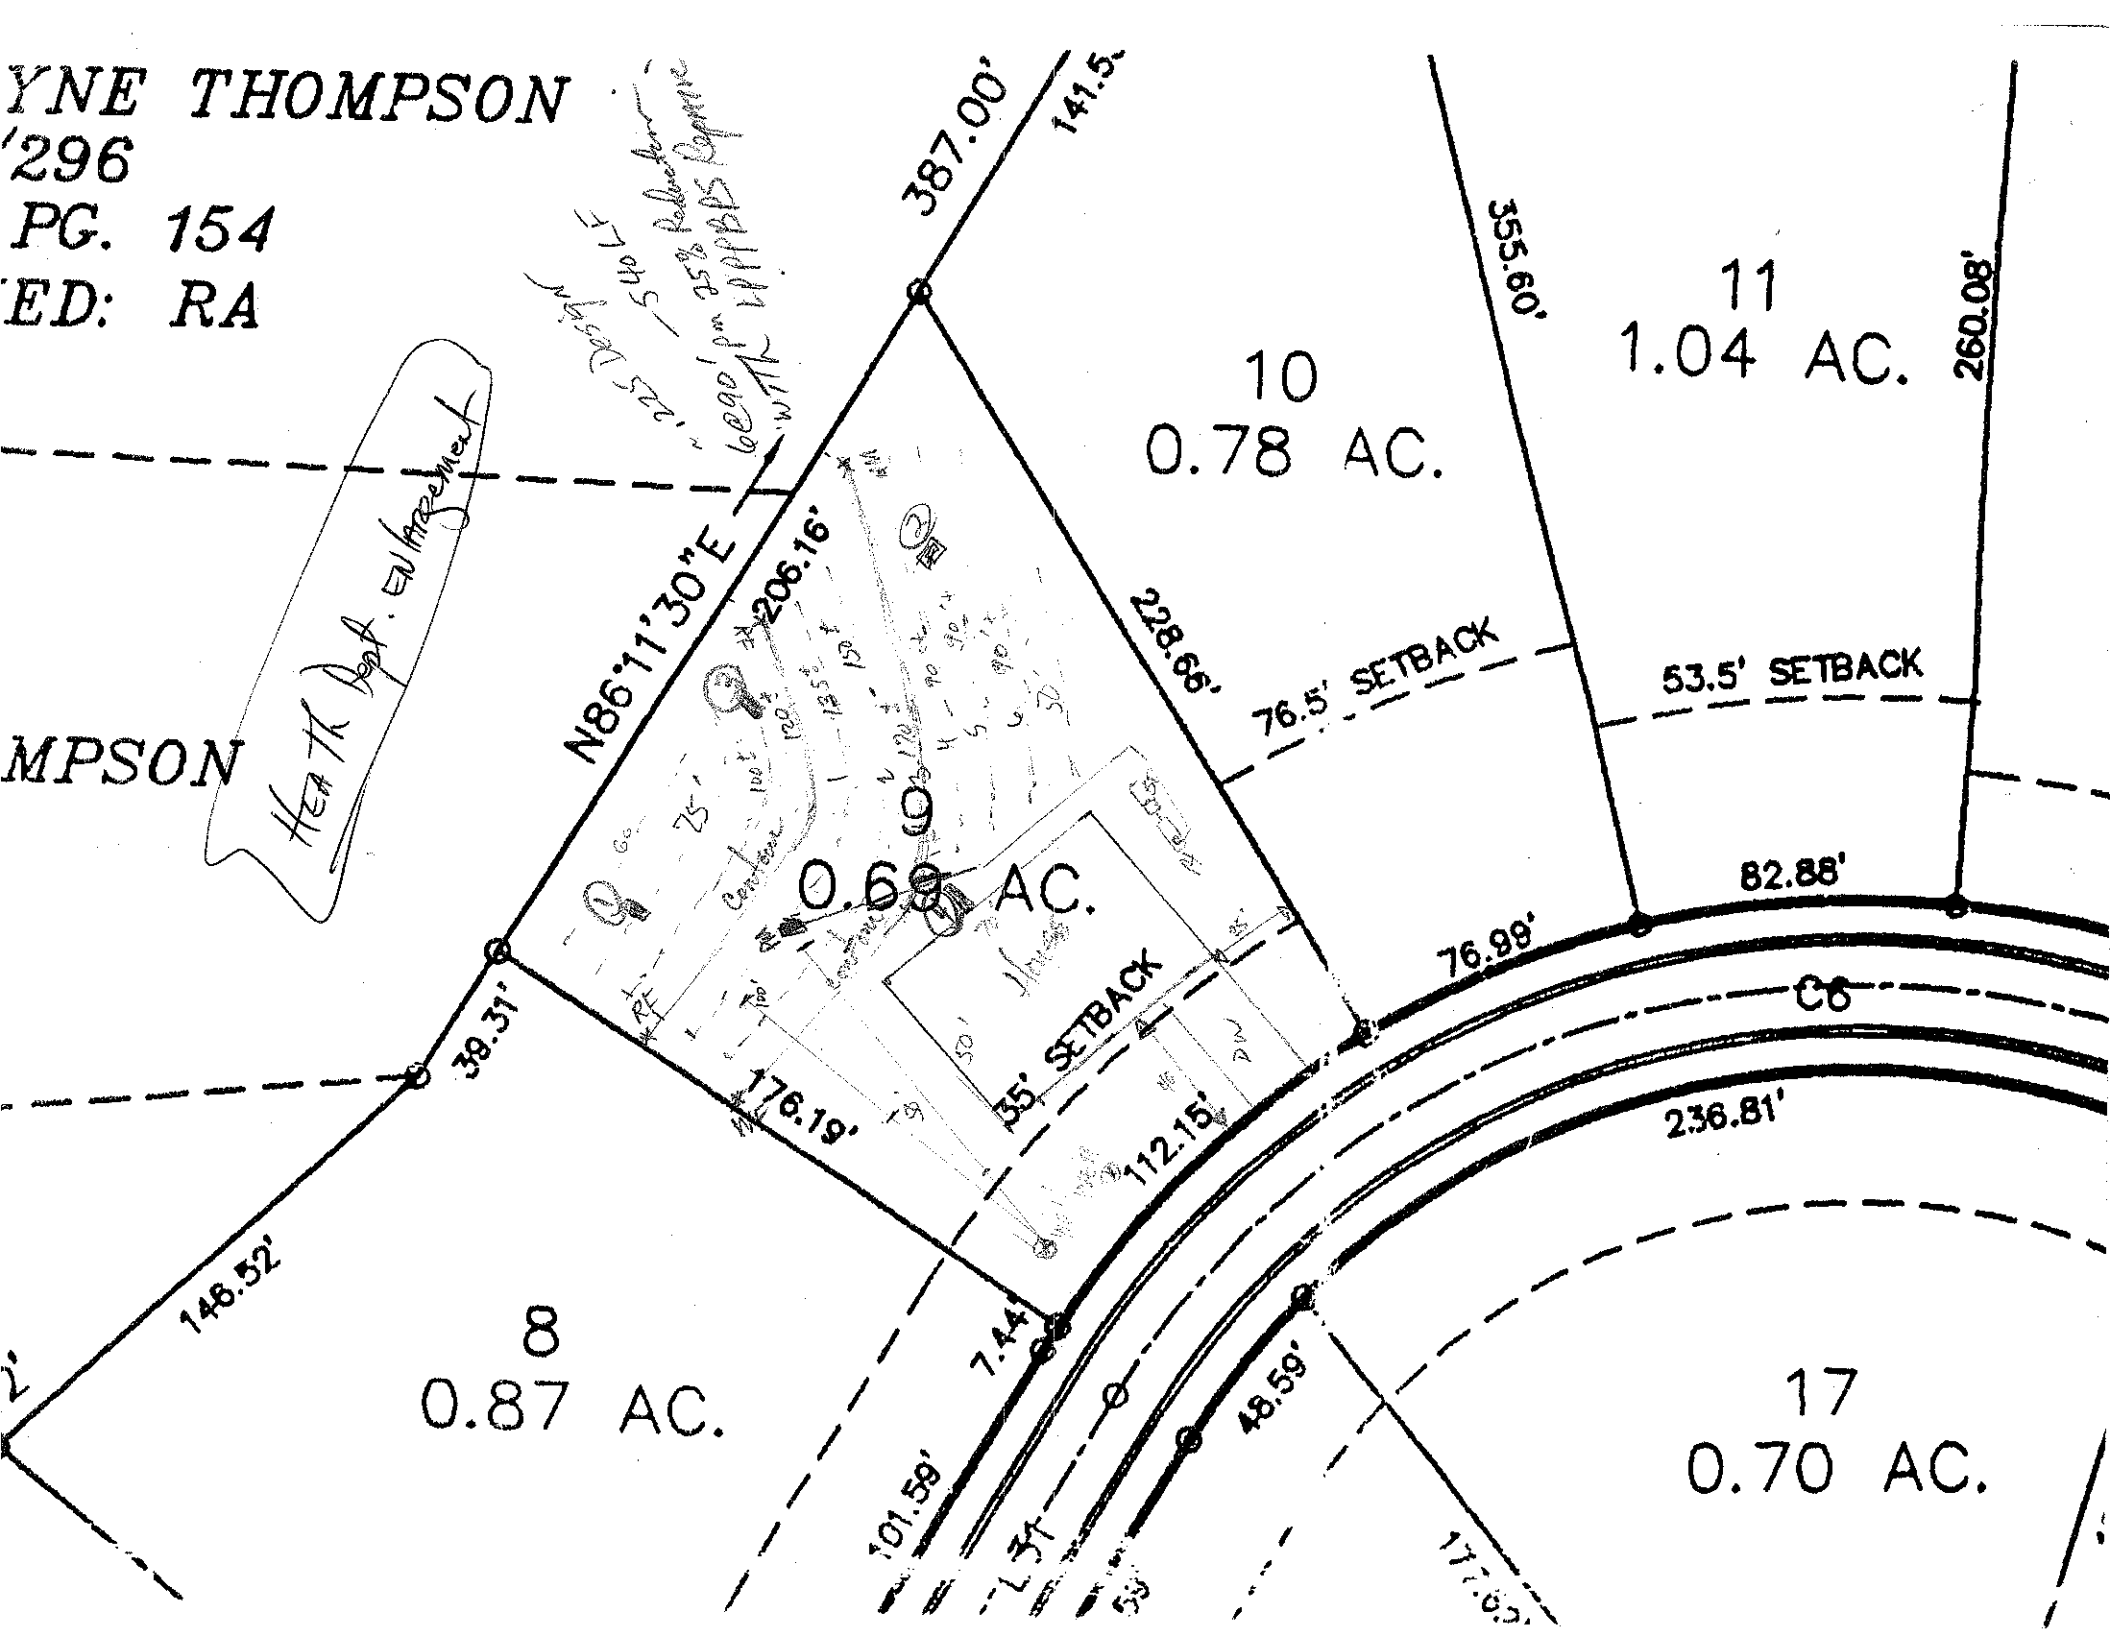
OWNER: Paul Smith APPLICATION DATE ___
ADDRESS: ___ DATE EVALUATED: 2-3-03
PROPOSED FACILITY: ___ PROPOSED DESIGN FLOW (.1949): 480 gpd PROPERTY SIZE: .69 Ac
LOCATION OF SITE: Lot 9 Whispering Oaks PROPERTY RECORDED: ___
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-10	WSBK BSCL	fri SSSP					.2 – .25
		10-44	MFSBK/PRISM RC	fri SP/SSSP/common VFS mottles					
		44-52	WFSBK RCL	fi/fri SSSP					
2	6-8%	0-10	WSBK BSCL	fri SSSP					.25 – .3
		10-53	MWSBK RCL	fri SP/SSSP/few		SAP			
3	5-15-03	0-6	SBK RCL (fill?)	fr SSSP					.225
		6-18	gr fsnl SL	fr SSSP					
		18-41	mfsbk rcl	fr SSSP common yel/red mottles SAP					
		41-62	WK fABK yp rcl	fi SSSP few mi SAP					
4	5-15-03	0-6	SBK RCL (fill)	fr SSSP					.225
		6-13	gr SAN SL	fr SSSP					
		13-35	mfsbk rc	fr SP SSSP few common yel/red mottles					
		35-57	WK fABK R-yp rcl	fi SSSP common mica flakes, few mi SAP					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS (Rese
System Type(s)	Pm-25% Red	LPP/RBDS
Site LTAR	.225	.225

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: DWA
OTHER(S) PRESENT: ___

COMMENTS: ___


YNE THOMPSON
'296
PG. 154
ED: RA
MPSON
387.00'
141.5'
355.60'
260.08'
11
1.04 AC.
10
0.78 AC.
N86°11'30"E
206.16'
228.66'
76.5' SETBACK
53.5' SETBACK
82.88'
76.99'
C6
236.81'
9
0.69 AC.
35' SETBACK
112.15'
176.19'
39.31'
146.52'
8
0.87 AC.
7.44'
101.59'
48.59'
17
0.70 AC.