Old # 128965

IREDELL COUNTY HEALTH DEPARTMENT

Statesville Office (704) 878-5305 Mooresville Office (704) 660-3625 PERMIT # 204350

IMPROVEMENT PERMIT / AUTHORIZATION TO CONSTRUCT / OPERATION PERMIT / EXISTING SYSTEM

PIN # 4636-33-7341

APPLICANT: Bonanza Dev. Co. APPLICANT ADDRESS: 816-G Brawley Sch Rd Mooresville NC 28117

SITE ADDRESS: 126 E. Vista View Place - Mod. PHONE: 704-662-0105 ALT. PHONE: 704-363-9942

SITE DIRECTIONS: Brawley Sch Rd, TL on Isle of Pines, TR on Meadow Crest, TR on E. Vista View, Lot ~~6~~ 18 at end

SUBDIVISION: The Villages at Isle of Pines SECTION: — LOT # 18 LOT AREA: 0.71 ac DESIGN FLOW: 360 gpd L.T.A.R.: 0.3

Septic Tank 1000 (gal) STB 794 Date 9-14-16
Pump Tank (gal) PT Date
Pump Make Model Serial #
Nitrification Fields 1 # Lines 4 Linear Ft: 300'
Trench Width 36" Max. Trench Bottom Depth 36" Gravel Depth N/A

☑ New System ☐ Repair ☐ Expansion System Type: I II (III) IV V VI
System Description: Gravity 25% Reduction
Repair System Description: LPP PBPS
Maintenance Agreement Required: ☐ YES ☑ NO
☑ GRAVITY ☐ PRESSURE

☑ Residence No. Bedrooms 3
☐ Business No. Persons 6
☐ Other No. Employees
☐ Slab ☑ Crawl Space
☐ Basement w/plumbing ☐ Basement w/o plumbing

Water Supply: ☐ Private ☐ Public ☑ Community

Comments / Conditions:

ST - 13.2ft off house (1.5 From Bay)

INITIAL SITE SKETCH

SEE DESIGN BY S & ME

(Dated 6-26-14, Approved 8-8-14)

AS BUILT SKETCH

Installed Quick 4 essentially as drawn.

Permit can be suspended or revoked if any false information is supplied toward securing the permit / any unauthorized changes are made to the site / any unauthorized changes are made in the installation of the system. CONTACT A LOCATOR SERVICE PRIOR TO ANY EXCAVATION

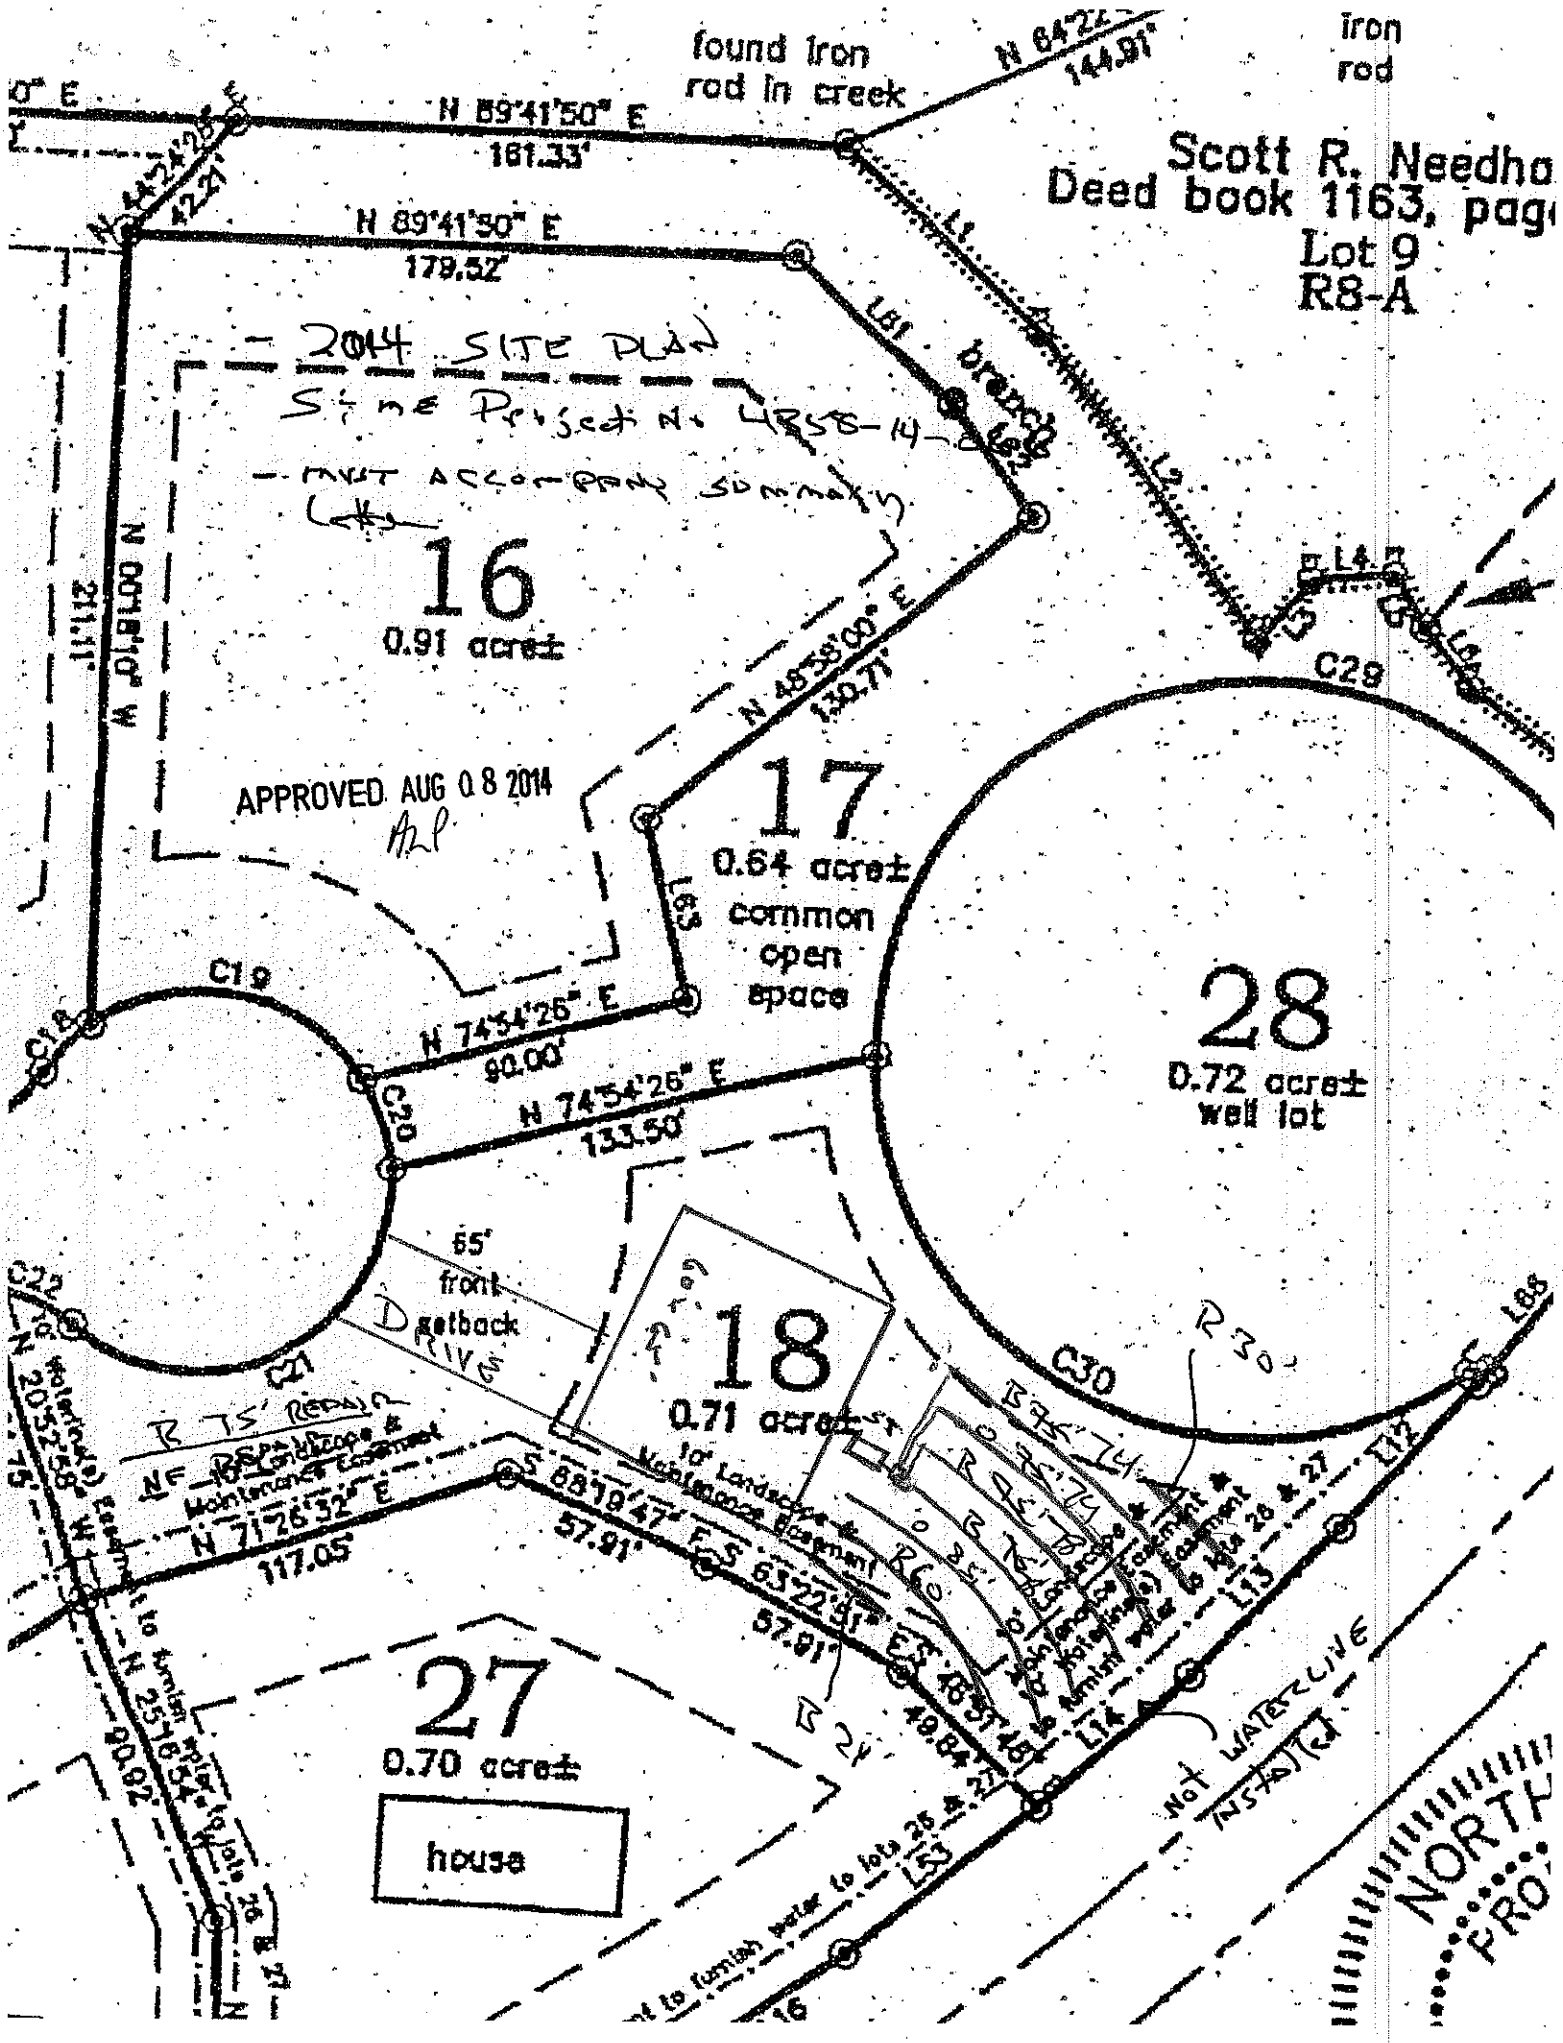
☑ IMPROVEMENT PERMIT *with plat* valid without expiration. ☒ IMPROVEMENT PERMIT *with site plan* valid for 60 mos. ☒ AUTHORIZATION TO CONSTRUCT valid for period equal to IMPROVEMENT PERMIT--not to exceed 60 mo.

Owner / Applicant Signature: Scott R. Needham Date: 8/13/14 Installed by: R&H

IMPROVEMENT PERMIT by: Date: 8-8-14 OPERATION PERMIT by: Maria Dolan RS. Date: 10/19/16

AUTHORIZATION TO CONSTRUCT by: Date: 3-28-16 Existing System Inspected by: Date:

Health Dept. Copy - WHITE Applicant (Final Approval) - YELLOW Applicant (Conditional Approval) - PINK


found iron rod in creek
iron rod
N 89°41'50" E
181.33'
N 64°22'
144.91'
Scott R. Needha
Deed book 1163, pag
Lot 9
R8-A
2014 SITE PLAN
Site Project No. 4858-14-2
- MUST ACCOMPANY SUBMITTAL
16
0.91 acre±
N 89°41'50" E
179.52'
N 44°24'25" E
42.21'
N 00°18'10" W
211.11'
N 48°38'00" E
120.71'
APPROVED AUG 08 2014
17
0.64 acre±
common open space
28
0.72 acre±
well lot
N 74°54'26" E
90.00'
N 74°54'26" E
133.50'
65' front setback
18
0.71 acre±
27
0.70 acre±
house
N 71°26'32" E
117.05'
S 88°18'47" E
57.91'
S 65°22'51" E
57.81'
S 45°51'48" E
49.84'
10' Landscape & Maintenance Easement
Not WATERLINE INSTALLED
NORTH
C18
C19
C20
C21
C22
C28
C30
L1
L2
L3
L4
L5
L6
L7
L8
L9
L10
L11
L12
L13
L14
L15
L16
L17
R30'
R24'
R60'