DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

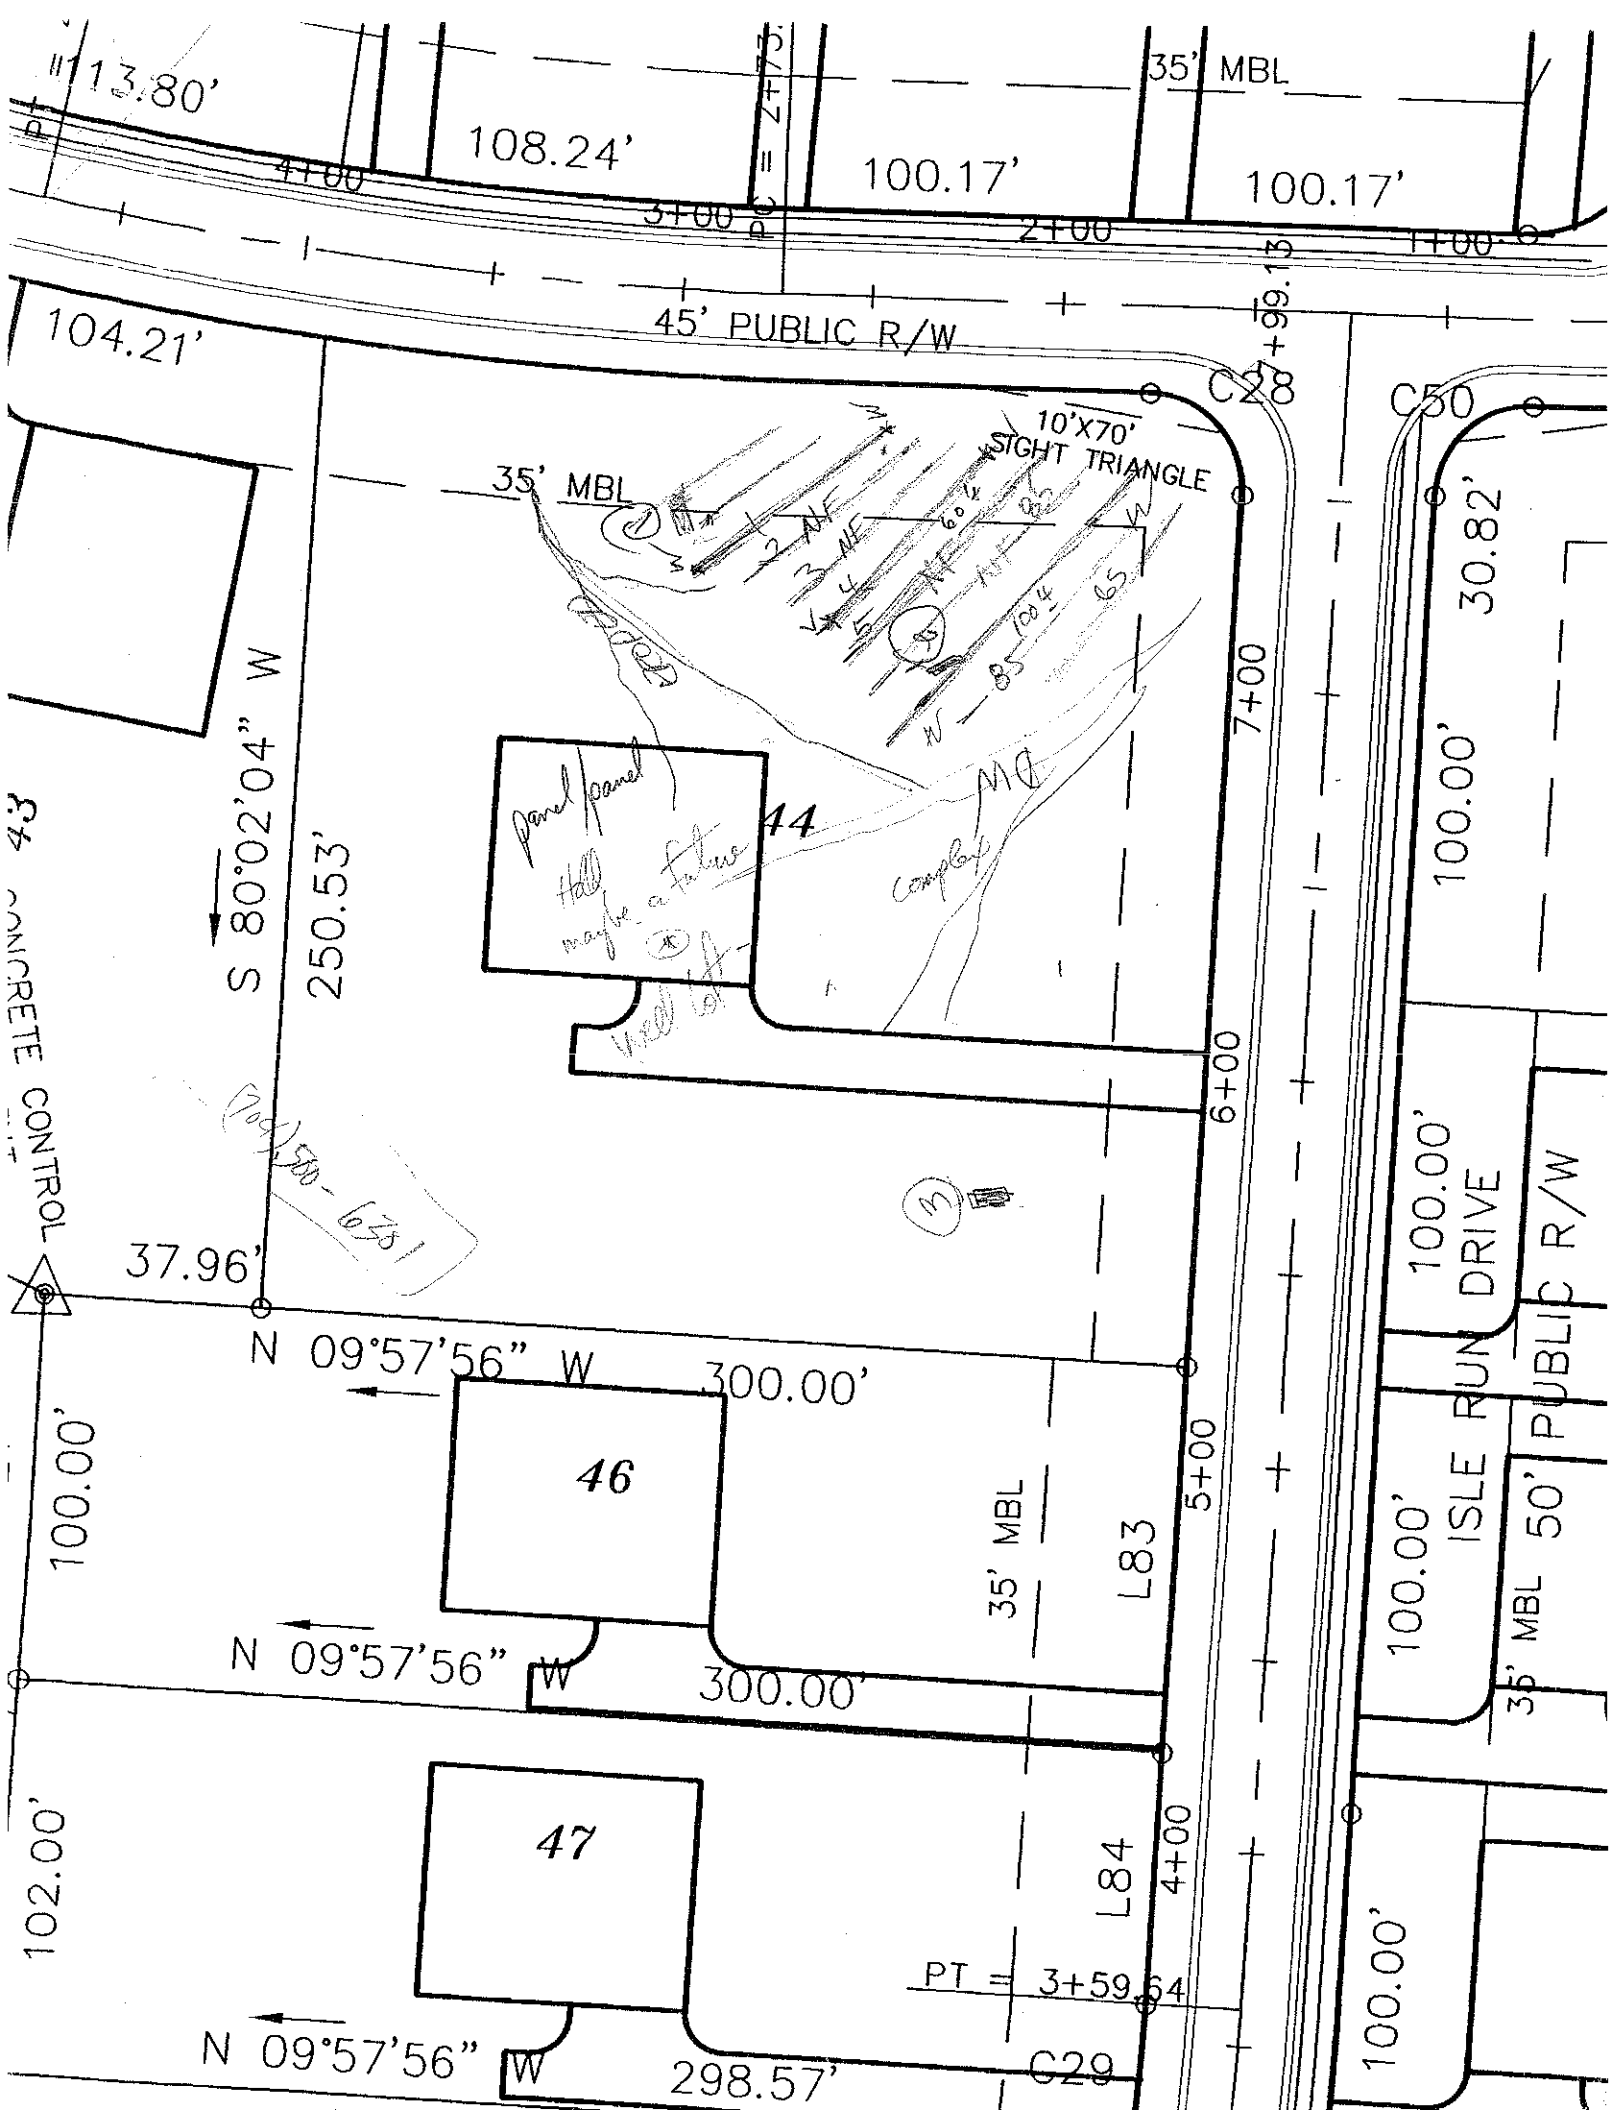
OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 7-28-04
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: Lot 44 The Preserve PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

Now a well lot and SPE outside wellradius.

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-11	gr wk sbk brn sdl	fr sss p					.3
		11-25	m-f sbk RC	fr sp san					
		25-40	(BC) wk f sbk yr sdl	fr sss p					
		40-54	massive yr l/sl sap	fr sss p					
2	14% S/V	0-14	gr brn sl	fr sss p					.3
		14-36	m-f sbk RC	fr sss p sap					
		36-48	wk f sbk yr sdl	fr sss p common in sap					
		48-54	massive yr l/sl sap	fr sss p					
3		0-12	gr-wk f sbk brn sdl	fr sss p					.25
		12-39	m-f sbk RC	fr sp sap					
		39-51	wk f sbk yr dl	fi-fr sss p common yr brown motles					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


13.80'
108.24'
100.17'
100.17'
35' MBL
45' PUBLIC R/W
104.21'
10'X70'
SIGHT TRIANGLE
35' MBL
S 80°02'04" W
250.53'
37.96'
N 09°57'56" W
300.00'
100.00'
46
35' MBL
L83
5+00
N 09°57'56" W
300.00'
102.00'
47
L84
4+00
PT = 3+59.64
N 09°57'56" W
298.57'
C29
C28
C50
7+00
6+00
30.82'
100.00'
100.00'
ISLE RUN DRIVE
50' PUBLIC R/W
35' MBL
100.00'
CONCRETE CONTROL
44
pool/pond
fill
maybe a future
complete
well