DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Michael Ditto
ADDRESS: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 360
LOCATION OF SITE: Stuttscove Lot 31

APPLICATION DATE _____
DATE EVALUATED: 3-19-07
PROPERTY SIZE: _____
PROPERTY RECORDED: _____

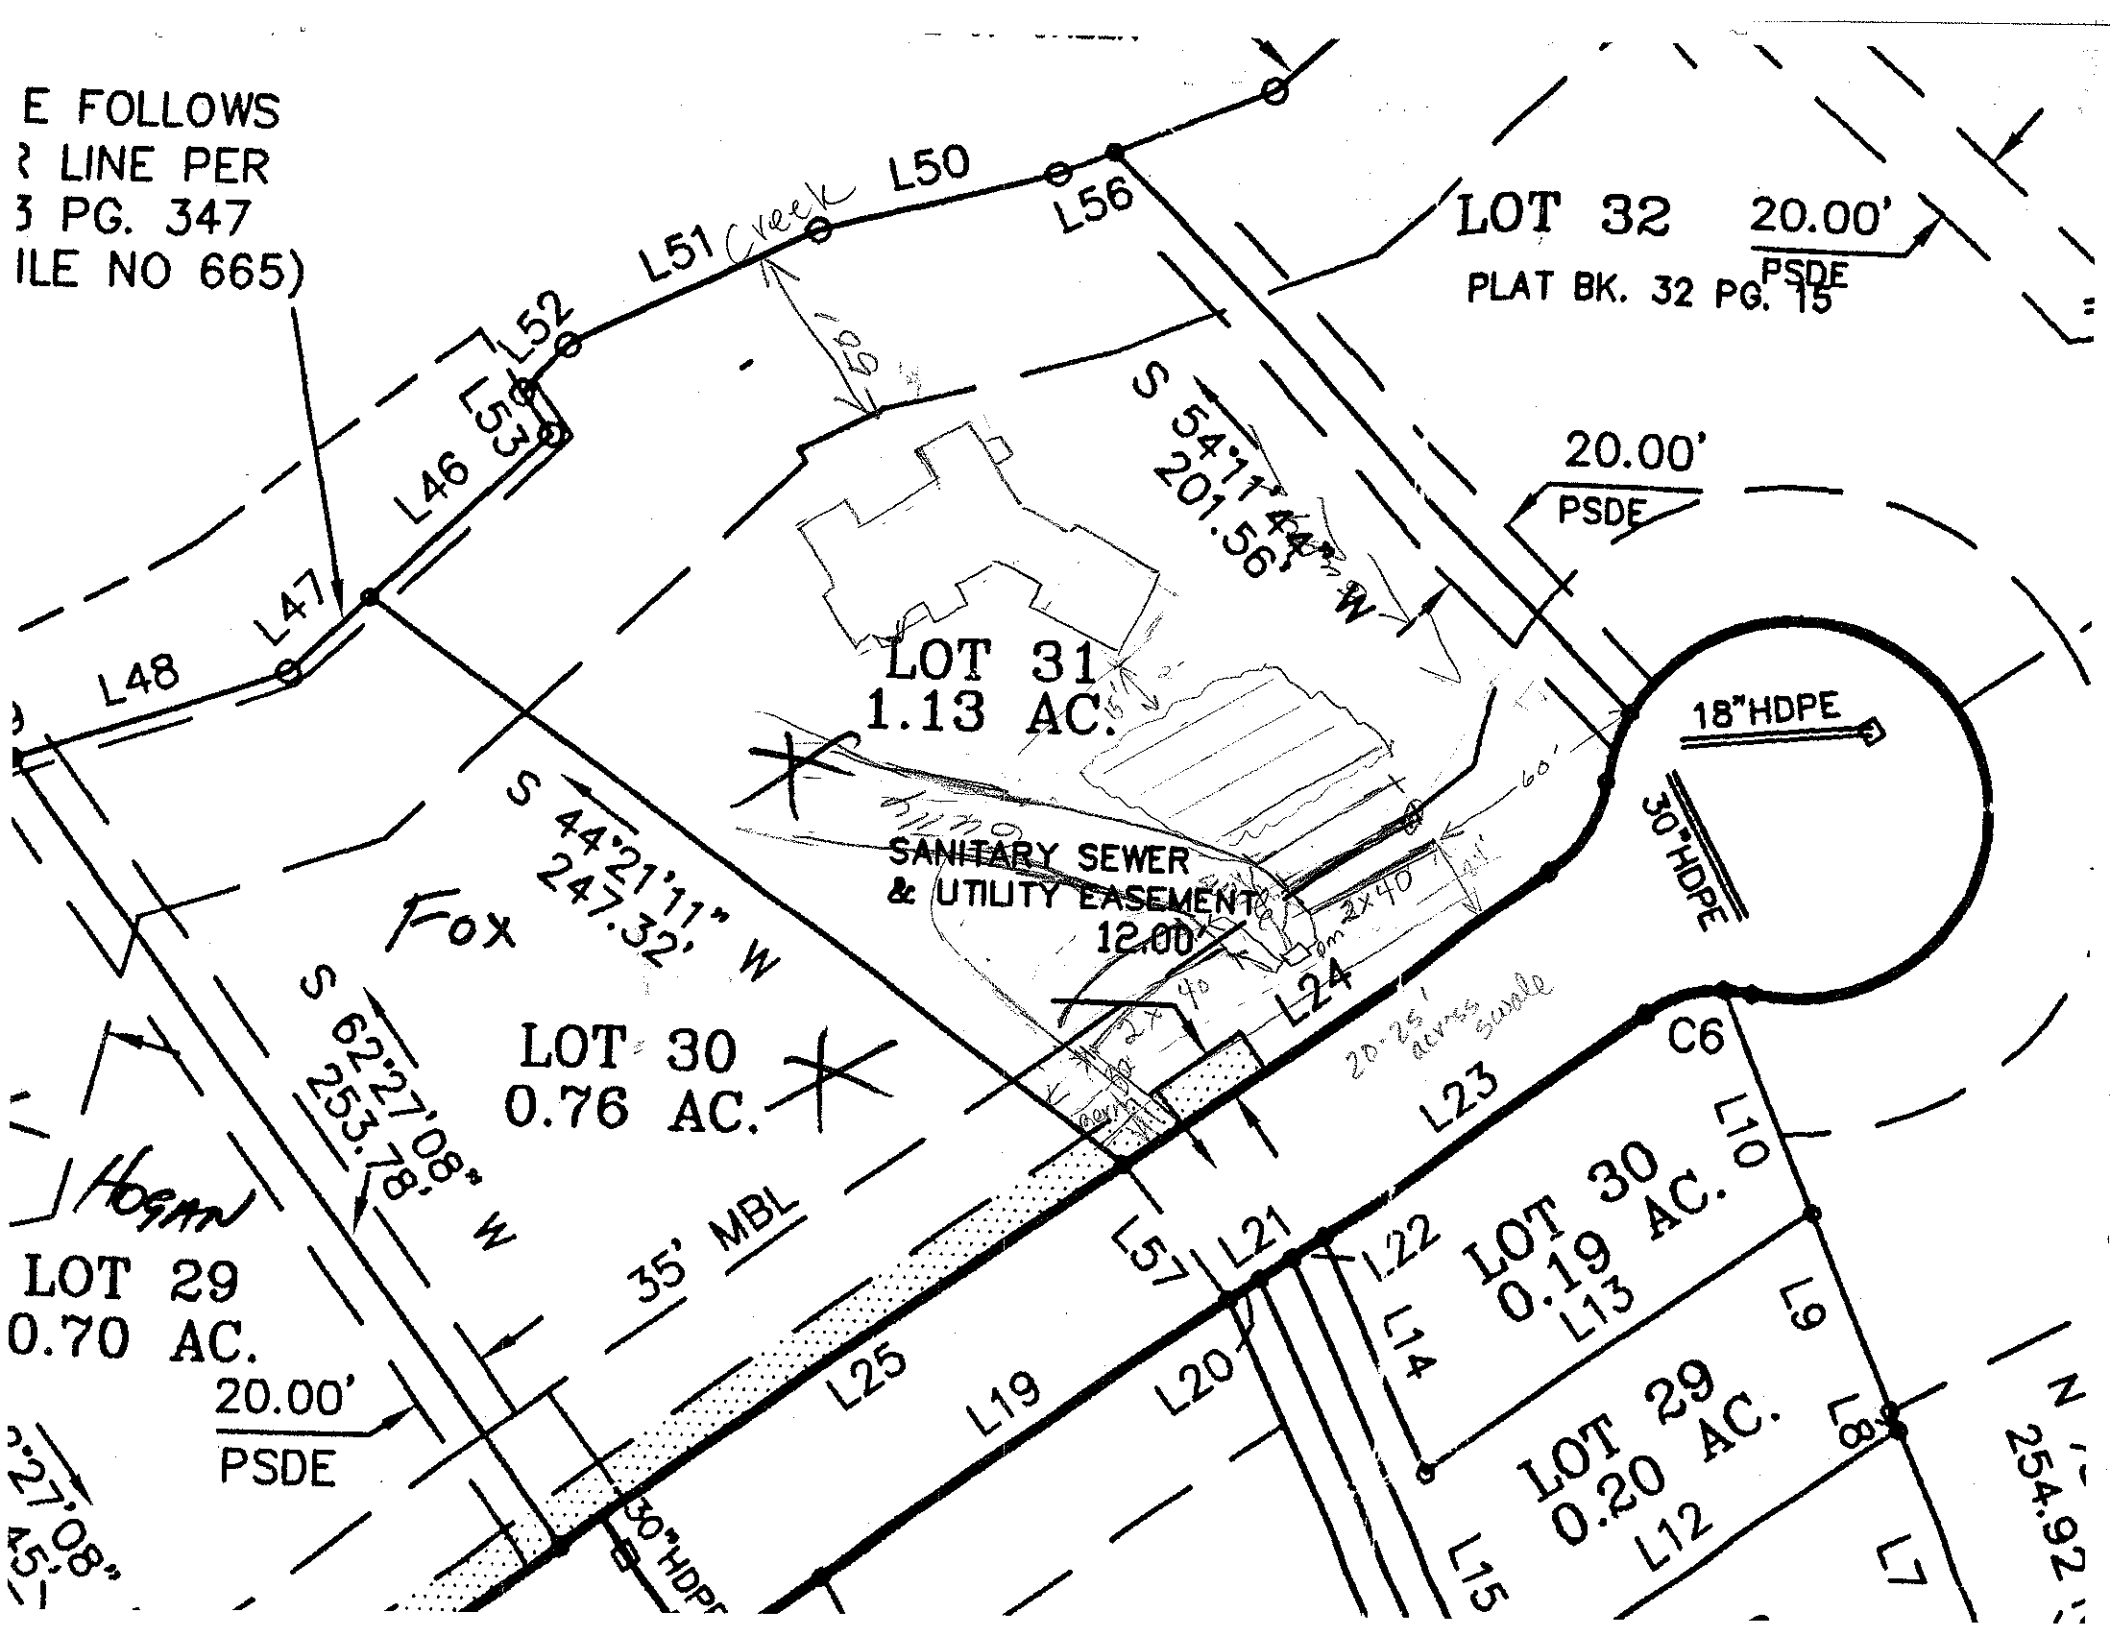
WATER SUPPLY: ☐ Private ☐ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☒ Auger Boring ☐ Pit ☐ Cut TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	10%	0-5	sbk DBrL			48			.3
		5-25	sbk C	Gr ss sp SE					
		25-48	sbk Cl	Gr ss sp					
2		0-3	sbk DBrL			48			.3
		3-27	mo sbk C	Gr ss sp SE					
		27-48	wk sbk Cl	Gr ss sp SE few sap					
3		0-5	sbk L			48	few sap		.3
		5-28	sbk C	Gr ss sp SE					
		28-48	wk sbk Cl	Gr ss sp					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	yes	yes
System Type(s)	PPBPS	PPBPS
Site LTAR	.3	.3

COMMENTS: _____

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: J Melville
OTHER(S) PRESENT: _____


E FOLLOWS
R LINE PER
3 PG. 347
ILE NO 665)
LOT 32
PLAT BK. 32 PG. 15
20.00'
PSDE
L50
L51
L52
L53
L46
L47
L48
L56
Creek
S 54°11'44" W
201.56'
LOT 31
1.13 AC.
18"HDPE
30"HDPE
SANITARY SEWER
& UTILITY EASEMENT
12.00'
S 44°21'11" W
247.32'
Fox
LOT 30
0.76 AC.
S 62°27'08" W
253.78'
L24
L23
C6
L10
L9
L8
L7
LOT 30
0.19 AC.
L13
L14
L22
LOT 29
0.20 AC.
L12
L15
LOT 29
0.70 AC.
Hogan
35' MBL
L57
L21
L20
L19
L25
30"HDPE
N
254.92