DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Hoke Co.

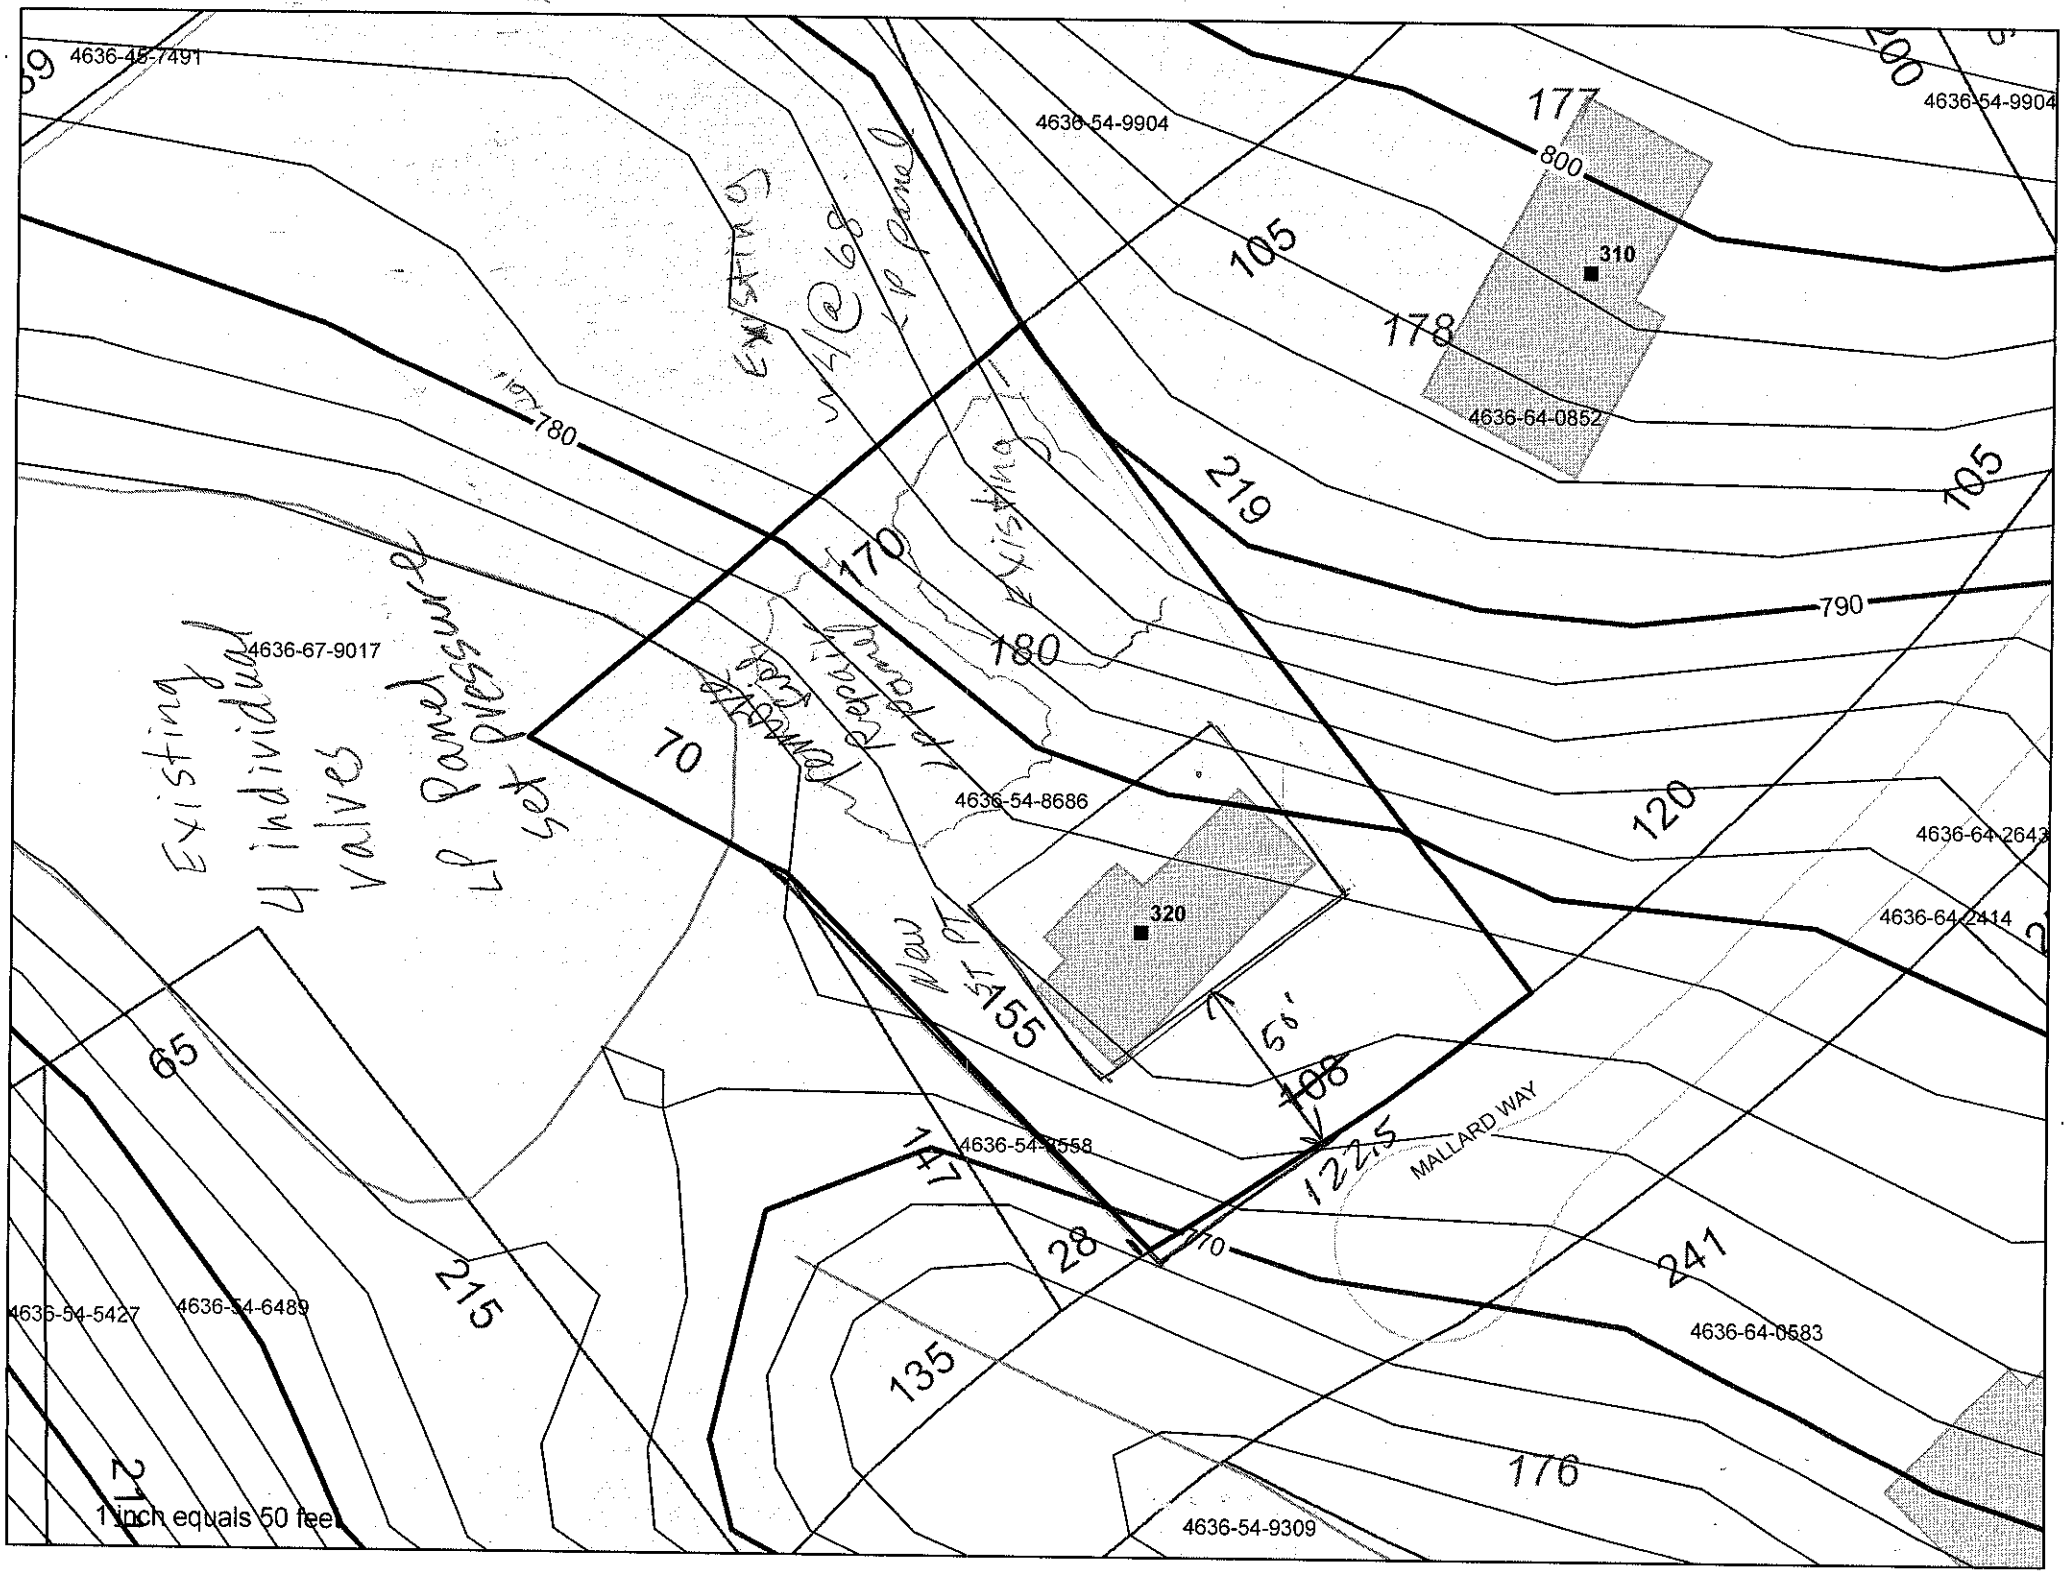
OWNER: Mallard Head Country Club #180
ADDRESS: _____ APPLICATION DATE _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 480 exist DATE EVALUATED: 6-6-06
LOCATION OF SITE: _____ PROPERTY SIZE: _____
WATER SUPPLY: ☐ Private ☒ Public ☐ Well ☐ Spring ☐ Other _____ PROPERTY RECORDED: _____
EVALUATION METHOD: ☒ Auger Boring ☐ Pit ☐ Cut TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-10	l sbk/gr scl	fr		48			PS .13
		10-48	l sbk C+Sapo	fr ss/sp≤E moist					
2									
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: J Melville
OTHER(S) PRESENT: _____

COMMENTS: _____


4636-45-7491
4636-54-9904
4636-54-9904
177
800
105
310
178
4636-64-0852
105
180
170
219
790
4636-67-9017
Existing 4 individual valves
LP Powered pressure set
70
Existing 4" Gas Riser
Proposed 4" Gas Riser
180
4636-54-8686
120
4636-64-2643
320
4636-64-2414
New 5' PT
455
5'
65
108
4636-54-9558
147
1225
MALLARD WAY
28
70
241
215
4636-54-5427
4636-54-6489
4636-64-0583
135
176
4636-54-9309
1 inch equals 50 feet