Chuck Peters - present owner Aug, '93 ORR

4636 76 8114

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Knox, Black & Briggs, Inc DATE 5/15/89 2 ACR PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION Building site on Spring Run Drive. Drainfield easement at end of Billy Joe's Blind S. R. No. _____

SUBDIVISION NAME Mallard Head LOT NO. 132 SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms _____

Garbage Disposal Unit Yes (✓) No ( )

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Easement Area: 37' x 100'+

Character & Porosity of Soil clay

Percolation Rate ~.3

Topography 2%

Depth to Water Table 4'+

Rock or other impervious formations none observed.

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

P.T 1500

Size of Tank 1500 Gals.

Nitrification Field:


No. of Lines 4

Sq. Ft. _____ Linear Ft. 200' of

Depth of Stone in Lines 16" T & T

Water Supply: Individual ( )

Public ( )

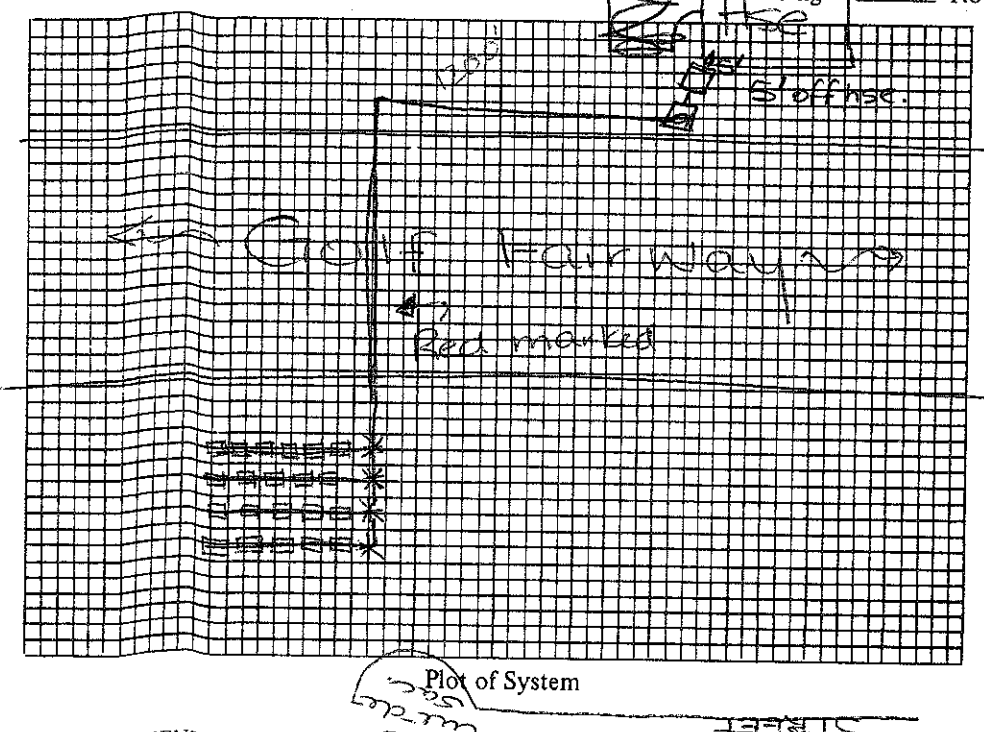

Installed by Bobby Mayhew

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY DRH, R.S.

COMMENTS: Checked drainfield lines (4 total) 50' ea.
High water alarm checked 5/15/89

CERTIFICATE OF COMPLETION BY Andrew C. Pierce, R.S. DATE 5/15/89

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold