IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System — G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Tom Price DATE 9-23-82 PERMIT NO. ______

PHONE: Business ______ Home ______

LOCATION 1100, TL 1179 TR ~~Billy Joes Blind~~ Old Squaw Trail TR Billy Joe's Blind TR Pintail Road 3rd lot on R S. R. No. ______

SUBDIVISION NAME Mallard Head LOT NO. 137 SECTION OR BLOCK NO. ______

House (X) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 3 No. Bathrooms 3

Garbage Disposal Unit Yes (X) No ( )

Auto. Dishwasher Yes (X) No ( )

Auto. Wash. Machine Yes (X) No ( )

Site Suitable Yes ( ) No ( )

Lot Area 15,000 ft² +

X Basement with Plumbing ______ Basement without Plumbing ______ No Basement


Character & Porosity of Soil Clay loam (Fairway #10 area see deed easement)

Percolation Rate ~80 min — 0.6 gal/ft²

Topography 4-10%

Depth to Water Table 4'+

Rock or other impervious formations NONE observed

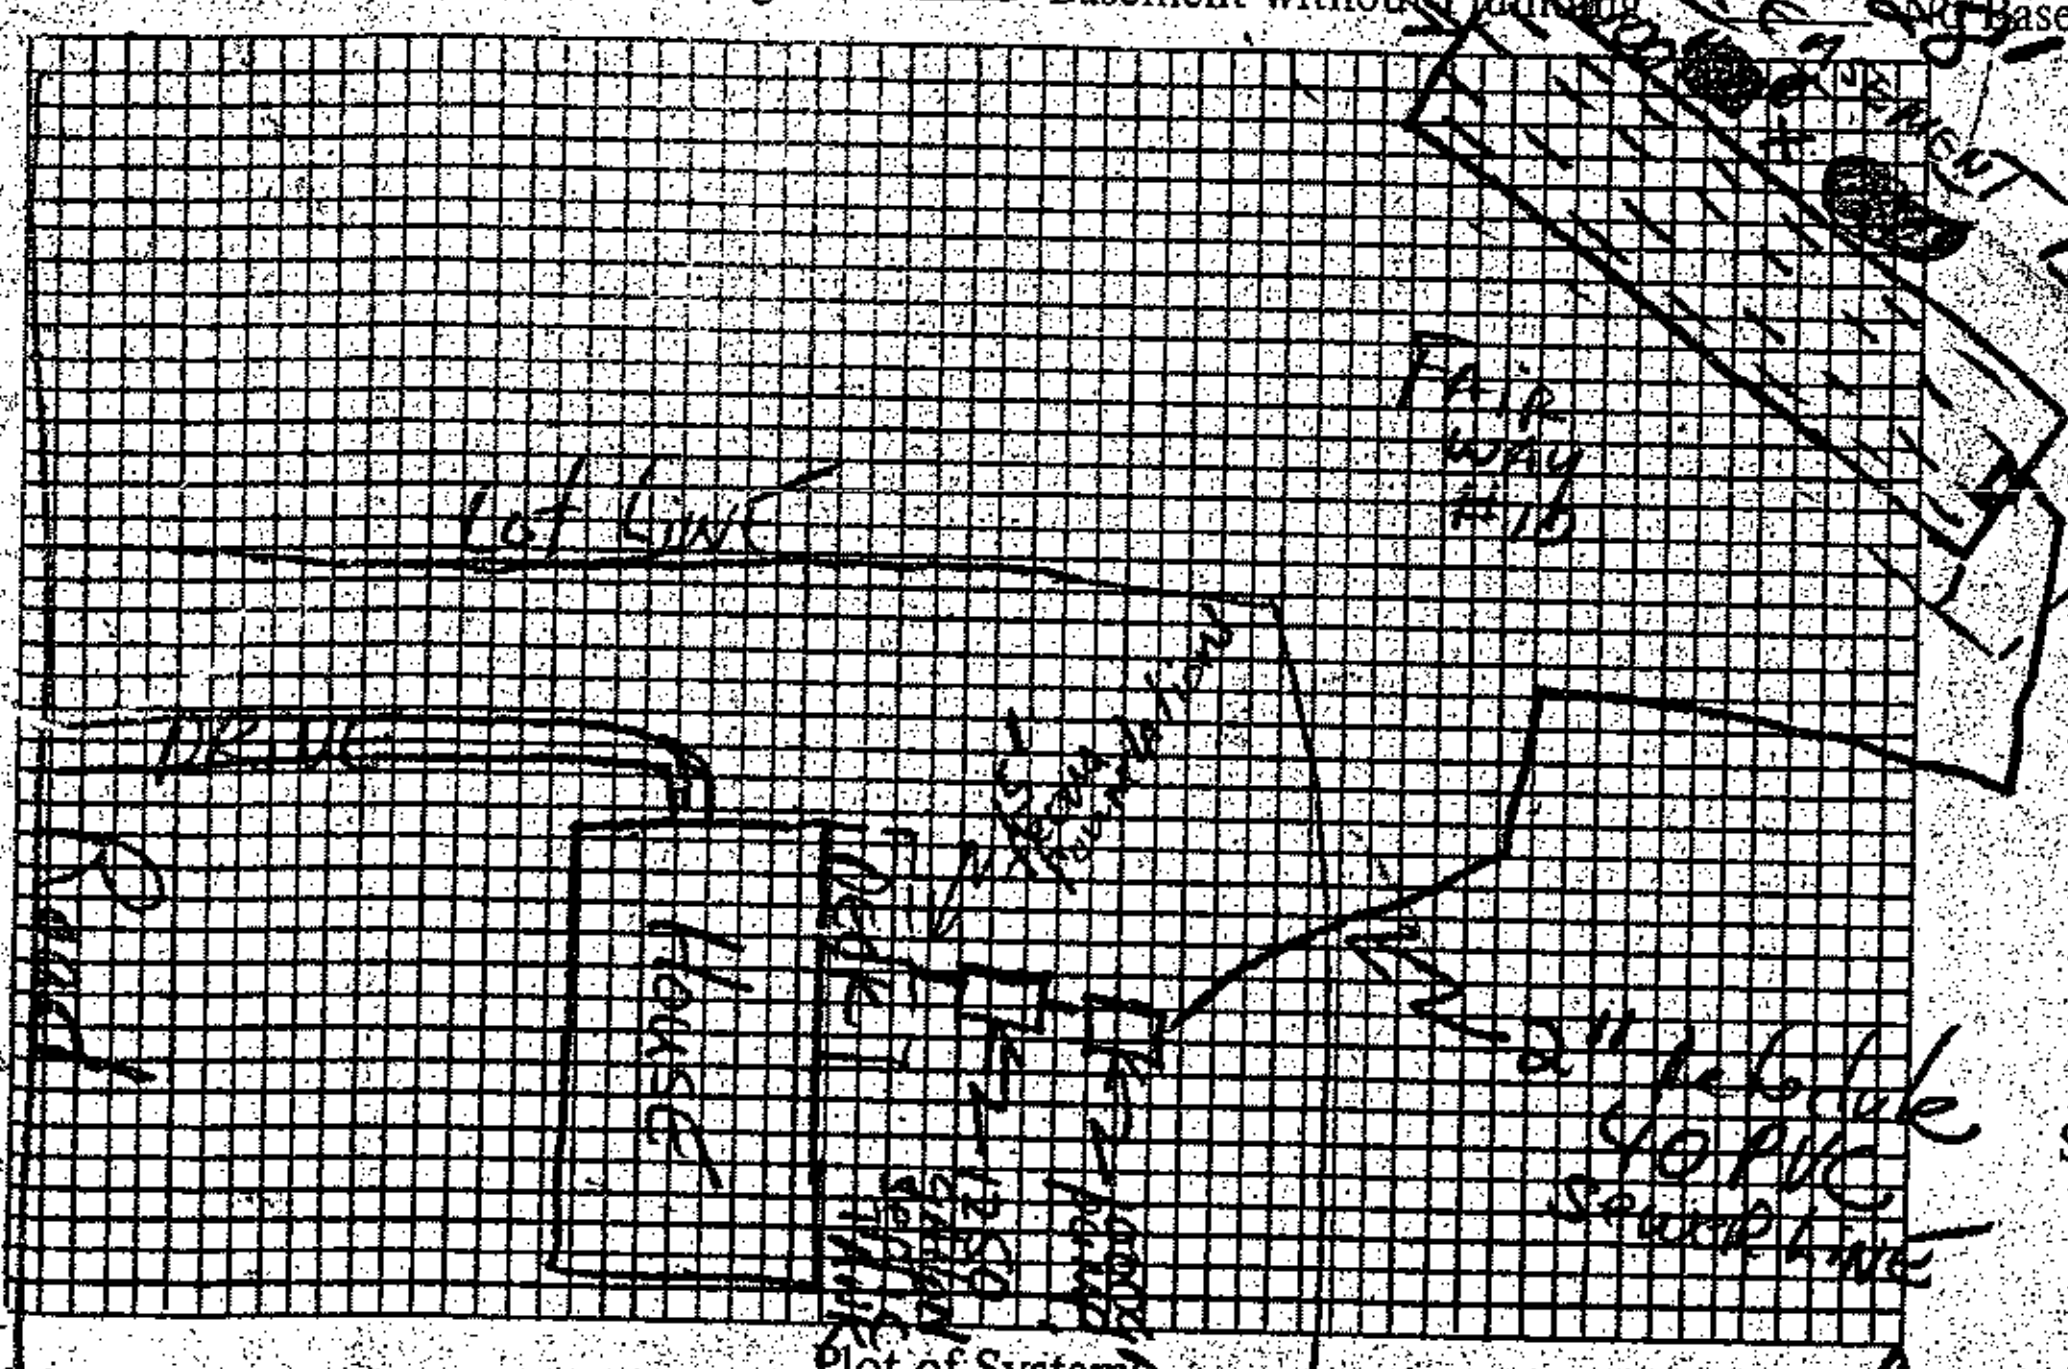

Plot of System

Size of Tank 1250 Gals. (1000 gallon pump tank)

Nitrification Field:

No. of Lines 3

Sq. Ft. 900 Linear Ft. 300

Depth of Stone in Lines 12"

Water Supply: Individual ( )

Public (X) Community Water

Installed by ______

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Thomas L Price

IMPROVEMENTS PERMIT BY Fred Clemmer + R.W. Johnson

COMMENTS: Use good quality effluent pump of at least ½ horse power; use an alarm located in house to warn of malfunction of pump; change easement area plotted to dimensions 28' x 120'; Distribution box to be located at area near backside of Lots 41 & 50

CERTIFICATE OF COMPLETION BY ______ DATE ______

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold