4-4:30

# IREDELL COUNTY HEALTH DEPARTMENT

## (SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Tom Price DATE 9-23-82 PERMIT NO. 181

PHONE: Business _____ Home _____

LOCATION 1190, TL 179, TR Billy Joes Blvd TR Billy Joes Blvd TR Pintail Road 3rd lot on R S. R. No. _____

SUBDIVISION NAME Mallard Head LOT NO. 137 SECTION OR BLOCK NO. _____

House (X) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 3


| | | | | | |
|---|---|---|---|---|---|
| Garbage Disposal Unit | Yes (X) | No ( ) | Character & Porosity of Soil | Clay loam | |
| Auto. Dishwasher | Yes (X) | No ( ) | Percolation Rate | ~80 min | ~0.6 gal/ft² |
| Auto. Wash. Machine | Yes (X) | No ( ) | Topography | 4-10% | |
| Site Suitable | Yes ( ) | No ( ) | Depth to Water Table | 4+ | |
| | | | Rock or other impervious formations | NONE observed | |

Lot Area 15,000ft² +

_X_ Basement with Plumbing _____ Basement without Plumbing _____ Crawl Space

FAIRWAY #10 ARE See deed easement

1000 GALLON PUMP TANK

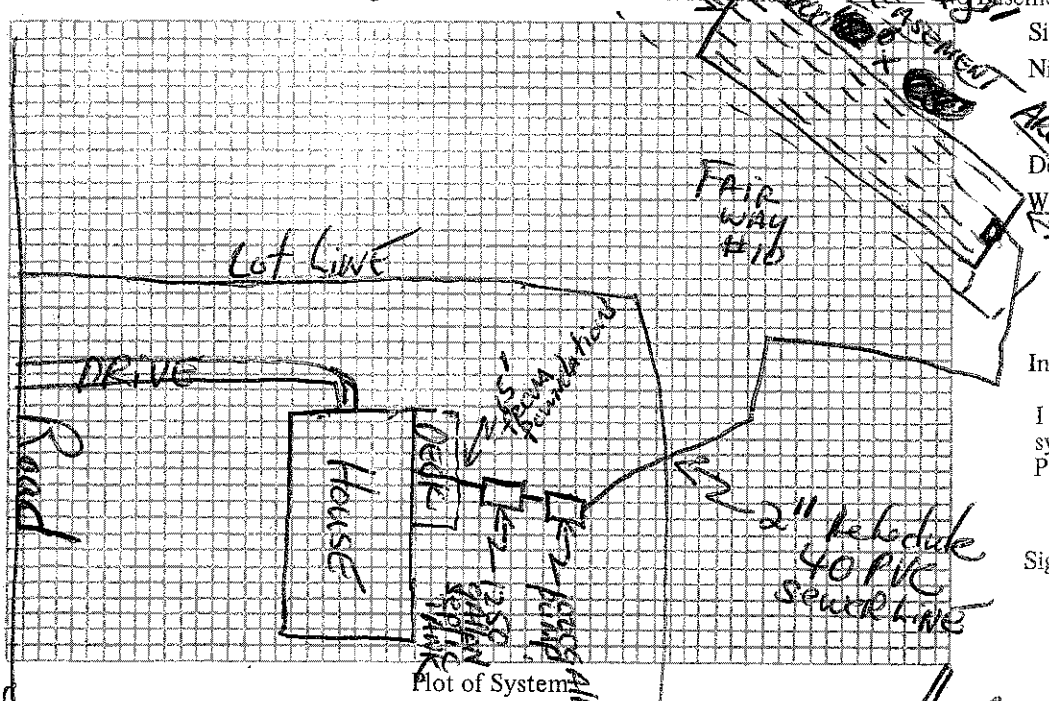


Plot of System

Size of Tank 1250 Gals.

Nitrification Field:
No. of Lines 3
Area Sq. Ft. 900 Linear Ft. 300
Depth of Stone in Lines 12"

Water Supply: Individual ( )
Public (X) Community WATER

Lot 50

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Thomas L Price

IMPROVEMENTS PERMIT BY Fred Clemmer + R. W. Johnson

COMMENTS: Use good quality effluent pump of at least ½ horse power; use AN Alarm located in house to warn of Malfunction of pump; Change EASEMENT AREA plotted to dimensions 28' x 120'; Distribution box to be located AT deck NEAR backside of Lots 49+50

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold