4636819847

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Larry Self DATE 7 17 87 PERMIT NO. ______

PHONE: Business ______ Home ______

LOCATION 1100 R 1179 (Canvasback) R Highland Drive round curve on Rt. S. R. No. ______

SUBDIVISION NAME Woodland Hills LOT NO. 35 SECTION OR BLOCK NO. 3

House (✓) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 3 No. Bathrooms 2½

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Lot Area 20000 ft²

Character & Porosity of Soil clay


Percolation Rate 2.35

Topography 2-6%

Depth to Water Table 4'+

Rock or other impervious formations none obs.

______ Basement with Plumbing ______ Basement without Plumbing ✓ No Basement

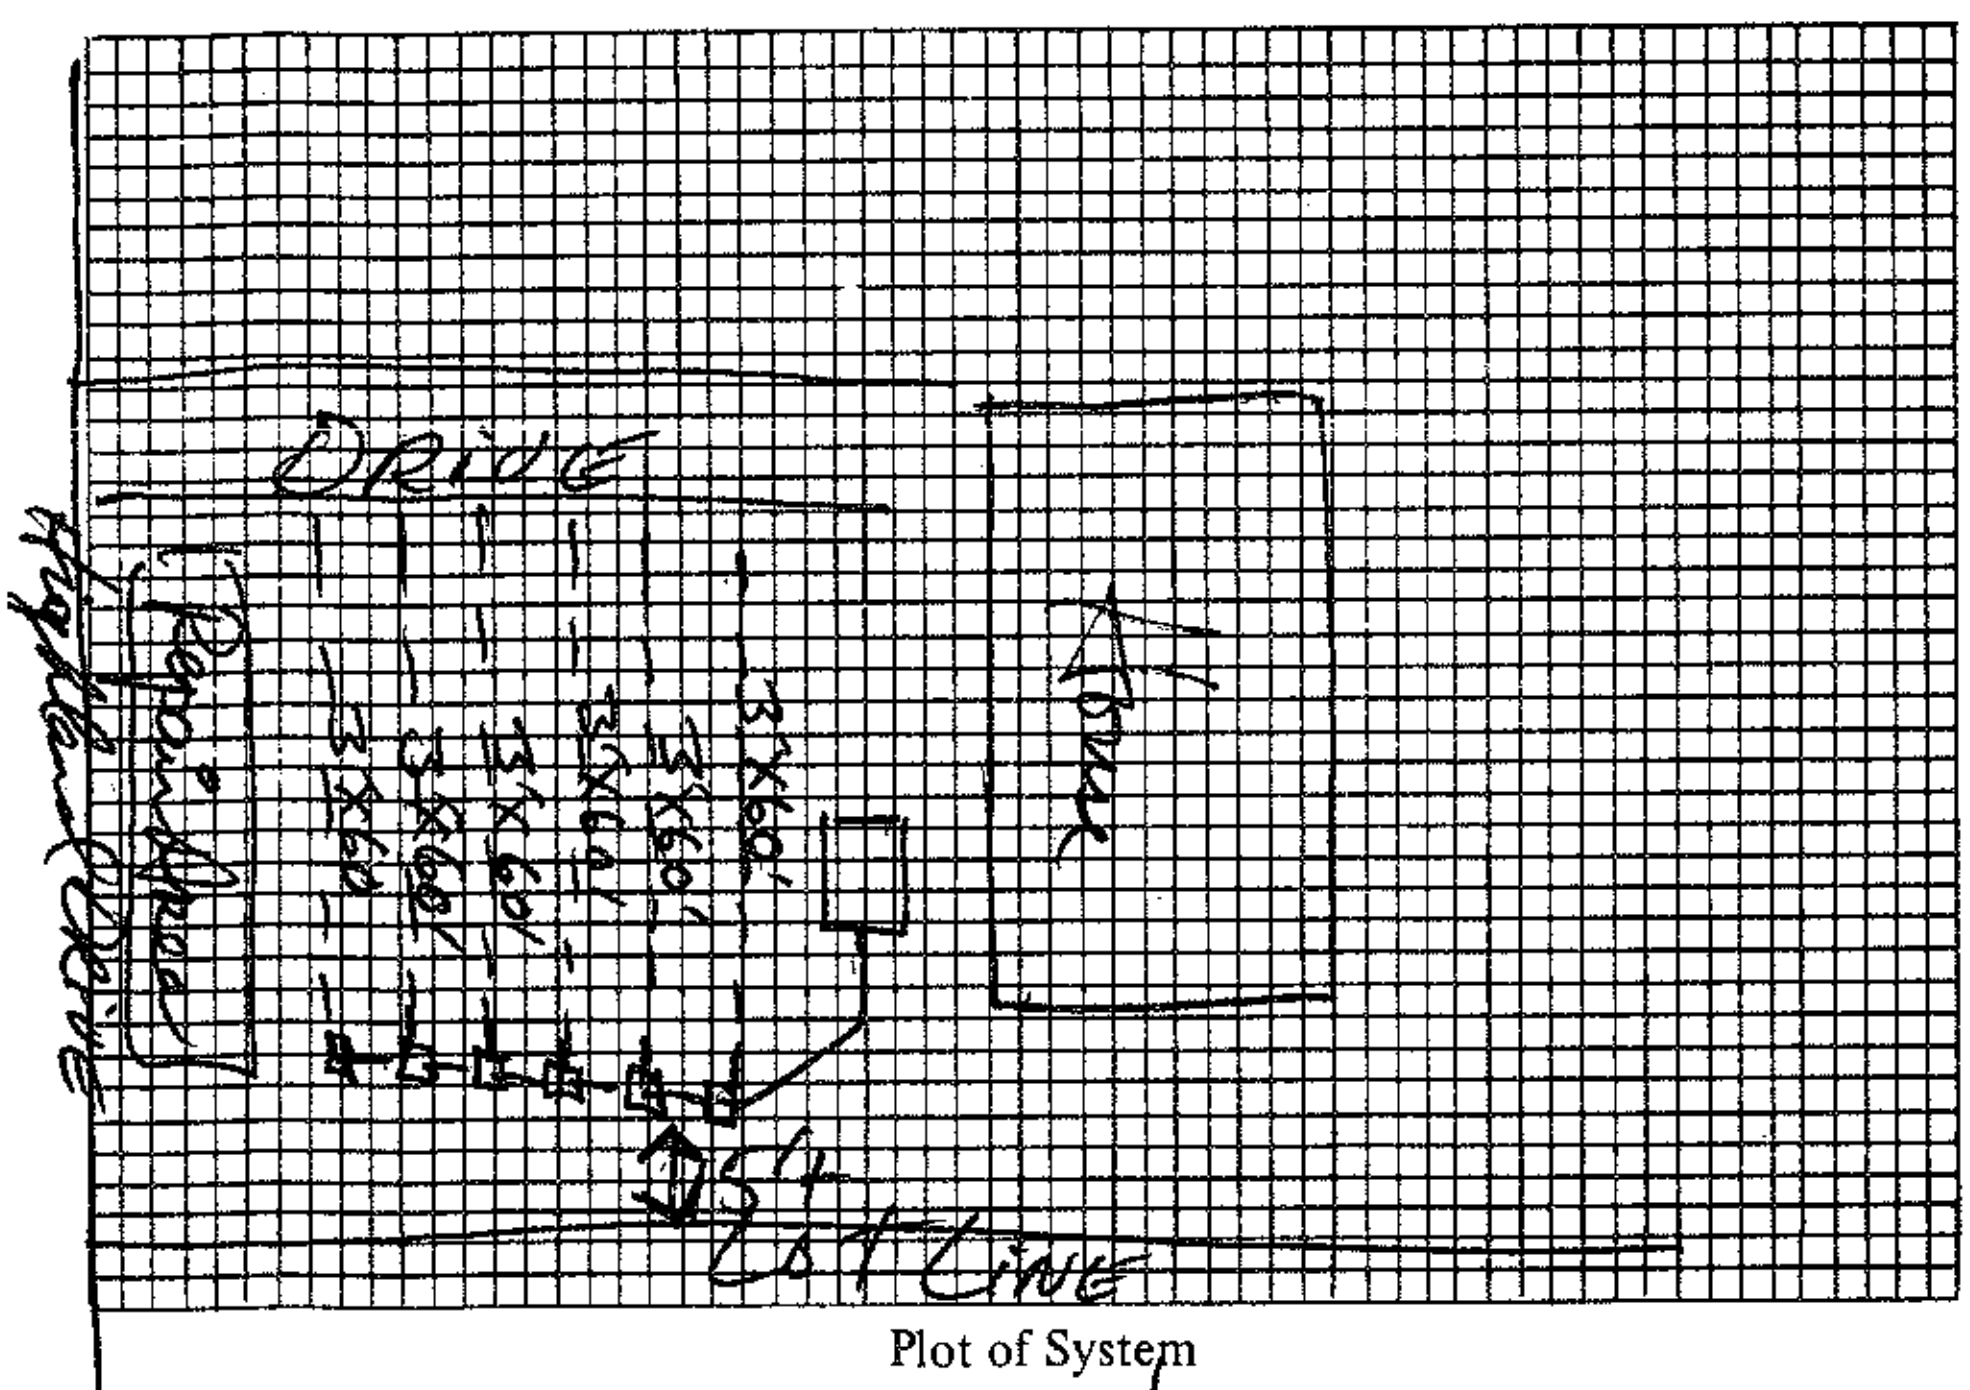

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 6

Sq. Ft. 1080 Linear Ft. 360

Depth of Stone in Lines 12"

Water Supply: Individual ( )

Public (✓)

Community Well

Installed by F J Ervin

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

IMPROVEMENTS PERMIT BY DRH

COMMENTS: ______

CERTIFICATE OF COMPLETION BY DR Hinson, R.S. DATE 7-17-87

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold