IREDELL COUNTY HEALTH DEPARTMENT 4636948157

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR W. Smith Kirk DATE 9-2-87 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 1100 TL 1179 (Canvasback) TL Broadbill on Rght ~500' past jct. w/ Ringneck S. R. No. _____

SUBDIVISION NAME Woodland Hills LOT NO. 80 SECTION OR BLOCK NO. 5


House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2
Garbage Disposal Unit Yes (✓) No ( )
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )

Character & Porosity of Soil clay
Percolation Rate ~.4
Topography 4-10% complex
Depth to Water Table 4'+
Rock or other impervious formations none obs.

Lot Area 20000ft²+

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

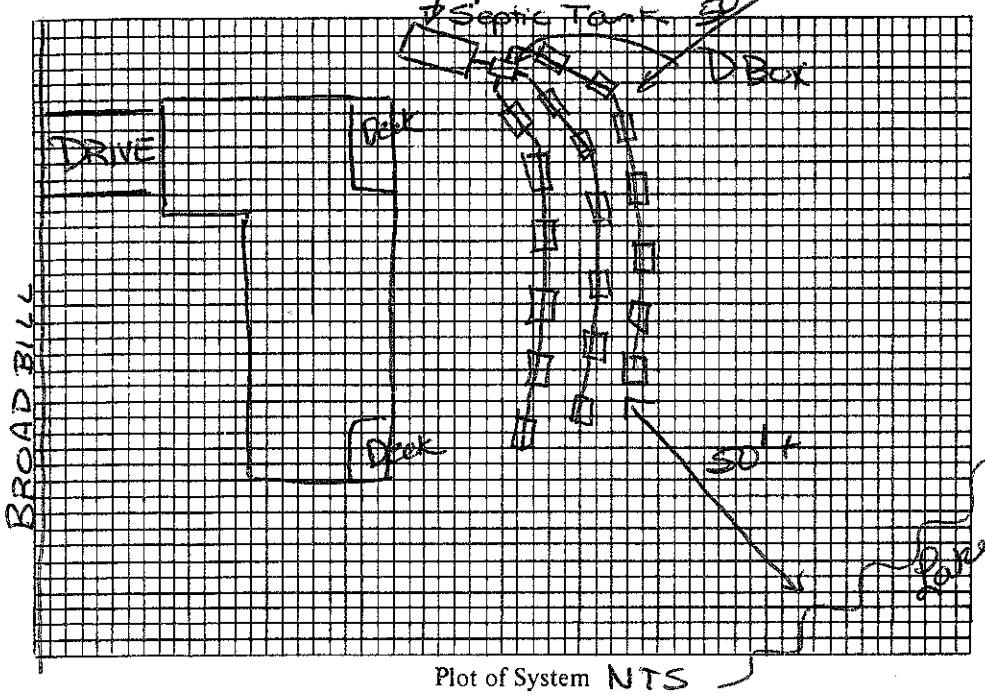

Plot of System NTS

ACP (9-2-87)
Size of Tank TOK 1500 Gals.
Nitrification Field:
No. of Lines 3
Sq. Ft. _____ Linear Ft. 150' T&T panels
Depth of Stone in Lines _____
Water Supply: Individual ( )
Public (✓)

Installed by FJ ERVIN

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY DRH

COMMENTS: _____

CERTIFICATE OF COMPLETION BY Andrew C. Price DATE 9-2-87

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

0682

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR W. Smith Kirk DATE 4-28-87 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 1100 TL 1129 (Canvasback) TR Broadbill on Rt. ~500' past jct. with Ringneck S. R. No. _____

SUBDIVISION NAME Woodland Hills LOT NO. 80 SECTION OR BLOCK NO. _____


House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes (*)	No (✓)	Character & Porosity of Soil	clay	
Auto. Dishwasher	Yes (✓)	No ( )	Percolation Rate	4-10-90	complet
Auto. Wash. Machine	Yes (✓)	No ( )	Topography	44	
Site Suitable	Yes (✓)	No ( )	Depth to Water Table		
			Rock or other impervious formations	none obs.	

Lot Area 20000 sq ft

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

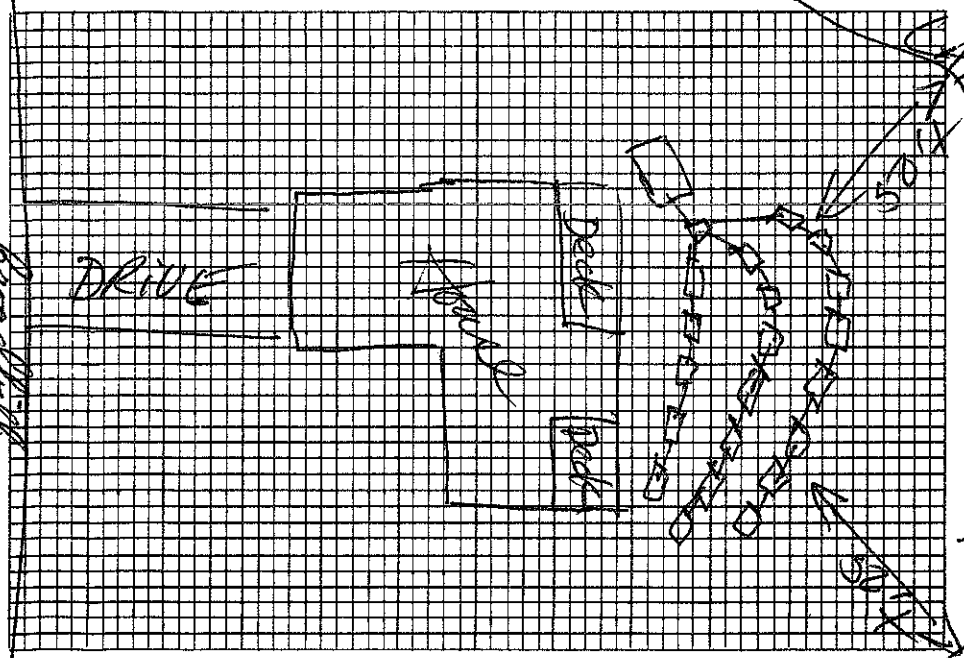

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 3
Sq. Ft. _____ Linear Ft. 150' of 1167
Depth of Stone in Lines 24"
Water Supply: Individual ( ) Public (✓) panels

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

X Signed: Lynne Keener

IMPROVEMENTS PERMIT BY David R. Hamrick R.S.

COMMENTS: Will have garbage disposal, increase tank size to 1250 gal min. Set house far enough off lake to leave room for sewage system repair. Pull plumbing out high enough to install system shallow (6" natural cover). Follow contours!

CERTIFICATE OF COMPLETION BY _____ DATE _____

~~EXISTING SYSTEM CHECKED BY:~~ _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold