PIN 4636971380 115 Turnberry Ln.

87338

IREDELL COUNTY HEALTH DEPARTMENT St. Andrews Village Lot 3

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR ABJ Construction DATE April 13, '89 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 1100 TR 1179 TR past 1st Woodlock Loop ~300' on left S. R. No. _____


SUBDIVISION NAME St. Andrews Village LOT NO. 3 SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2
Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site ~~Suitable~~ PS Yes (✓) No ( )
Lot Area ~20000ft²

Character & Porosity of Soil clay
Percolation Rate ue 35
Topography 2-6%
Depth to Water Table 44
Rock or other impervious formations none obs.

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

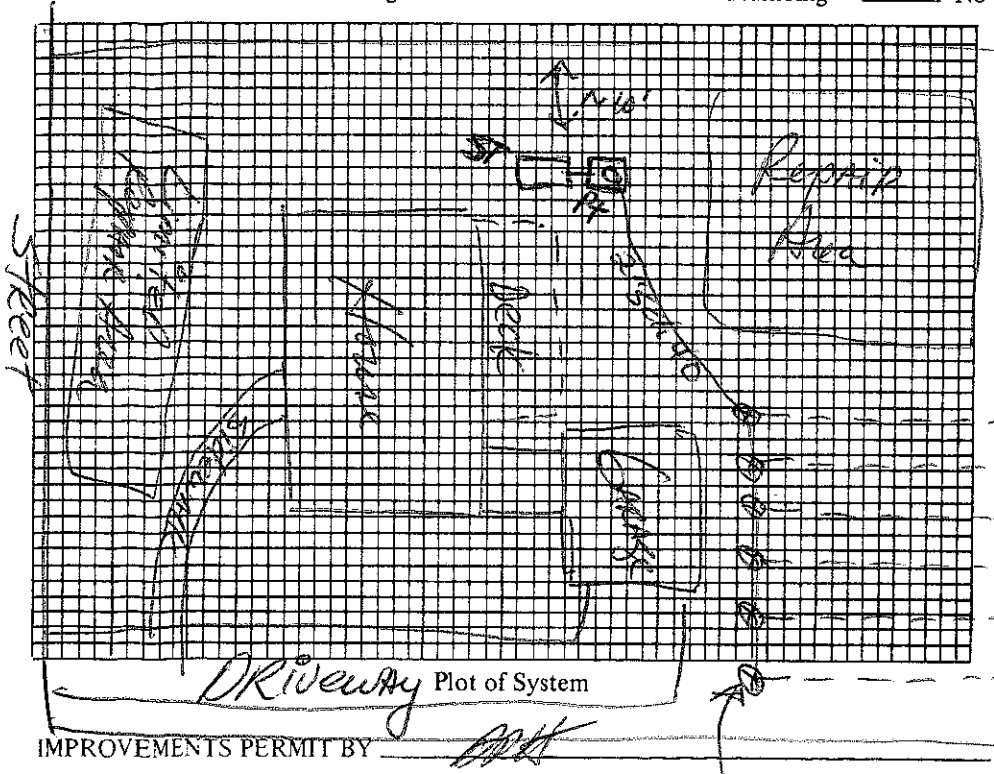

Plot of System

1000 gal.
Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 6
Sq. Ft. 1050 Linear Ft. 350
Depth of Stone in Lines 12"
Water Supply: Individual ( )
Public (✓ CW

Installed by J. L. Bowles

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY _____

COMMENTS: Ball valves
Alarm tested & working but not mounted in house yet.

CERTIFICATE OF COMPLETION BY _____ DATE 4-13-89

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold