8245

Call B. Inspection 2:00

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR TERRY NEAL DATE 6/29/88 PERMIT NO. ____

PHONE: Business ____ Home 892-4966

LOCATION 1100 TL CANVASBACK TL 1st Wood Duck Lp. ~ 1/4 mi on left. (Lot 12). S. R. No. ____

SUBDIVISION NAME LAKESIDE FARM SEC. 1 LOT NO. 12 SECTION OR BLOCK NO. ____

House (✓) Mobile Home ( ) Business ( ) Other ____

No. Bedrooms 3 No. Bathrooms 3


	Yes	No
Garbage Disposal Unit	( )	(✓)
Auto. Dishwasher	(✓)	( )
Auto. Wash. Machine	(✓)	( )
Site ~~Suitable~~ P.S.	(✓)	( )

Character & Porosity of Soil Clayey
Percolation Rate ~.35gpd/ft²
Topography 6%
Depth to Water Table 4'+
Rock or other impervious formations none obs.

Lot Area .83 ACRES ⇒ 20,000ft²+

____ Basement with Plumbing ____ Basement without Plumbing ____ No Basement

P. Tank: 1000 gals.

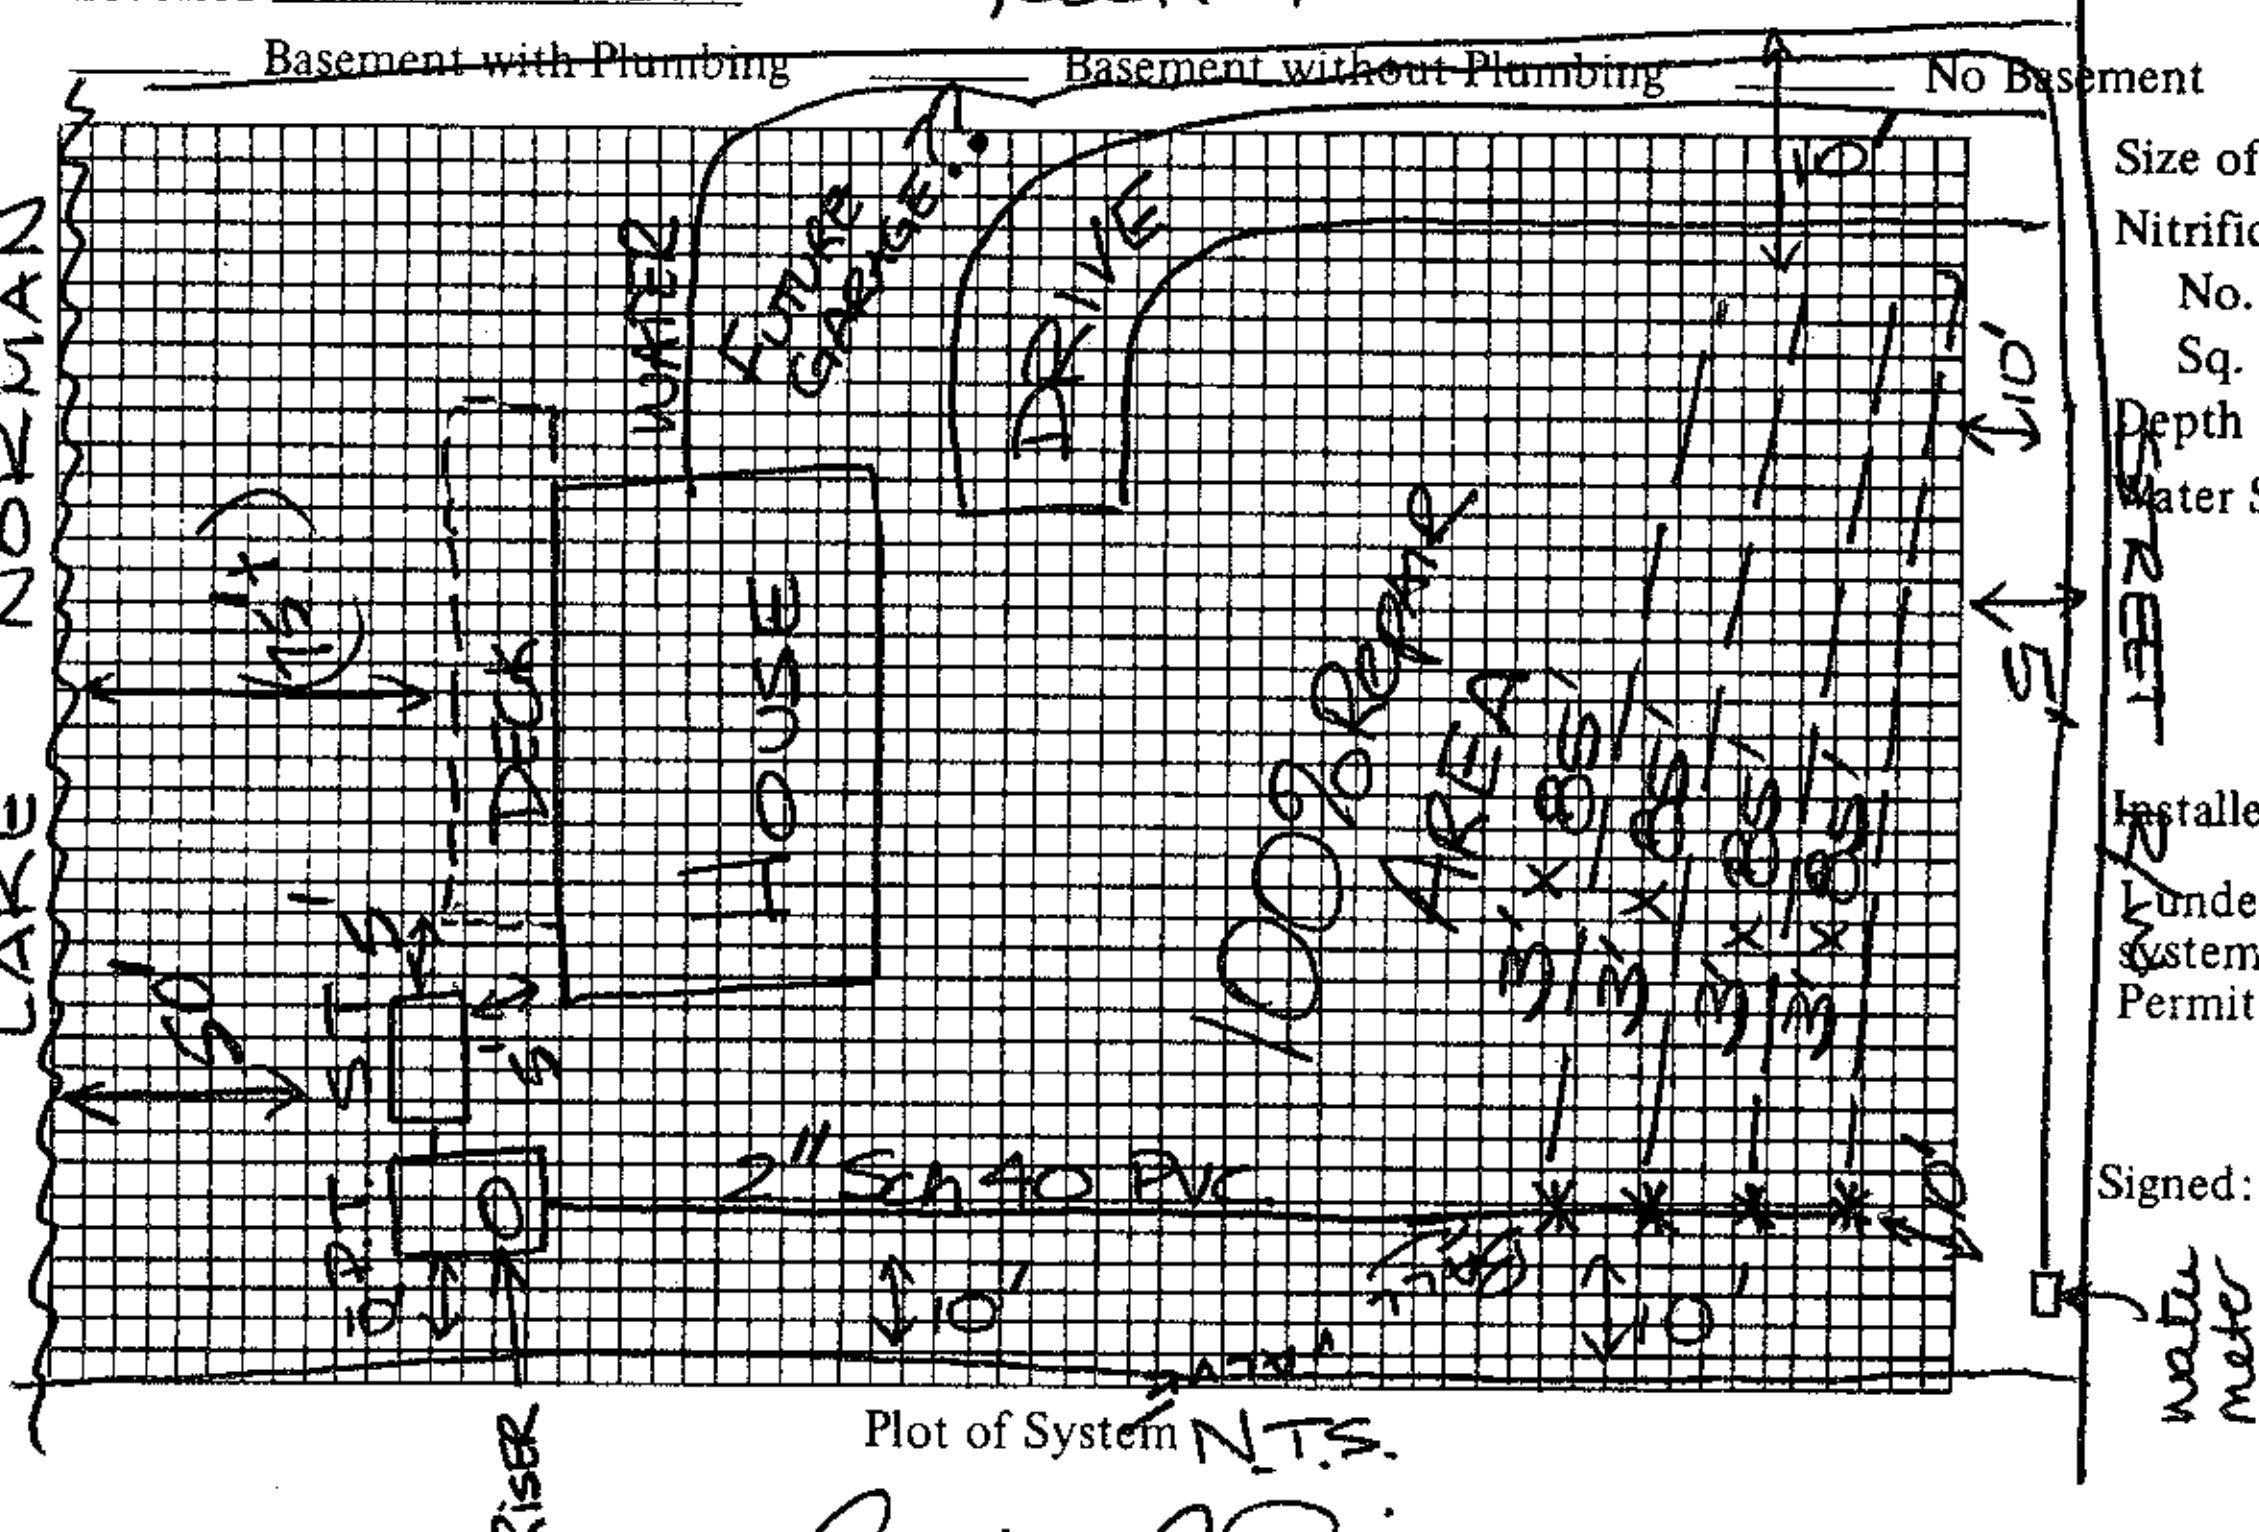

Plot of System N.T.S.

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 4
Sq. Ft. 1020 Linear Ft. 340
Depth of Stone in Lines 12"
Water Supply: Individual ( )
Public (X)

Installed by ____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Terry Neal

IMPROVEMENTS PERMIT BY Andre C Price

COMMENTS: Set tank 5' off any building structure. Pump through 2" Sch 40 PVC. Reduce to 1½" PVC (Sch. 40) w/ 5/32" hole every 5'. 2' pressure head to be acheived on each ditch. Dose Field at 25 gpm w/ ~ 19 TDH. High water alarm/floats

CERTIFICATE OF COMPLETION BY to be mounted and checked before DATE ____

EXISTING SYSTEM CHECKED BY: final completion issued. DATE ____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

system: → ® in repair area - 100% repair will be in area to Rd.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

high water alarm not checked