4637045933

13074

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR: William Reeves DATE: Sept 10, '91 PERMIT NO: 2P-3-A-75

PHONE: Business ______ Home ______

LOCATION: 150 W TR 1168 (McCrary) TR Riverwood 1/2 mile on left

S. R. No. ______

SUBDIVISION NAME: Crescent Lake Norman LOT NO. 75 SECTION OR BLOCK NO. 10

House (✓) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable PS Yes (✓) No ( )

Lot Area 1/2 Acre

Character & Porosity of Soil: PS clay


Percolation Rate: 1.04

Topography: 4%

Depth to Water Table: 4'+

Rock or other impervious formations: none obs.

✓ Basement with Plumbing ______ Basement without Plumbing ______ No Basement

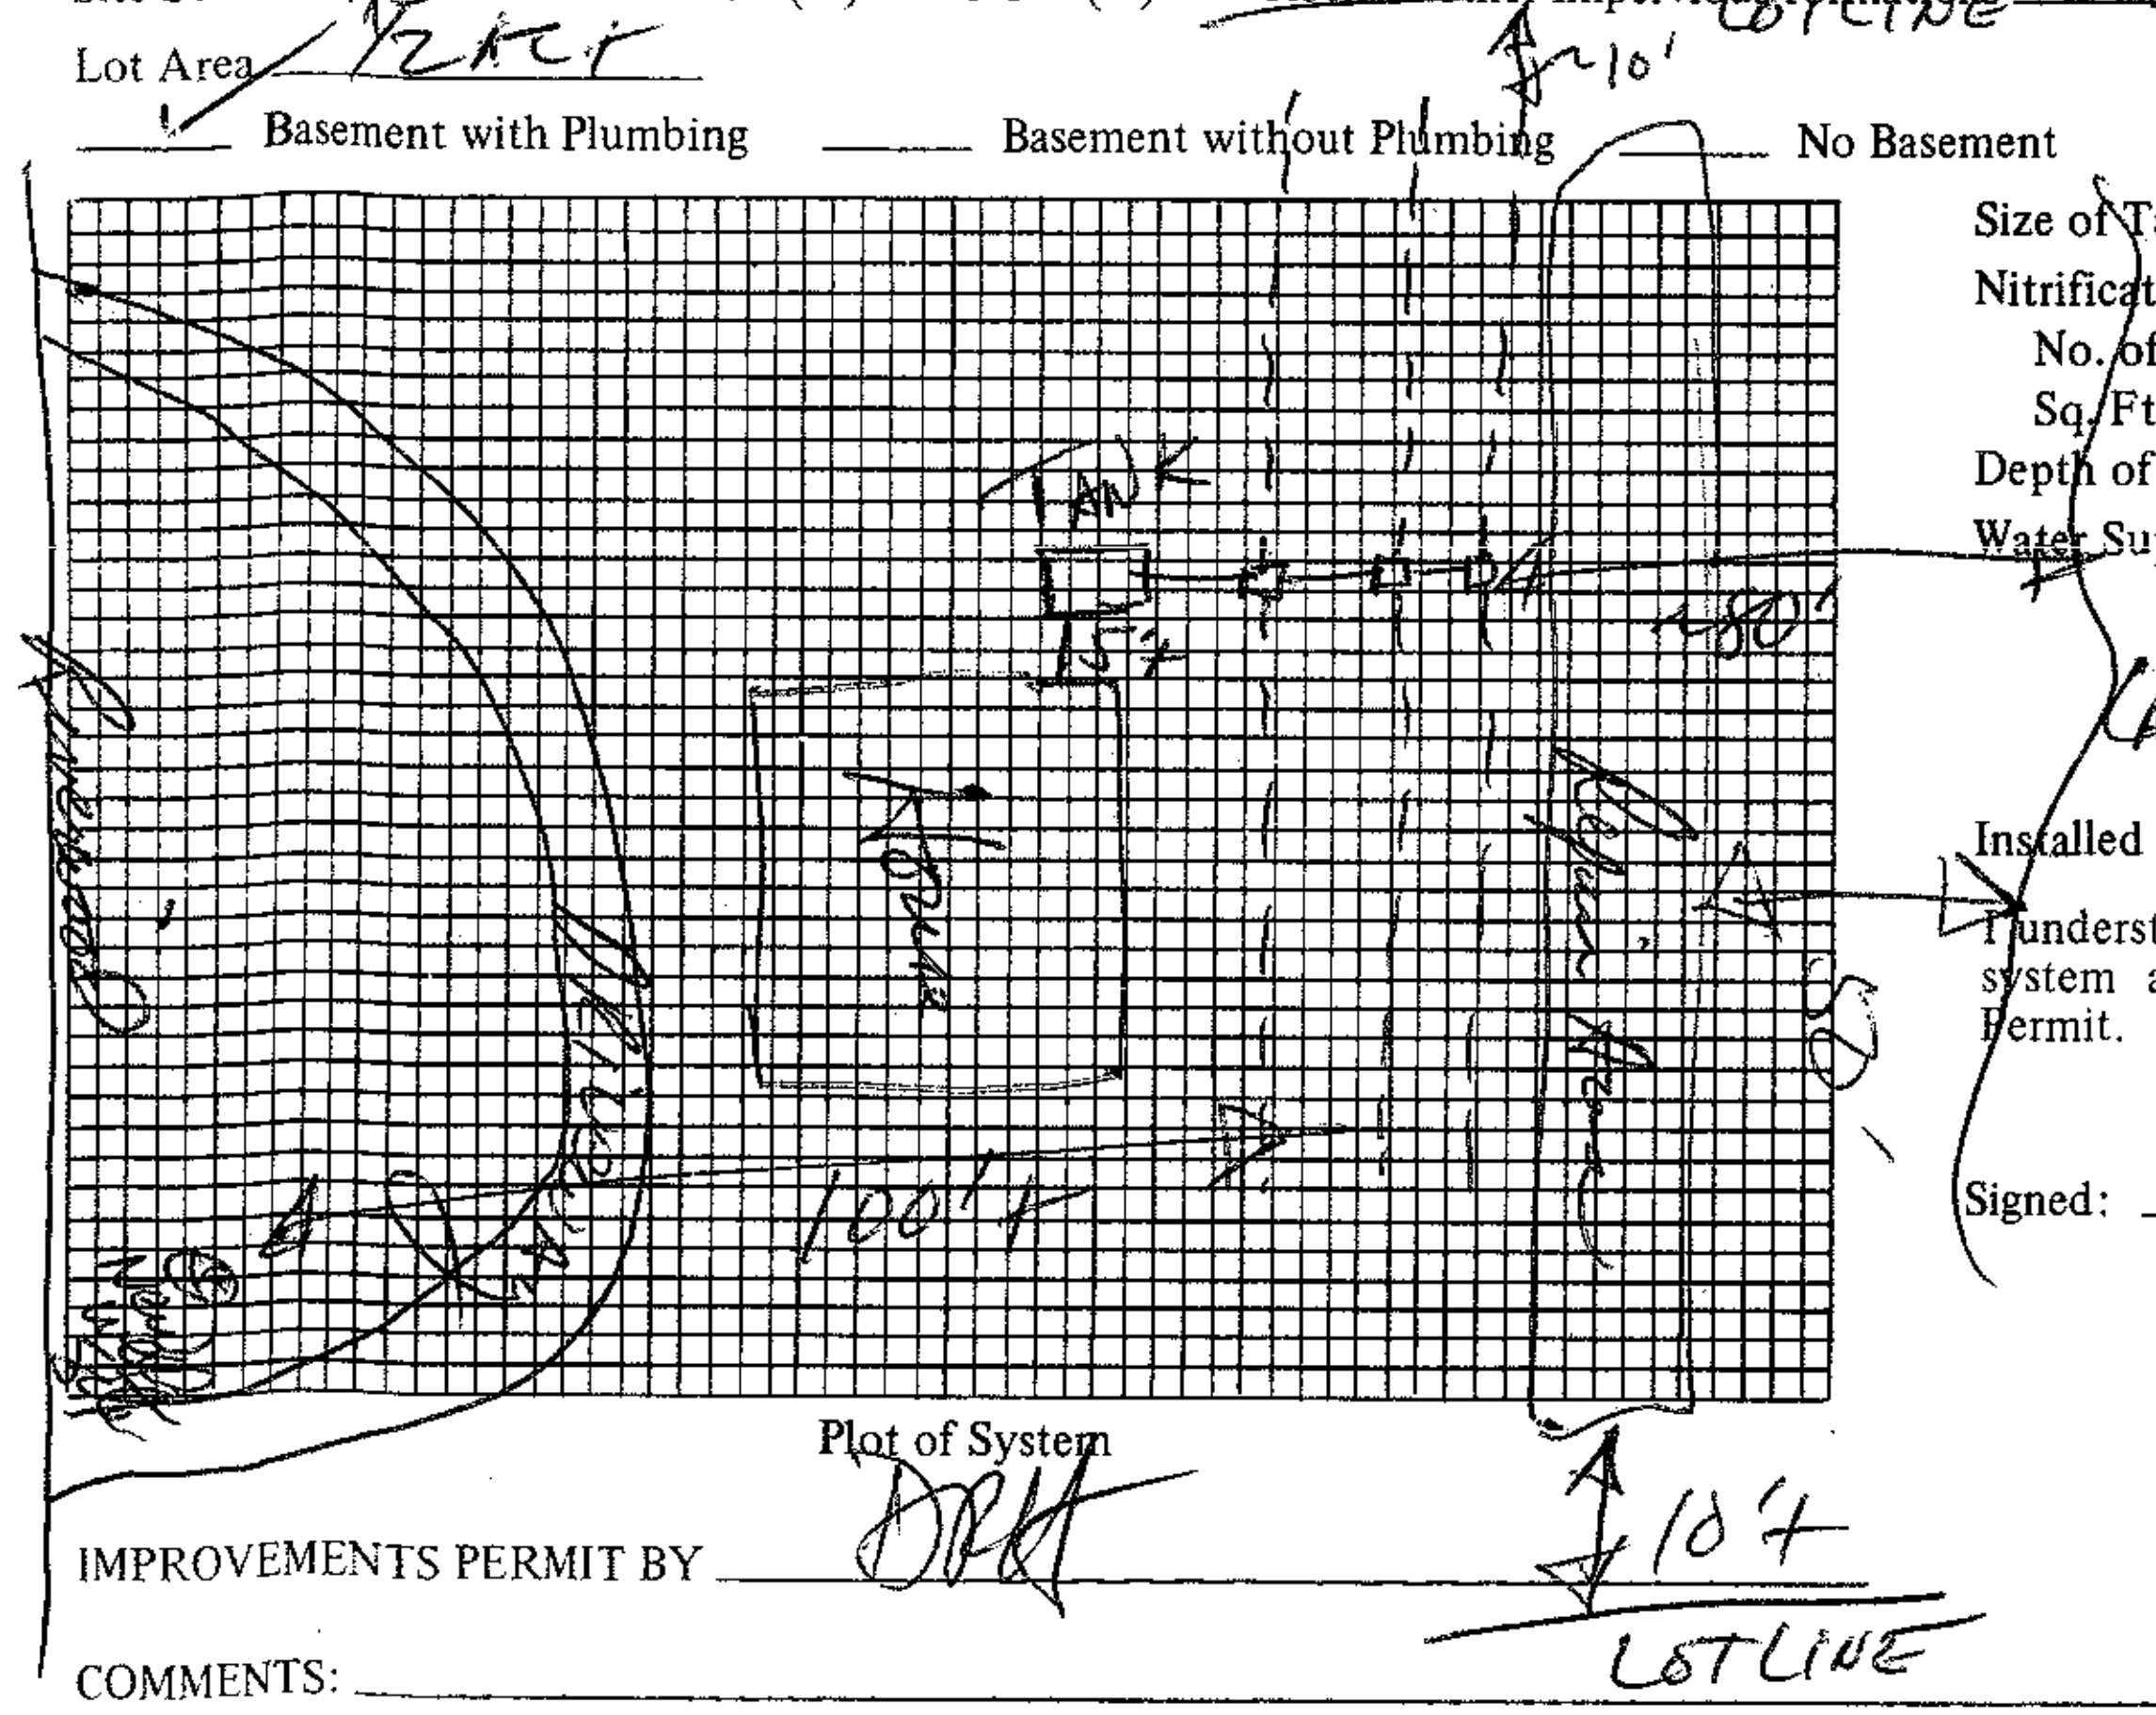

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 6

Sq. Ft. 900+ Linear Ft. 300+

Depth of Stone in Lines 12"

Water Supply: Individual (✓) Public ( )

LAKE

Installed by Ironhorse Grading

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

IMPROVEMENTS PERMIT BY: DRH

COMMENTS: ______

CERTIFICATE OF COMPLETION BY: DRHinson, RS DATE 9-10-91

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

IREDELL COUNTY HEALTH DEPARTMENT

13074

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR William Reaves DATE July 5, 19 PERMIT NO. 213-A75

PHONE: Business _____ Home _____

LOCATION 150W TR 1168 (McCrary) TR Riverwood 1/4-1/2 mile on left

S. R. No. _____

SUBDIVISION NAME Crescent Lake Norman LOT NO. 75 SECTION OR BLOCK NO. 10

House (✓) Mobile Home ( ) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site ~~Suitable~~ PS Yes (✓) No ( )

Character & Porosity of Soil PS clay
Percolation Rate ~49" 4'
Topography
Depth to Water Table 4'+
Rock or other impervious formations none obs.

Lot Area 1/2 AC +

_____ Basement with Plumbing ✓ Basement without Plumbing _____ No Basement

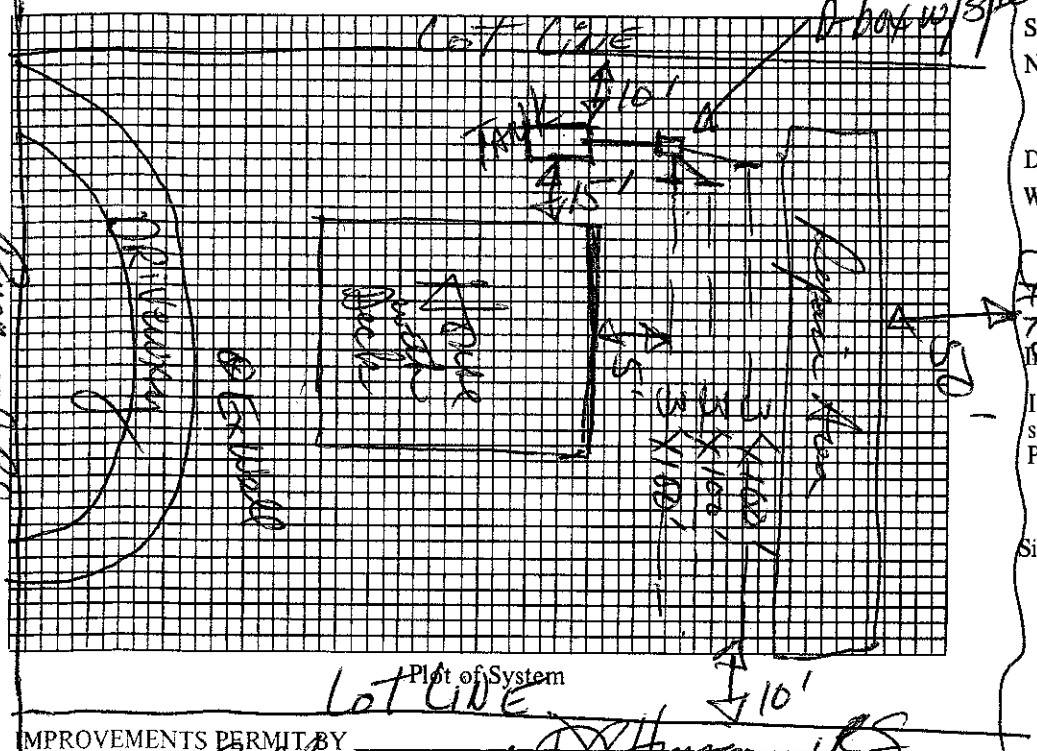

Plot of System

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 3
Sq. Ft. 900 Linear Ft. 300
Depth of Stone in Lines 12"
Water Supply: Individual (✓) Ex.
Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Kenny B. Lawson

IMPROVEMENTS PERMIT BY _____

COMMENTS: Follow contour w/ drainfield. 36" max trench bottom depth. May use drop boxes if needed or desired.

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold