DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

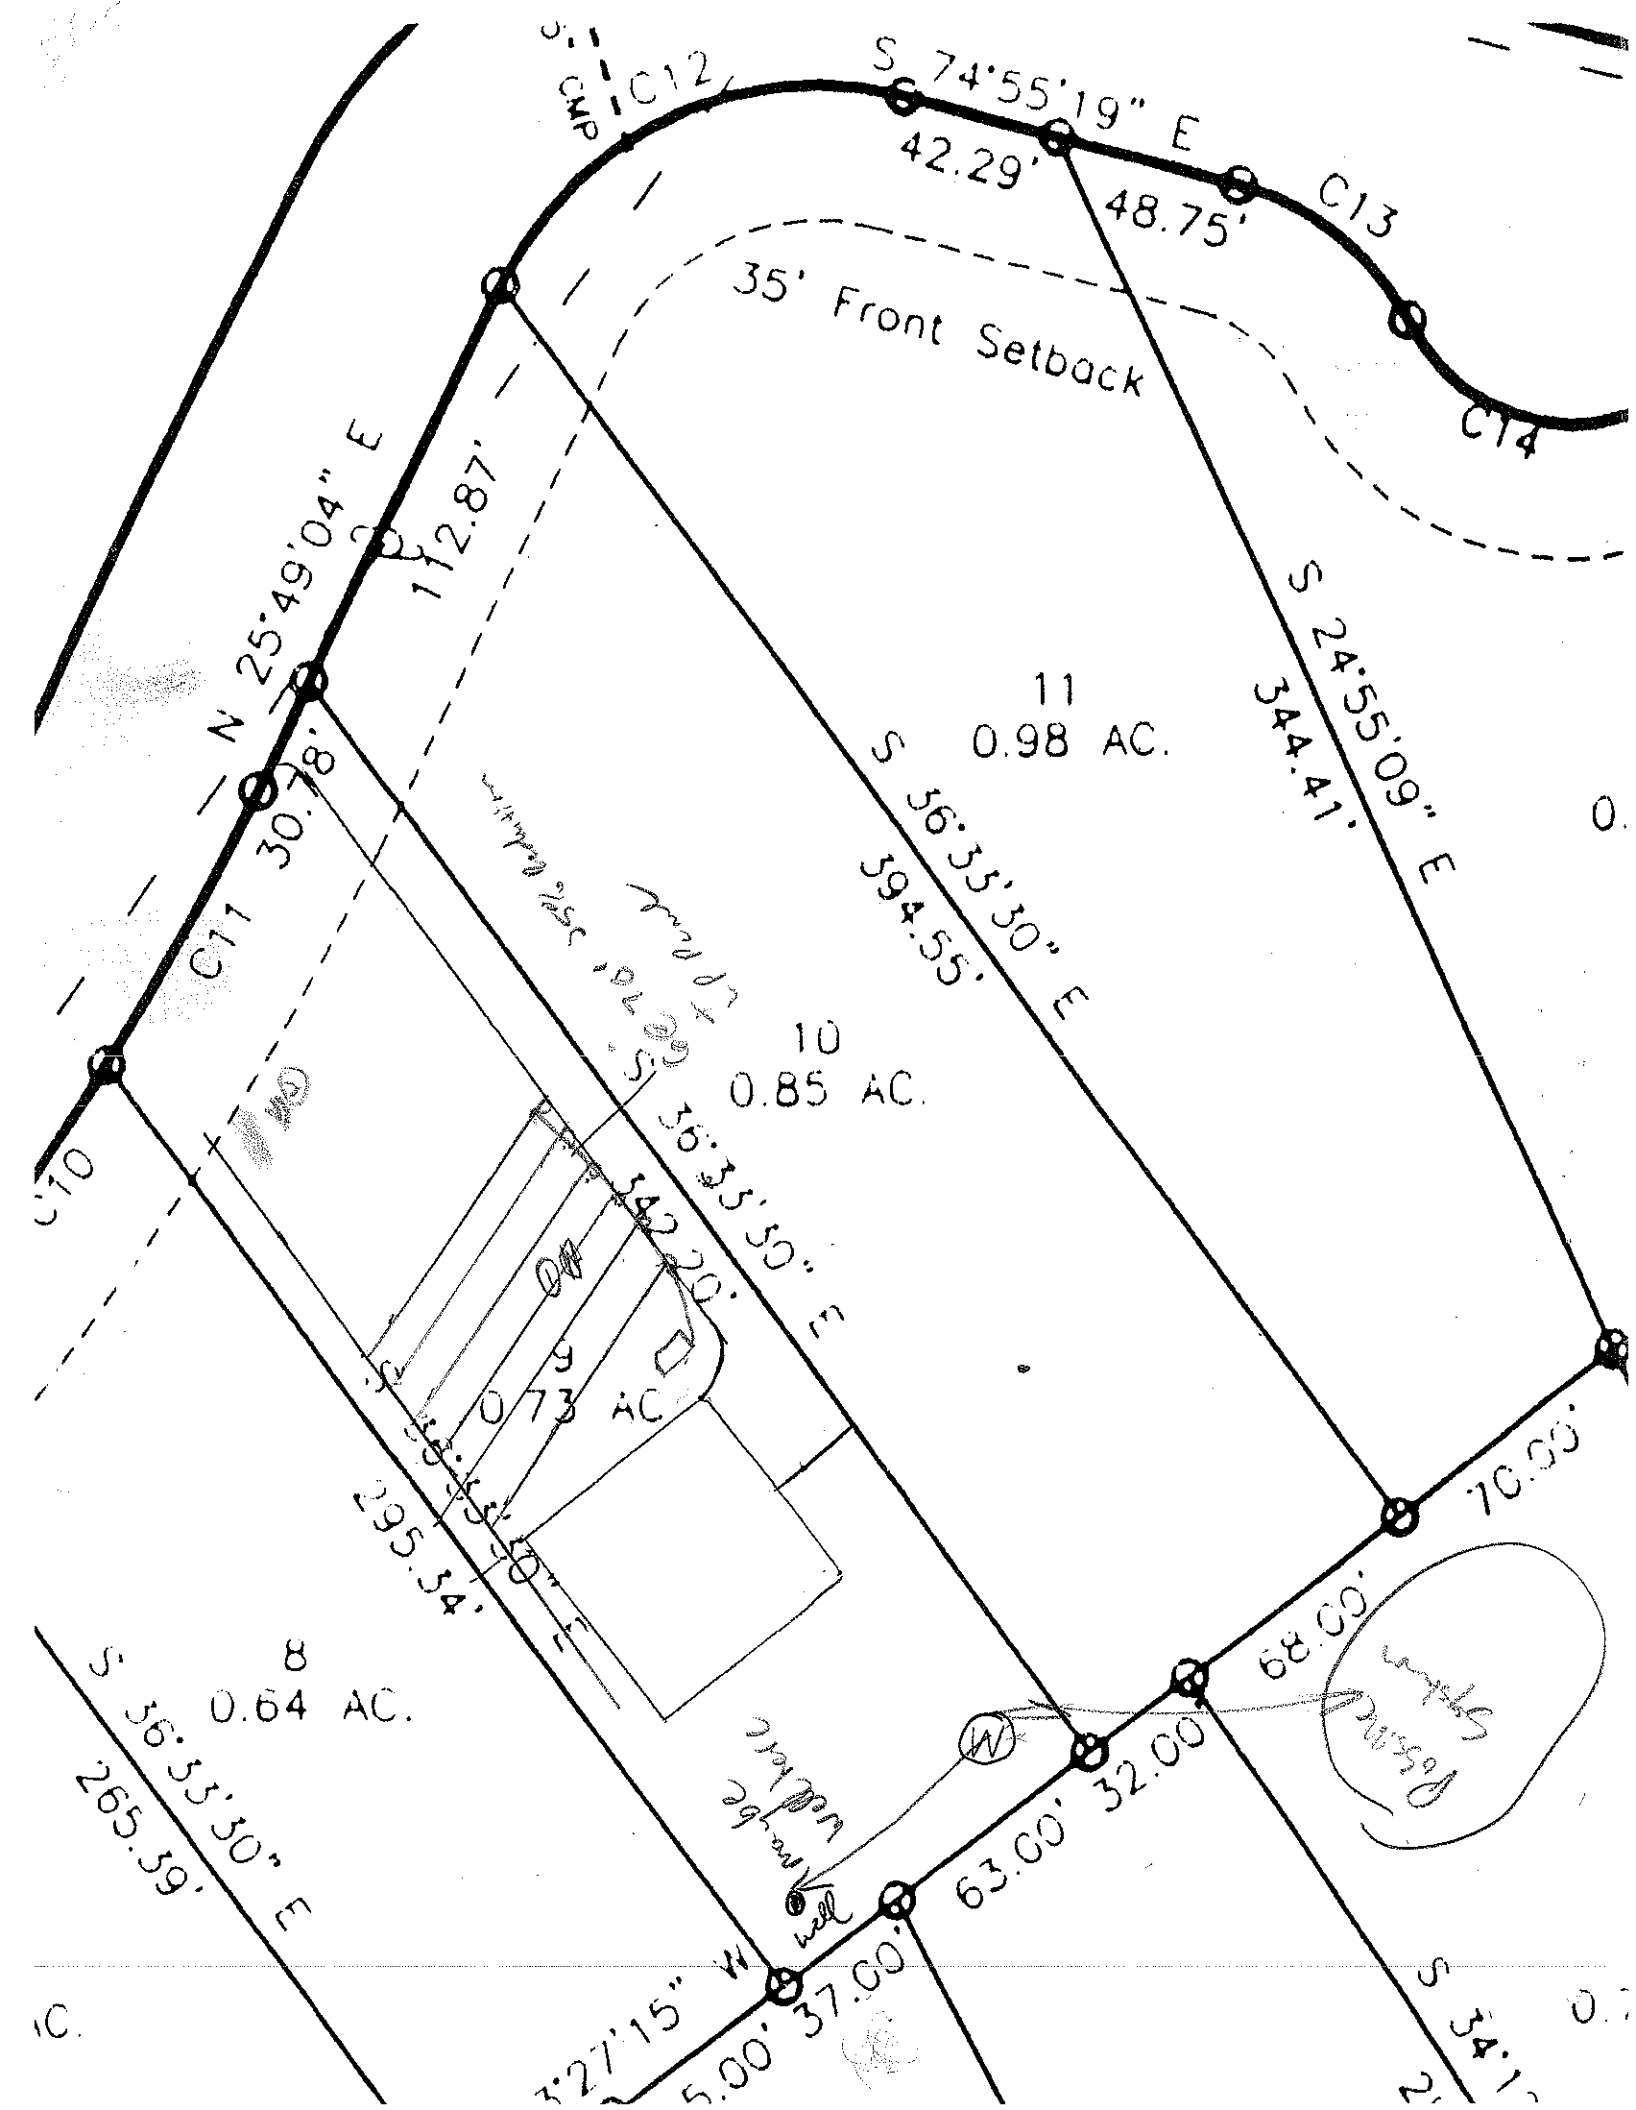
OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: lot 9 Meran PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-23	R CL WSBK	fri SSSP					PS .35
		23-52	L SAP Mang	fri SSSP					
2		0-5	SiL WSBK	fri SSP					PS .35
		5-30	RC SBK	fri SP + Y Mang					
		30-40	CL WSBK	fri SSSP Rock mix					
		40-50	RB L Mn	SSP fri					
3									
4									

DESCRIPTION	PROFILE #	REPAIR SYSTEM	SITE PLAN #
Available Space (.1945)			
System Type(s)			
Site LTAR			

SITE CLASSIFICATION (.1948): _____

EVALUATED BY: _____
OTHER(S) PRESENT: _____


C12
S 74°55'19" E
42.29'
48.75'
C13
C14
35' Front Setback
N 25°49'04" E
112.87'
C11 30.78'
C10
11
0.98 AC.
S 24°55'09" E
344.41'
S 36°35'50" E
594.55'
10
0.85 AC.
9
0.73 AC.
S 36°35'50" E
543.20'
S 36°35'50" E
295.54'
8
0.64 AC.
S 36°35'50" E
265.59'
70.00'
68.00'
63.00'
32.00
37.00'
S 34°
well