4637074642 4637074593

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Gerald & Patricia Roberts DATE 5/9/89 PERMIT NO. 17D

PHONE: Business _____ Home _____

LOCATION 150 W. TL Spring Acres lot 1 and 2 (Block B) S. R. No. _____

SUBDIVISION NAME Spring Acres LOT NO. 1 & 2 SECTION OR BLOCK NO. 2L-7-B 1 and 2 (Block B)

House (✓) Mobile Home ( ) Business ( ) Other _____


No. Bedrooms 2 No. Bathrooms 2

Garbage Disposal Unit	Yes ( )	No (✓)	
Auto. Dishwasher	Yes (✓)	No ( )	
Auto. Wash. Machine	Yes (✓)	No ( )	
Site Suitable	Yes (✓)	No ( )	

Character & Porosity of Soil Clayey
Percolation Rate .35gpd/ft²
Topography 4-J 8%
Depth to Water Table 4'+
Rock or other impervious formations None Obs

Lot Area _____

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

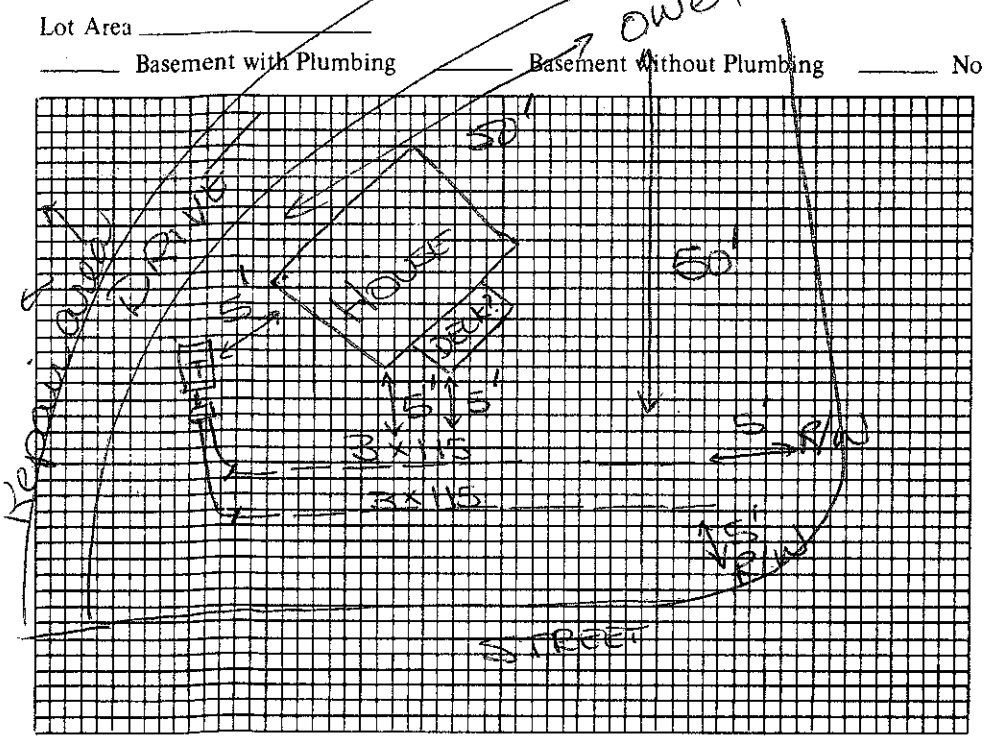

Plot of System

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 2
Sq. Ft. 690 Linear Ft. 230
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by Ray Beam

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY Andre C. Pierce

COMMENTS: Heavy rains expected today. Drizzling @ present

CERTIFICATE OF COMPLETION BY Andre C. Pierce DATE 5/9/89

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

9683

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Gerald & Patricia Roberts DATE 4/10/89 Quad# ~~PERMIT NO.~~ 17D

PHONE: Business ______ Home 392-6661

LOCATION 150 W. TL Spring Acres Lot 1&2 (Block B)

______ S. R. No. ______

SUBDIVISION NAME Spring Acres LOT NO. 1&2 SECTION OR BLOCK NO. ______

2L-7-B-1 and 2 (Block B)

House (✓) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 2 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Character & Porosity of Soil Clay (P.S.)

Percolation Rate .35 gpd/ft2


Topography 4-8%

Depth to Water Table 4'+

Rock or other impervious formations none obs

Lot Area ______

______ Basement with Plumbing ______ Basement without Plumbing ______ No Basement

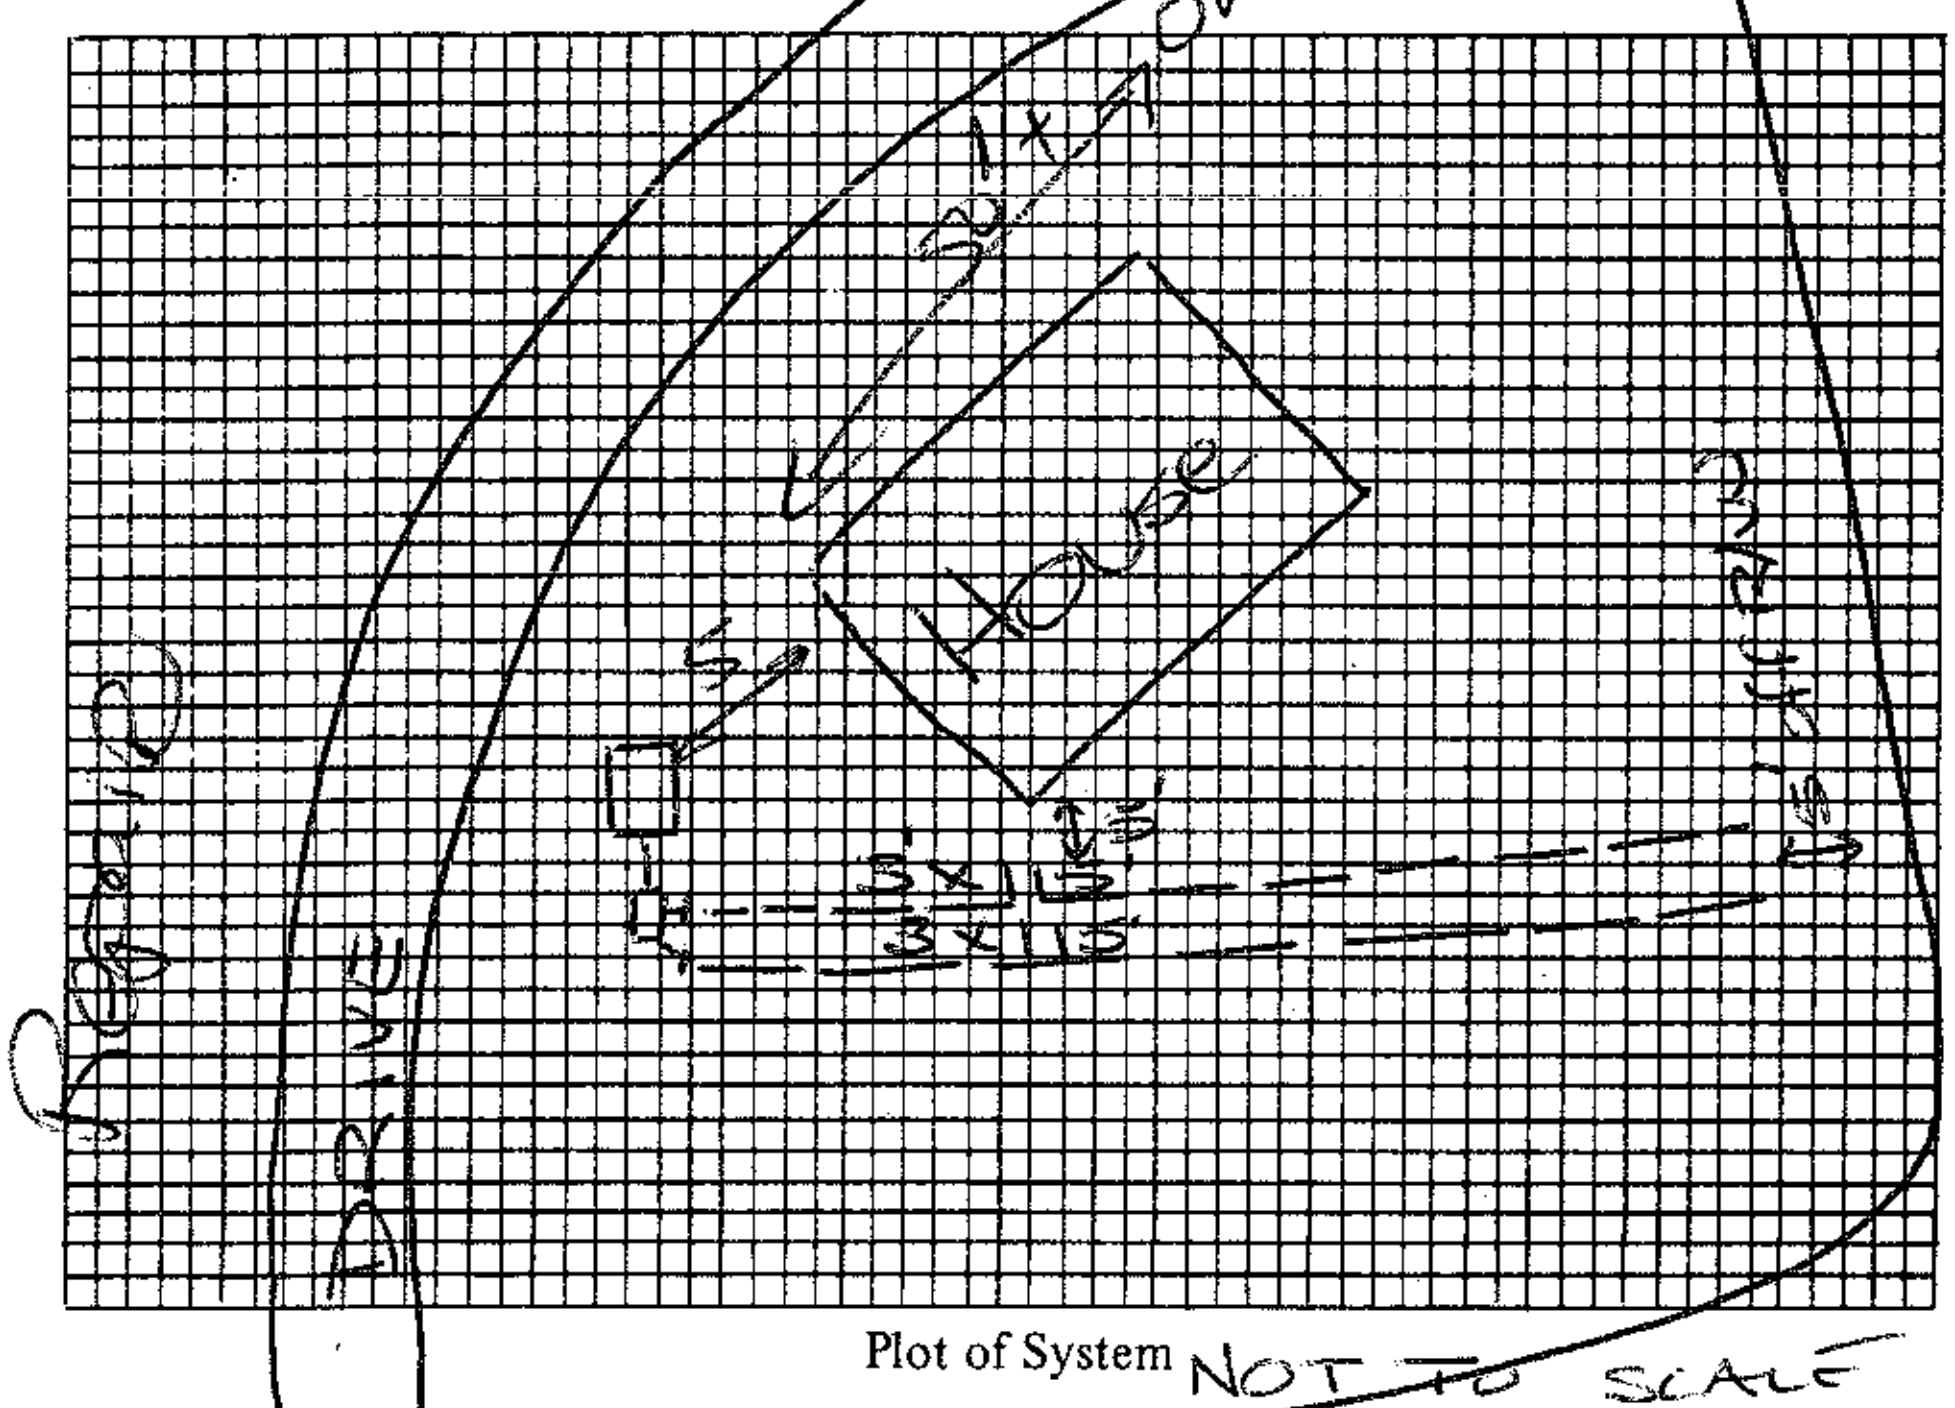

Plot of System NOT TO SCALE

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 2

Sq. Ft. 690 Linear Ft. 230

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

Installed by ______

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Gerald J. Roberts

IMPROVEMENTS PERMIT BY Andie [signature]

COMMENTS: Install tank shallowly. Lines must be a 30" max. to trench bottom. Lines should run on level contour.

CERTIFICATE OF COMPLETION BY ______ DATE ______

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold