07865

Pin 4637097816 1240 River Hwy

Type 4 Inspection 2-6-2003

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR JMJ Lumber Co. DATE May 19 '88 PERMIT NO. _____

PHONE: Business Carlos Deloresa Home 704 662-7799

LOCATION 50 W. on Rt past Big Daddy's and before Apple House 1240 River Hwy S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home ( ) Business (✓) Other ~7 employees at 25 gal/emp.

No. Bedrooms _____ No. Bathrooms 3

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes ( ) No (✓)

Auto. Wash. Machine Yes ( ) No (✓)

Site Suitable-PS Yes (✓) No ( )

Lot Area Acreage

Character & Porosity of Soil clay


Percolation Rate 43-47

Topography 4 6 ft

Depth to Water Table 4 ft

Rock or other impervious formations some large scattered rock

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement 1000 gal pumped tank

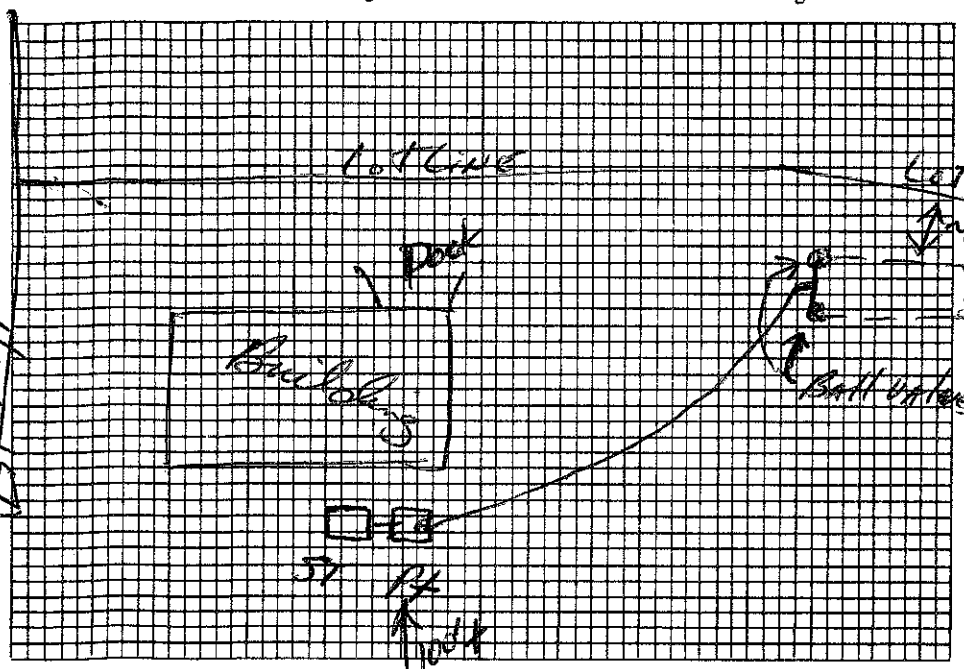

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 2
Sq. Ft. 660 Linear Ft. 220
Depth of Stone in Lines 12"

Water Supply: Individual (✓)
Public ( )

Installed by Dobson

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY DRH

COMMENTS: Plumbing stub-out changed as shown. High water alarm on site but not mounted. It was checked and found satisfactory.

CERTIFICATE OF COMPLETION BY D R Johnson, RS DATE 5-10-88

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

0865

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR JMJ Lumber Co. DATE 2-1-88 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 150 W on Rt. past Big Daddy's and before Apple House

S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home ( ) Business (✓) Other ~ 7employees @ 25gal/employee

No. Bedrooms — No. Bathrooms 3

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes ( ) No (✓)

Auto. Wash. Machine Yes ( ) No (✓)

Site ~~Suitable~~ P.S. Yes (✓) No ( )

Lot Area acreage

Character & Porosity of Soil clay

Percolation Rate ~ 3-4 0


Topography 4-6%

Depth to Water Table 4ft

Rock or other impervious formations some scattered rock

— Basement with Plumbing ____ Basement without Plumbing ✓ No Basement

1000 gal pump tank

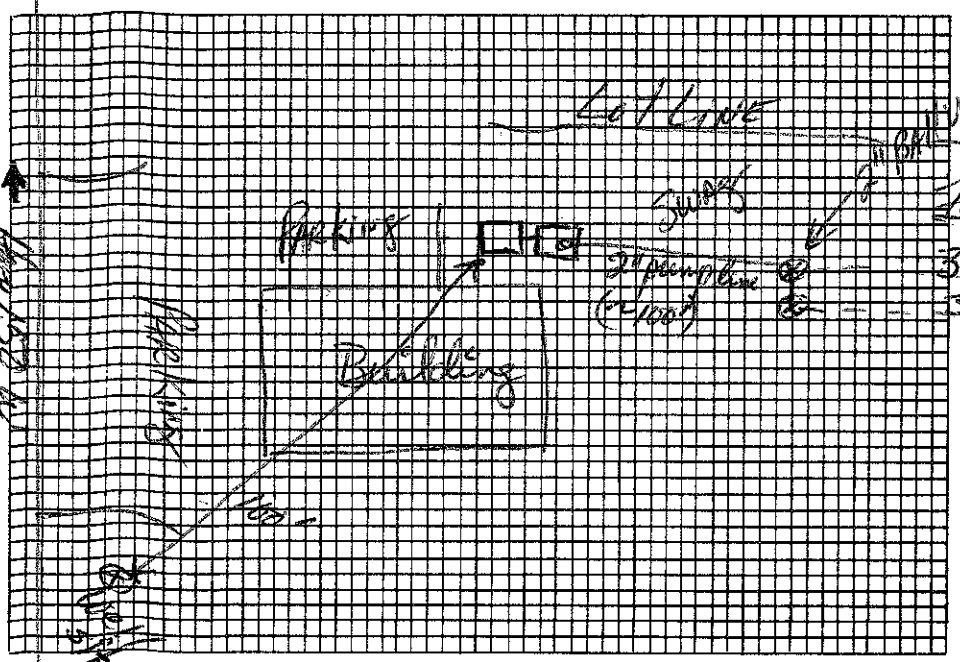

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 2

Sq. Ft. 660 Linear Ft. 220

Depth of Stone in Lines 12"

Water Supply: Individual (✓) Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY Marvin R. Hamm, R.S.

COMMENTS: No parking over AREA of tanks and drainfield. Drainfield to be installed with 12" cover (24" to bottom of ditch) and grade run level on ditch bottom. Follow ~~contour~~ contour! from 2" ball valves at head of each ditch reduce down to 1½" pvc with 1 - 5/32" holes drilled every 5 feet. Need pump capable of delivering 19 gal/min at the 18' TDH.

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold