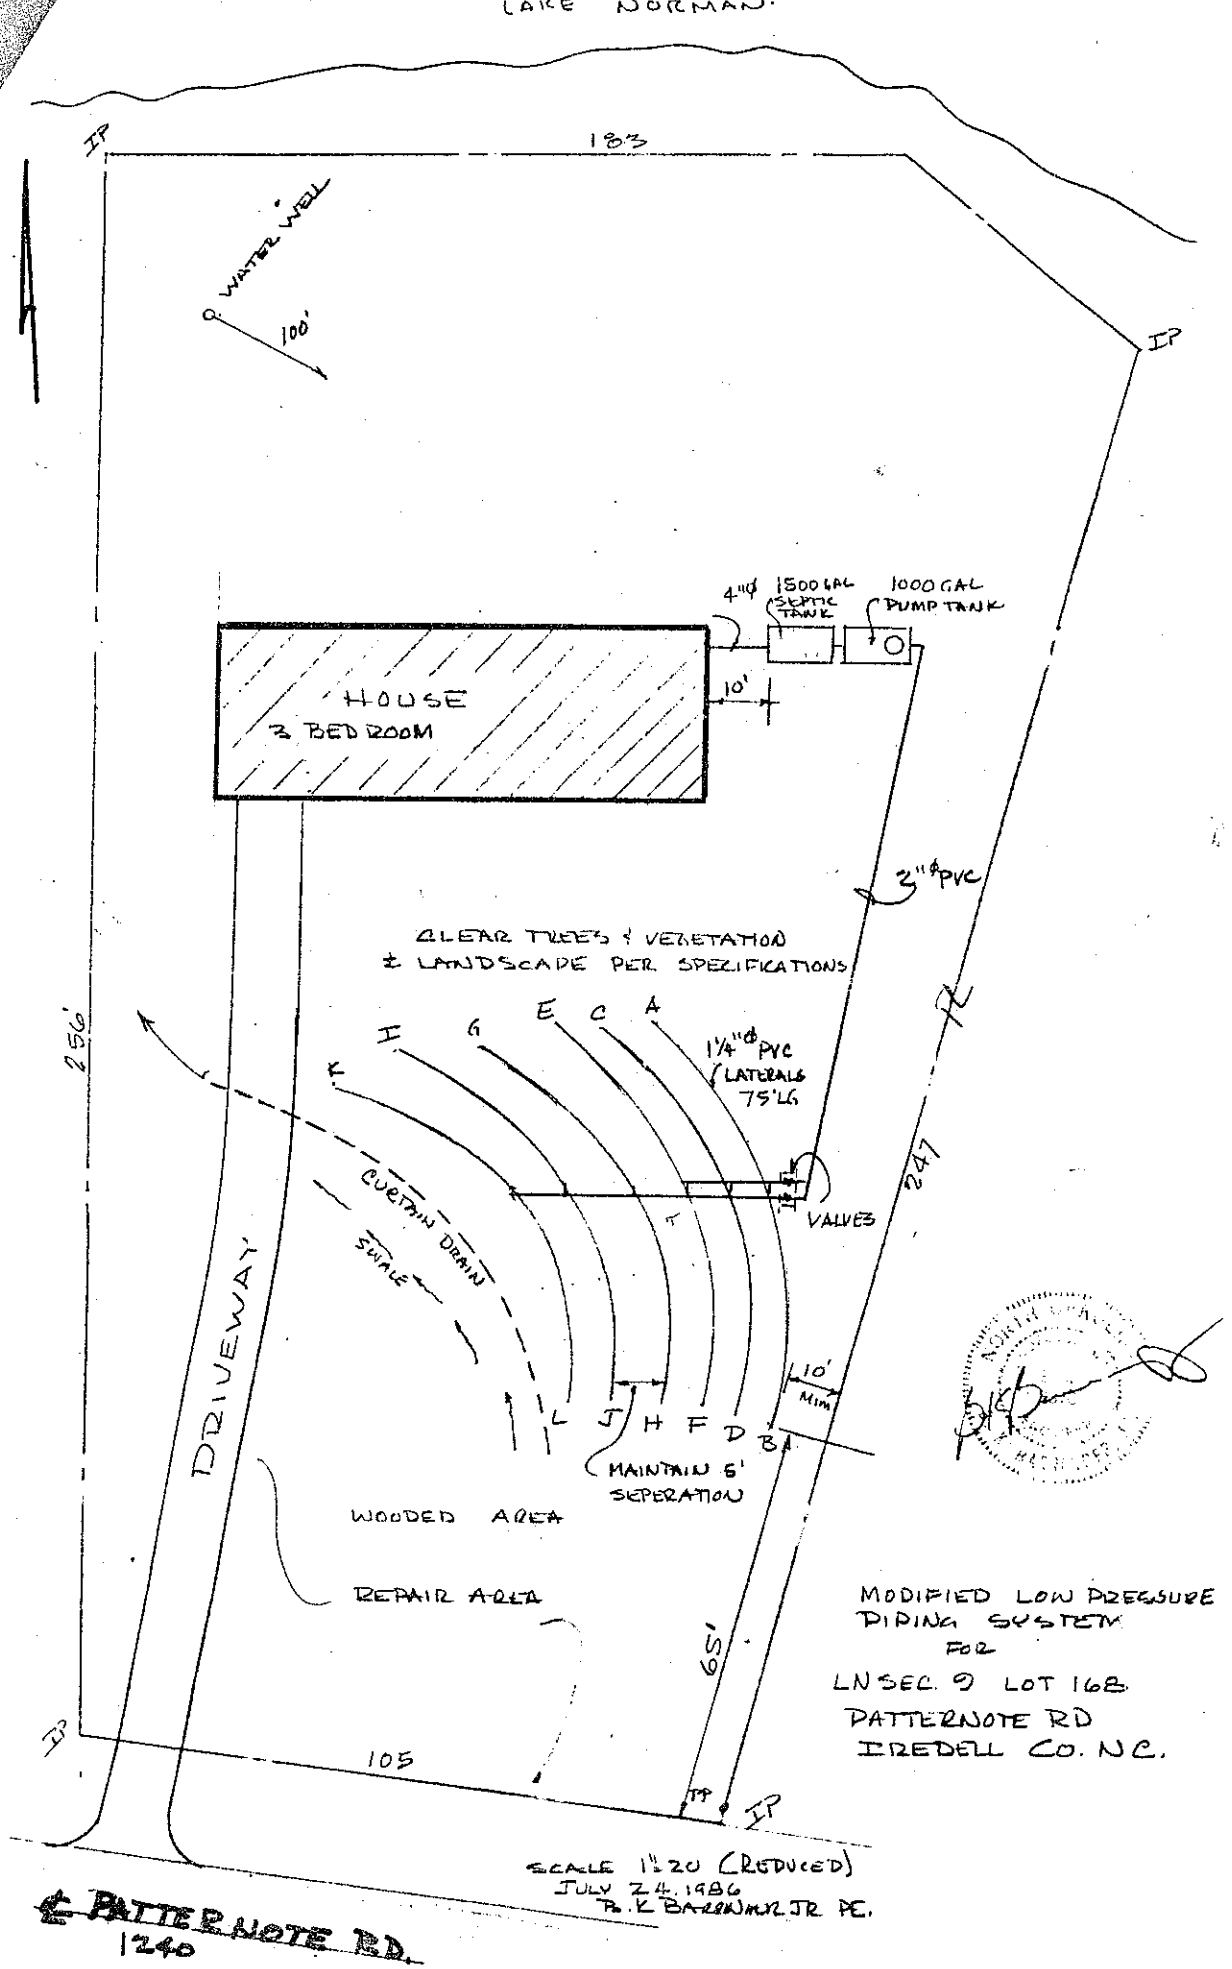

LAKE NORMAN.
IP
183
WATER WELL
100'
IP
4"ϕ
1500 GAL SEPTIC TANK
1000 GAL PUMP TANK
HOUSE
3 BED ROOM
10'
3"ϕ PVC
CLEAR TREES & VEGETATION & LANDSCAPE PER SPECIFICATIONS
E
C
A
I
G
K
1¼"ϕ PVC LATERALS 75'LG
VALVES
256'
247'
CURTAIN DRAIN
SWALE
DRIVEWAY
L
J
H
F
D
B
10' Min
MAINTAIN 6' SEPERATION
WOODED AREA
REPAIR AREA
65'
IP
105
IP
SCALE 1"=20' (REDUCED)
JULY 24, 1986
P. K. BARRON JR. PE.
PATTERNOTE RD.
1240
MODIFIED LOW PRESSURE PIPING SYSTEM FOR
LN SEC. 9 LOT 16B
PATTERNOTE RD
IREDELL CO. N.C.